LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/01/2020 Expiration Date: 10/01/2021

Property Owner: Melissa Guckenberg c/o:

Address: 625 Metzner Dr Fortine, MT 59918

Telephone: 406-890-0909 (Home) (Work)

Installer: Kootenai Sand & Gravel Inc. License No. 109

___ New Installation __XX__ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: 14'X80' Elevated sand mound system.

Parcel Description:

Legal: DICKEY LAKE LOTS, S16, T34 N, R25 W, ACRES 0.77, LOT 11 OR PRCL A CS 2934

Address or Location: LOT 11

Geo/Assessors code: 0000001352

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 2000/500 gallons Drainfield Size: 1120 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Donavan Truman *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 11/25/20

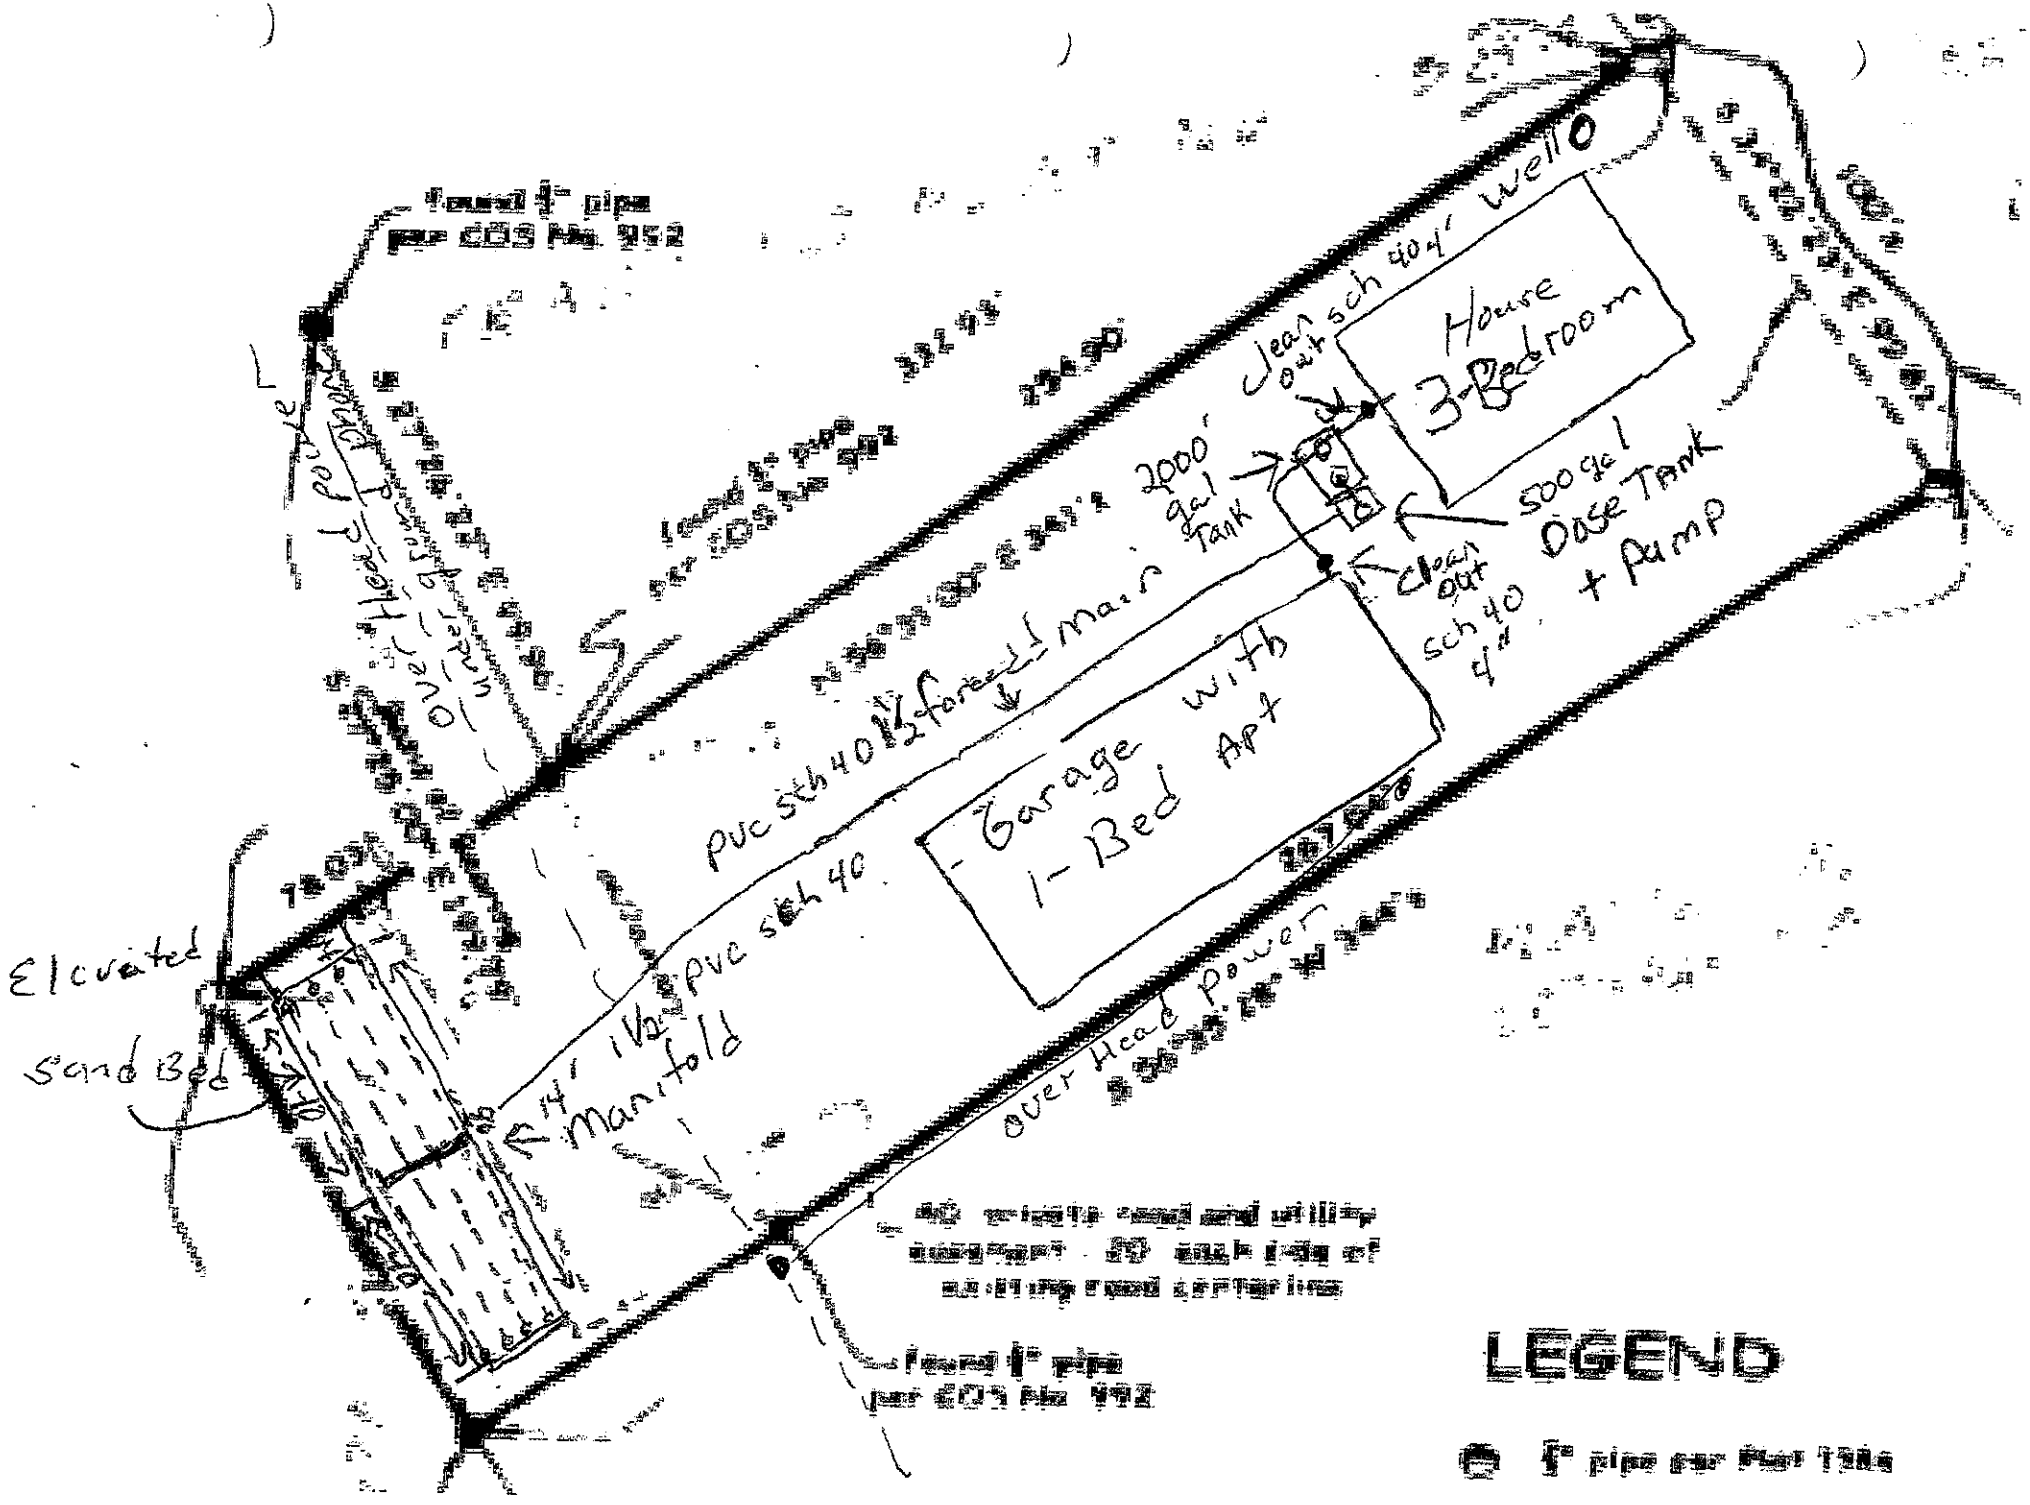
Title: Licensed Installer - 109 - Kootenai Sand & Gravel

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Found 1" pipe
per COS No. 952
Overhead power
pvc sch 40 1½ forced Main
2000 gal Tank
Clean out sch 40 4" well
House
3-Bedroom
500 gal Dose Tank + Pump
Clean out sch 40 4"
- Garage with
1- Bed Apt
1½" pvc sch 40
Elevated
Sand Bed
14' 1½" pvc Manifold
over Head power
Found 1" pipe
per COS No. 952
LEGEND
1" pipe or Pin Flag