LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/14/2021 Expiration Date: 10/14/2022

Property Owner: Diane Harrison c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Charley Follensbee License No.: 96

Proposed Work: (Check One) XXX New Installation ___ Existing System

____ Repair ___ Replacement ____ Extension ____ Other

Describe:

Parcel Description:

Legal: S13+14, T37N, R27N, COS: 4674, Acres: 10.001

Address or Location: 338 Arena View Rd., Eureka, MT 59917

Assessment Code: 0000053284

Approved Design Criteria: 1500-gallon tank and 2 71' laterals w/ infiltrators

Bedrooms: 2 Septic Tank Size: 1500 gallons Drainfield Size: 142 Linear Ft.

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Dustin Webb, RS*

Closure Statement:

I Charley Follensbee have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Charley Follensbee *Date:* 10/29/21

Title:


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER
This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

N

1" = 200'

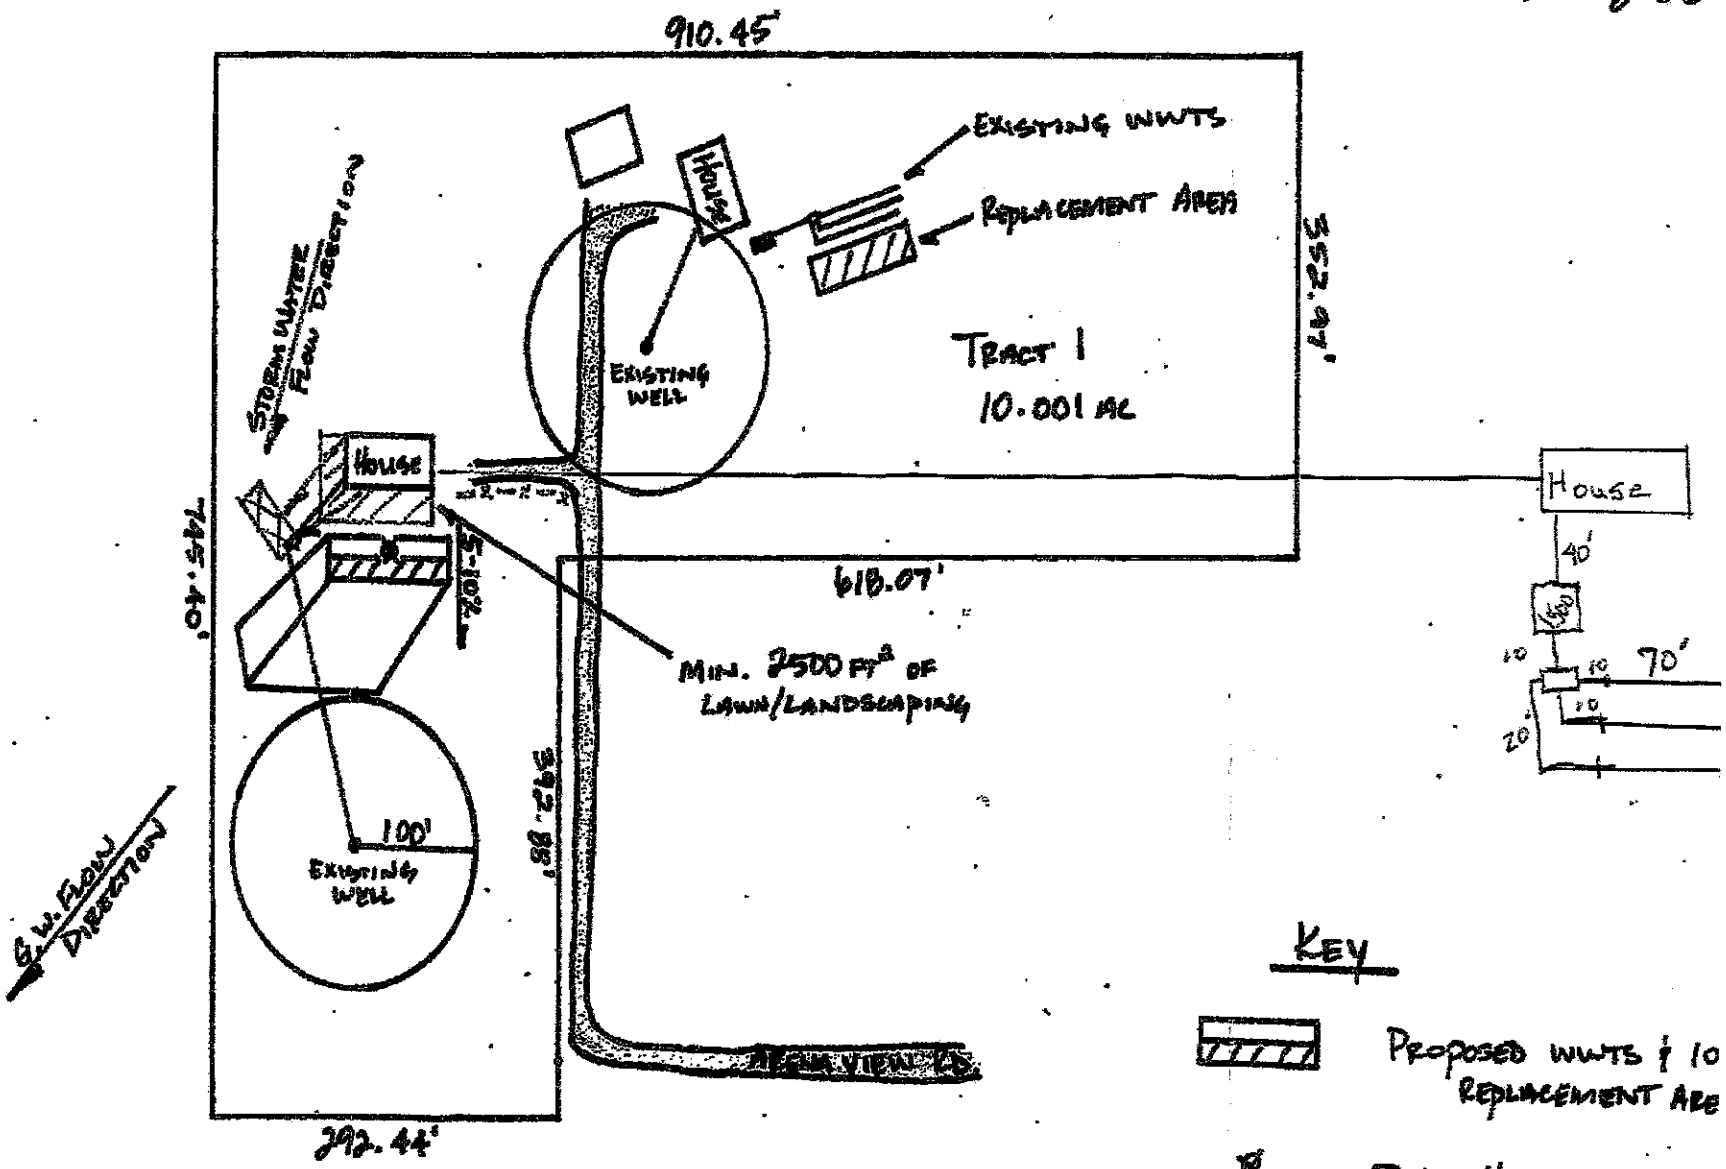

* NO OTHER WELLS OR NWTS W/IN 100' *
OF PROPERTY BOUNDARIES