LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/02/2020 Expiration Date: 10/02/2021

Property Owner: Jeff Johnson c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Brad Persson License No. 159

XX New Installation ____ Existing System

__Repair ____ Replacement ____ Extension ____ Other

Describe: Five 80' Lines 2' Wide Infiltrators.

Parcel Description:

Legal: S09, T35 N, R27 W, C.O.S. CS 2899, PARCEL C, ACRES 20, IN NW4

Address or Location: Slick Gulch Rd Rexford, MT 59930

Geo/Assessors code: 0000011272

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 400 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Bradley S. Persson, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 9-20-2021

Title: 159 Installer.

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

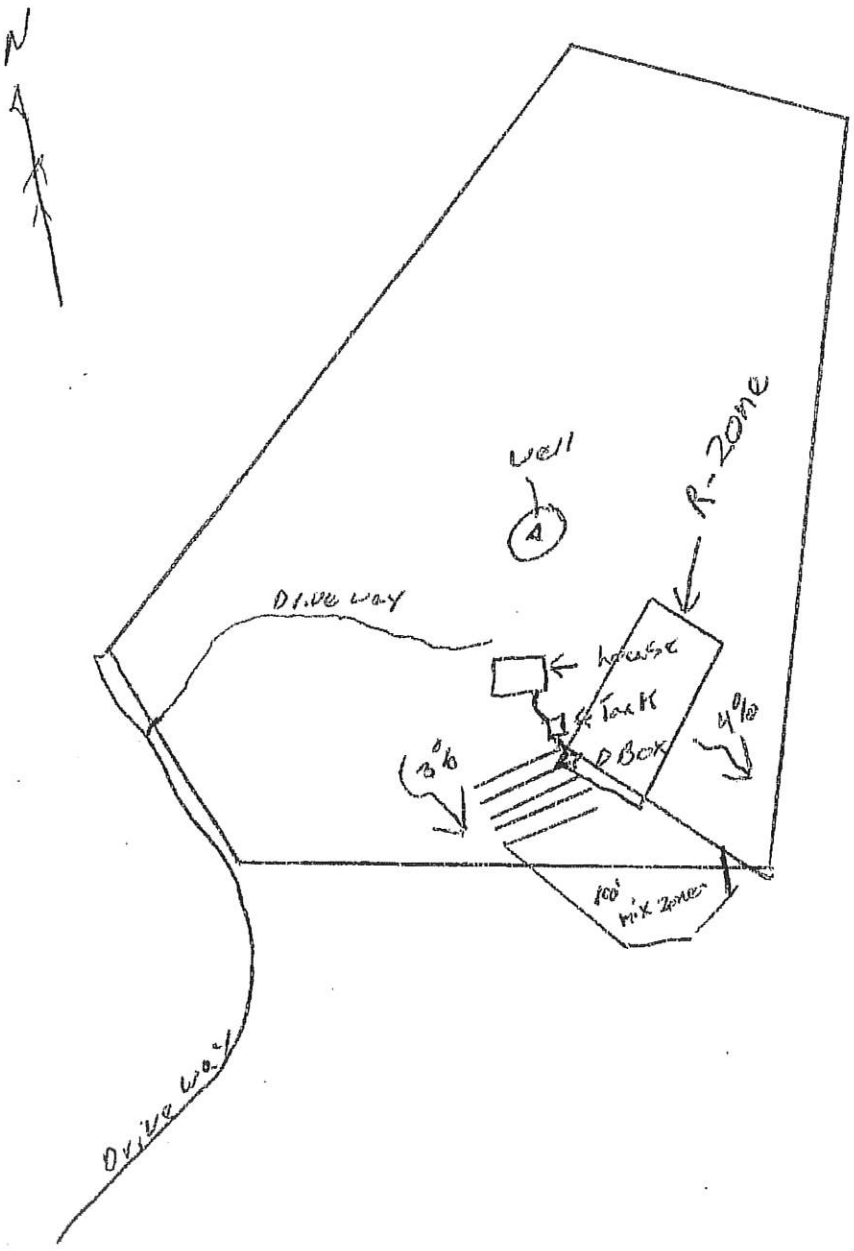
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

RECEIVED
OCT 07 2021
BY: [signature]

LOT LAYOUT


N
well
A
R-zone
Drive way
house
Tank
D Box
3%
4%
100' Mix Zone
Drive way