SEPTIC TANK PERMIT Permit Sent 9/17/79

for

LINCOLN COUNTY

Permit No. 3-6483 Date 9/13/79

Property Owner TED JOHNSON Address BOX 141 LIBBY


Lot, Block Number, or legal description of Property LOT 9 KOOTENAI HGTS 1ST ADD'N.

To be built by: SMART Square feet absorption area. 400 SQ. FT.

Septic Tank Size 1000 GAL # of bedrooms 3 Water Supply SHARED WELL

Description of Absorption Area: DIG A DITCH AT LEAST 200' IN LENGTH x 2½-3' DEEP x 2' WIDE ACCORDING TO LOT LAYOUT AND DITCH DIAGRAM. GRADE OF PIPE SHOULD NOT EXCEED 1% DEEP.

Sketch: Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

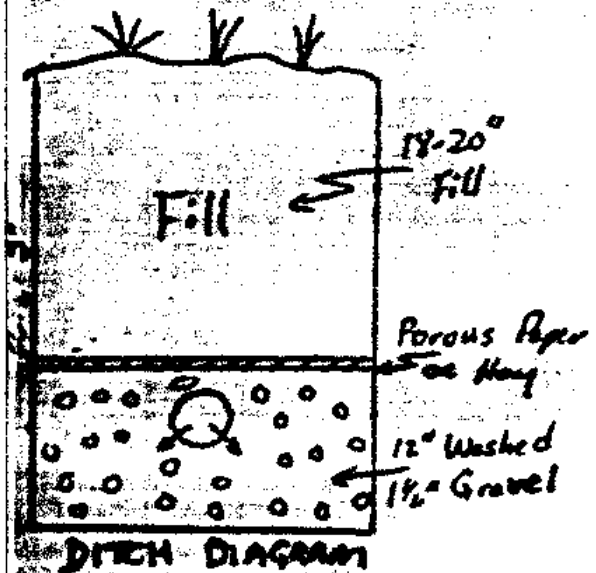


DITCH DIAGRAM

SOIL: TIGHT SANDY SILT

SLOPE: 0%

LOT LAYOUT

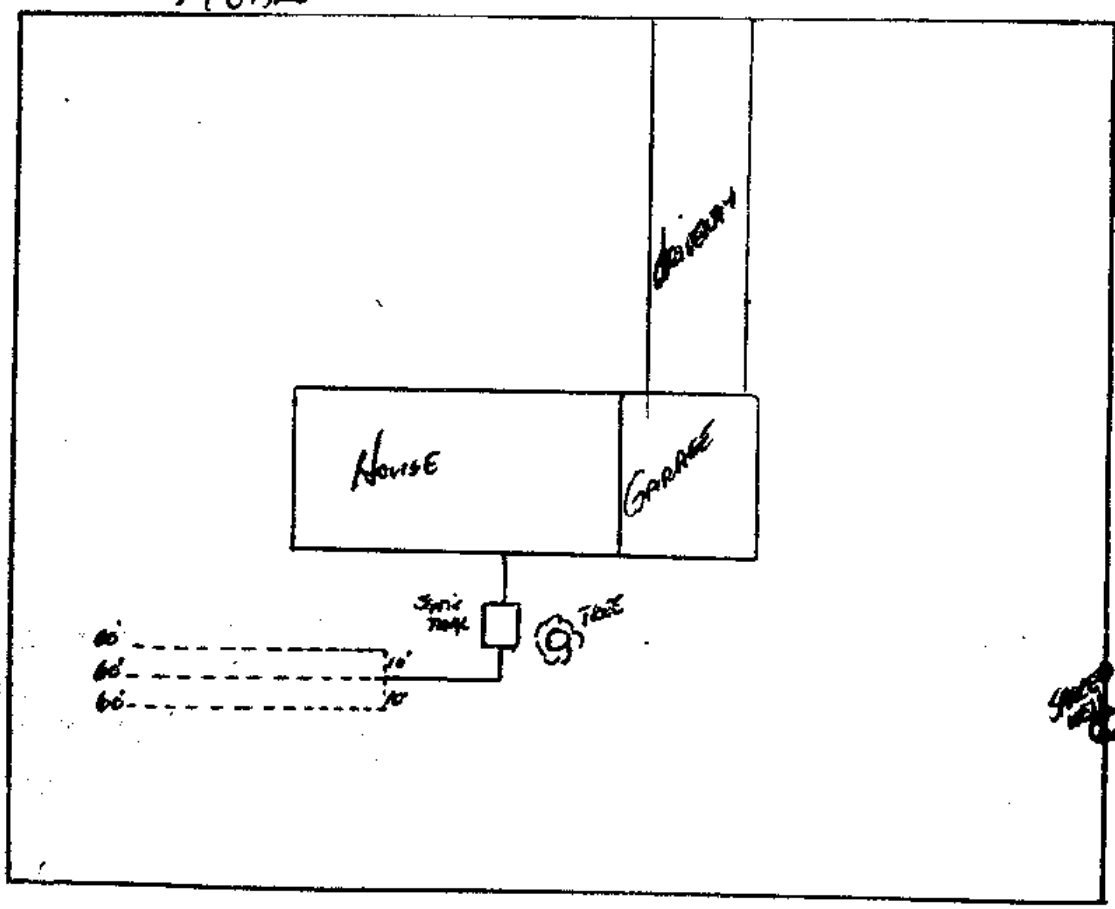

Issued by Ron Anderson Inspected by

Date 9/17/79