LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/07/2021

Expiration Date: 10/07/2022

Property Owner: KLMNO

c/o: Mark & Charlotte Nelson

Address: [redacted]

Telephone: [redacted] (Work)

Installer: TBD-Will be a certified Installer License No. 56

__XX__ New Installation ____ Existing System

__Repair ____ Replacement ____ Extension __XX__ Other (Renewal)

Describe: Four 64' pressure dosed laterals in 3' wide chambers.

Parcel Description:

Legal: S30, T36 N, R26 W TR 5D CS 375

Address or Location: US Highway 93 S Eureka, MT 59917

Geo/Assessors code: 0000007051

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1500 gallons Drainfield Size: 256 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

MONTANA
ANDY MEFFORD
No. 16208PE
Licensed
PROFESSIONAL ENGINEER

Closure Statement:

I, Andy Mefford, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 6/15/22

Title: Installer

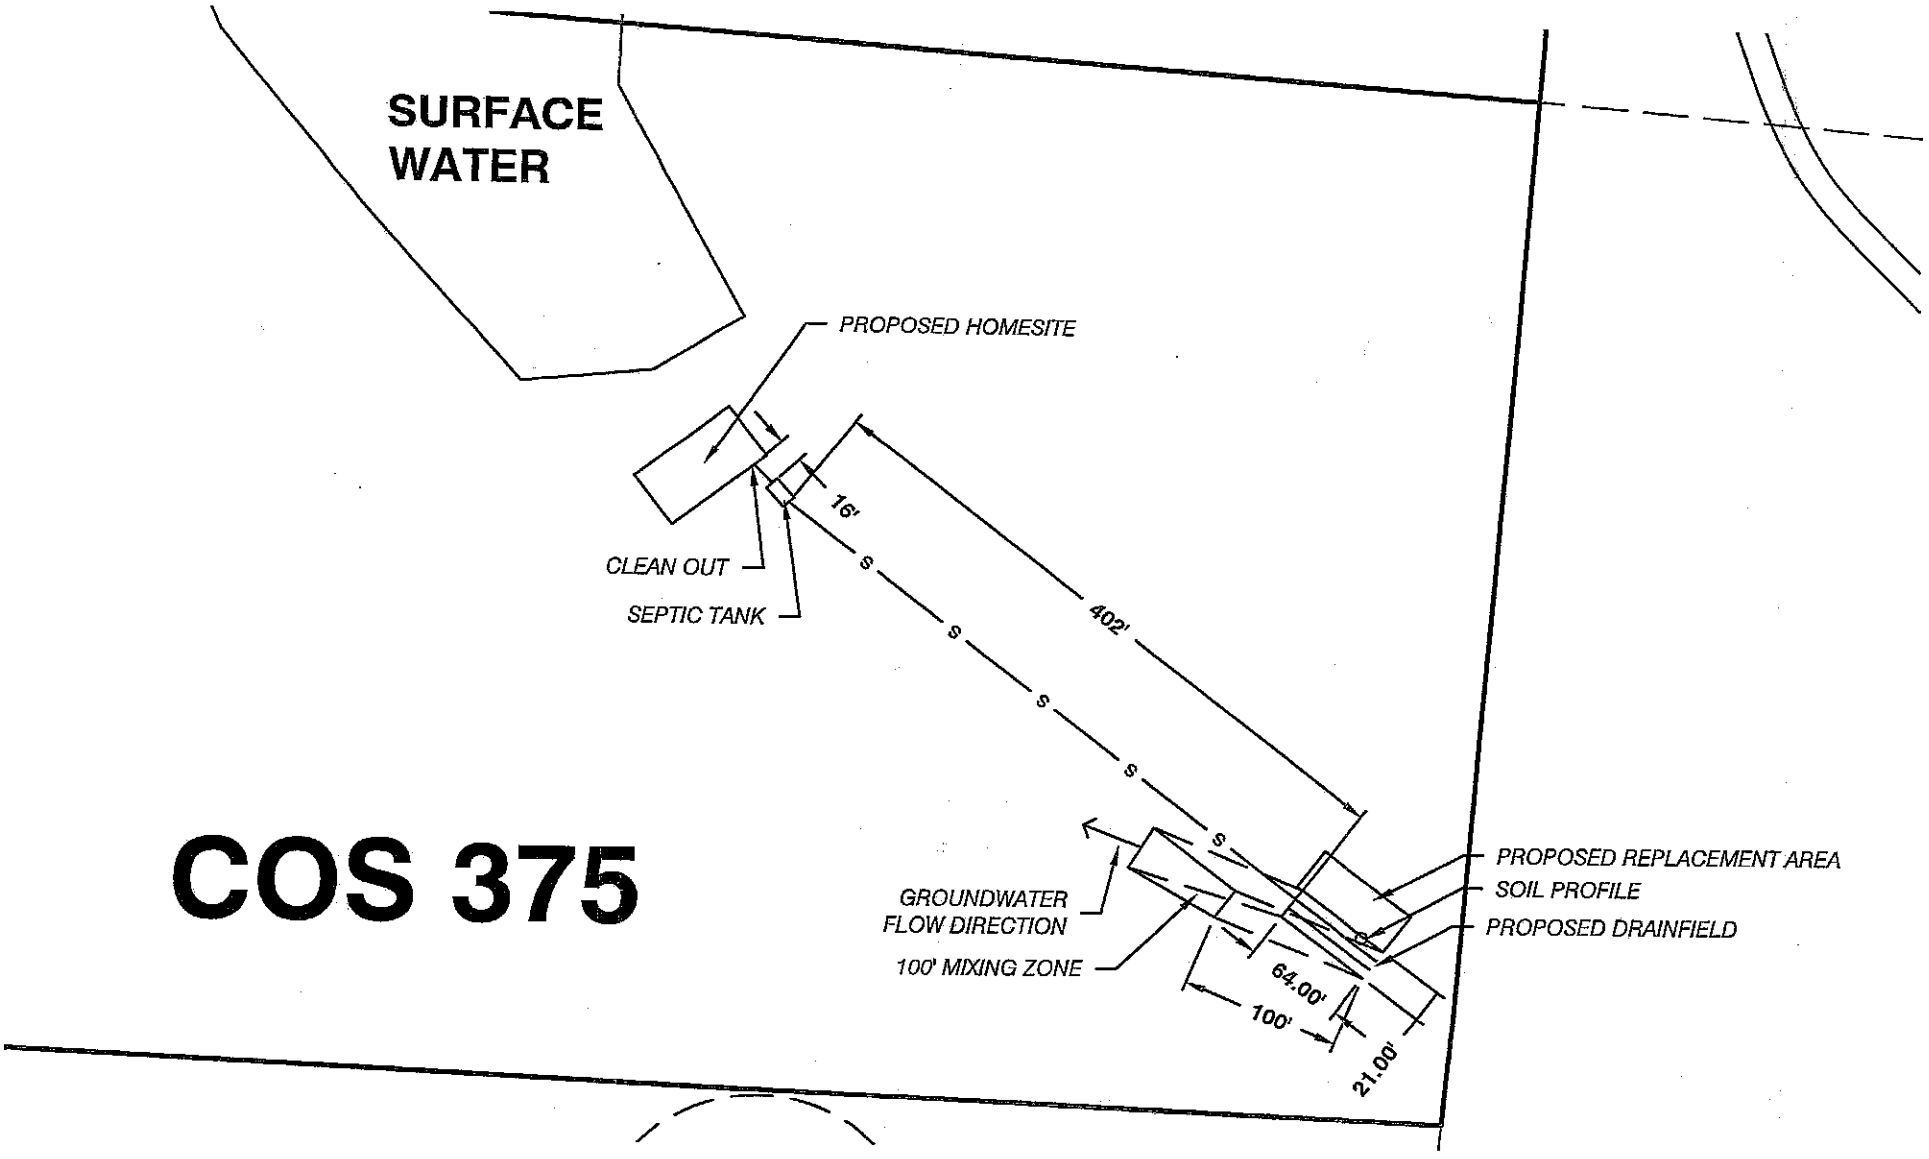
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

$


SURFACE WATER
PROPOSED HOMESITE
16'
CLEAN OUT
SEPTIC TANK
S
S
S
S
S
402'
GROUNDWATER FLOW DIRECTION
100' MIXING ZONE
PROPOSED REPLACEMENT AREA
SOIL PROFILE
PROPOSED DRAINFIELD
64.00'
100'
21.00'

COS 375