LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/24/2021 Expiration Date: 03/24/2022

Property Owner: Karl Kassler c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work) [redacted]

Installer: Karl Kassler License No. 135 (MDS)

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 66' laterals using gravelless chambers.

Parcel Description:

Legal: S15, T36 N, R27 W, C.O.S. 4202, ACRES 256.192, TRACTS 2-3-4-5 & TRACT 1 of CS 4211

Address or Location: 359 Osloski Road Eureka, MT 59917

Geo/Assessors code: 0000011540

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000/500 gallons Drainfield Size: (2)-66' Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Burk Schuerman *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Burk Schuerman *Date:* 4/28/21

Title: President


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

REV	DESCRIPTION	BY/DATE	APPD

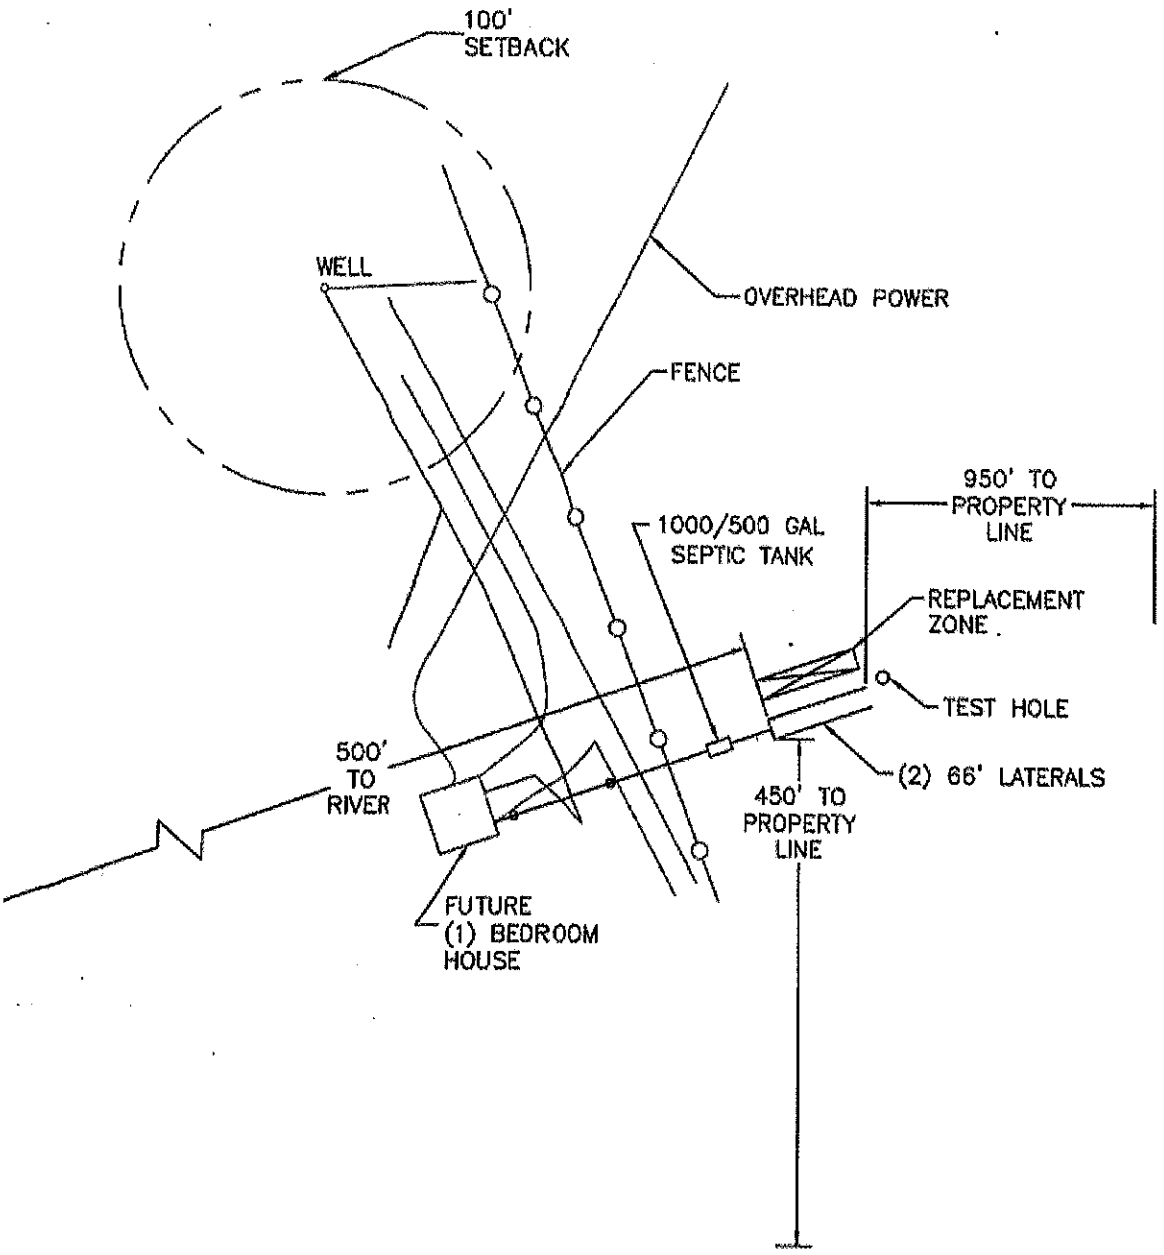

ARL KASSLER 359 OSLOSKI ROAD
EUREKA, MT 59917

REV	DATE	COMPANY	SCALE	SURVEY ACCEPTANCE	MONTANA DESIGN SERVICES
		MDS	1/16 = NOTED		KASSLER SEPTIC
		CONTRACT	DATE	DRG TOLERANCES	SITE LAYOUT
		VERBAL	1/21		1/2
		PLOT FILE	WEIGHT		1/2
		PML-0001		FINISH	MEEKER

THIS DRAWING IS PROPERTY OF MDS UNTIL CONTRACT HAS BEEN SIGNED BETWEEN OWNER & MDS IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT