LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/19/2021 Expiration Date: 04/19/2022

Property Owner: Deborah Lampe c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Shayne Nelson Excavating LLC License No.

XX New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Three 84' laterals.

Parcel Description:

Legal: 24, T27 N, R28 W, C.O.S. 4577

Address or Location: LOT 8

Geo/Assessors code:

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 252 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, SHAYNE NELSON, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 5/14/2021

Title: OWNER NELSON EXCAVATION LLC

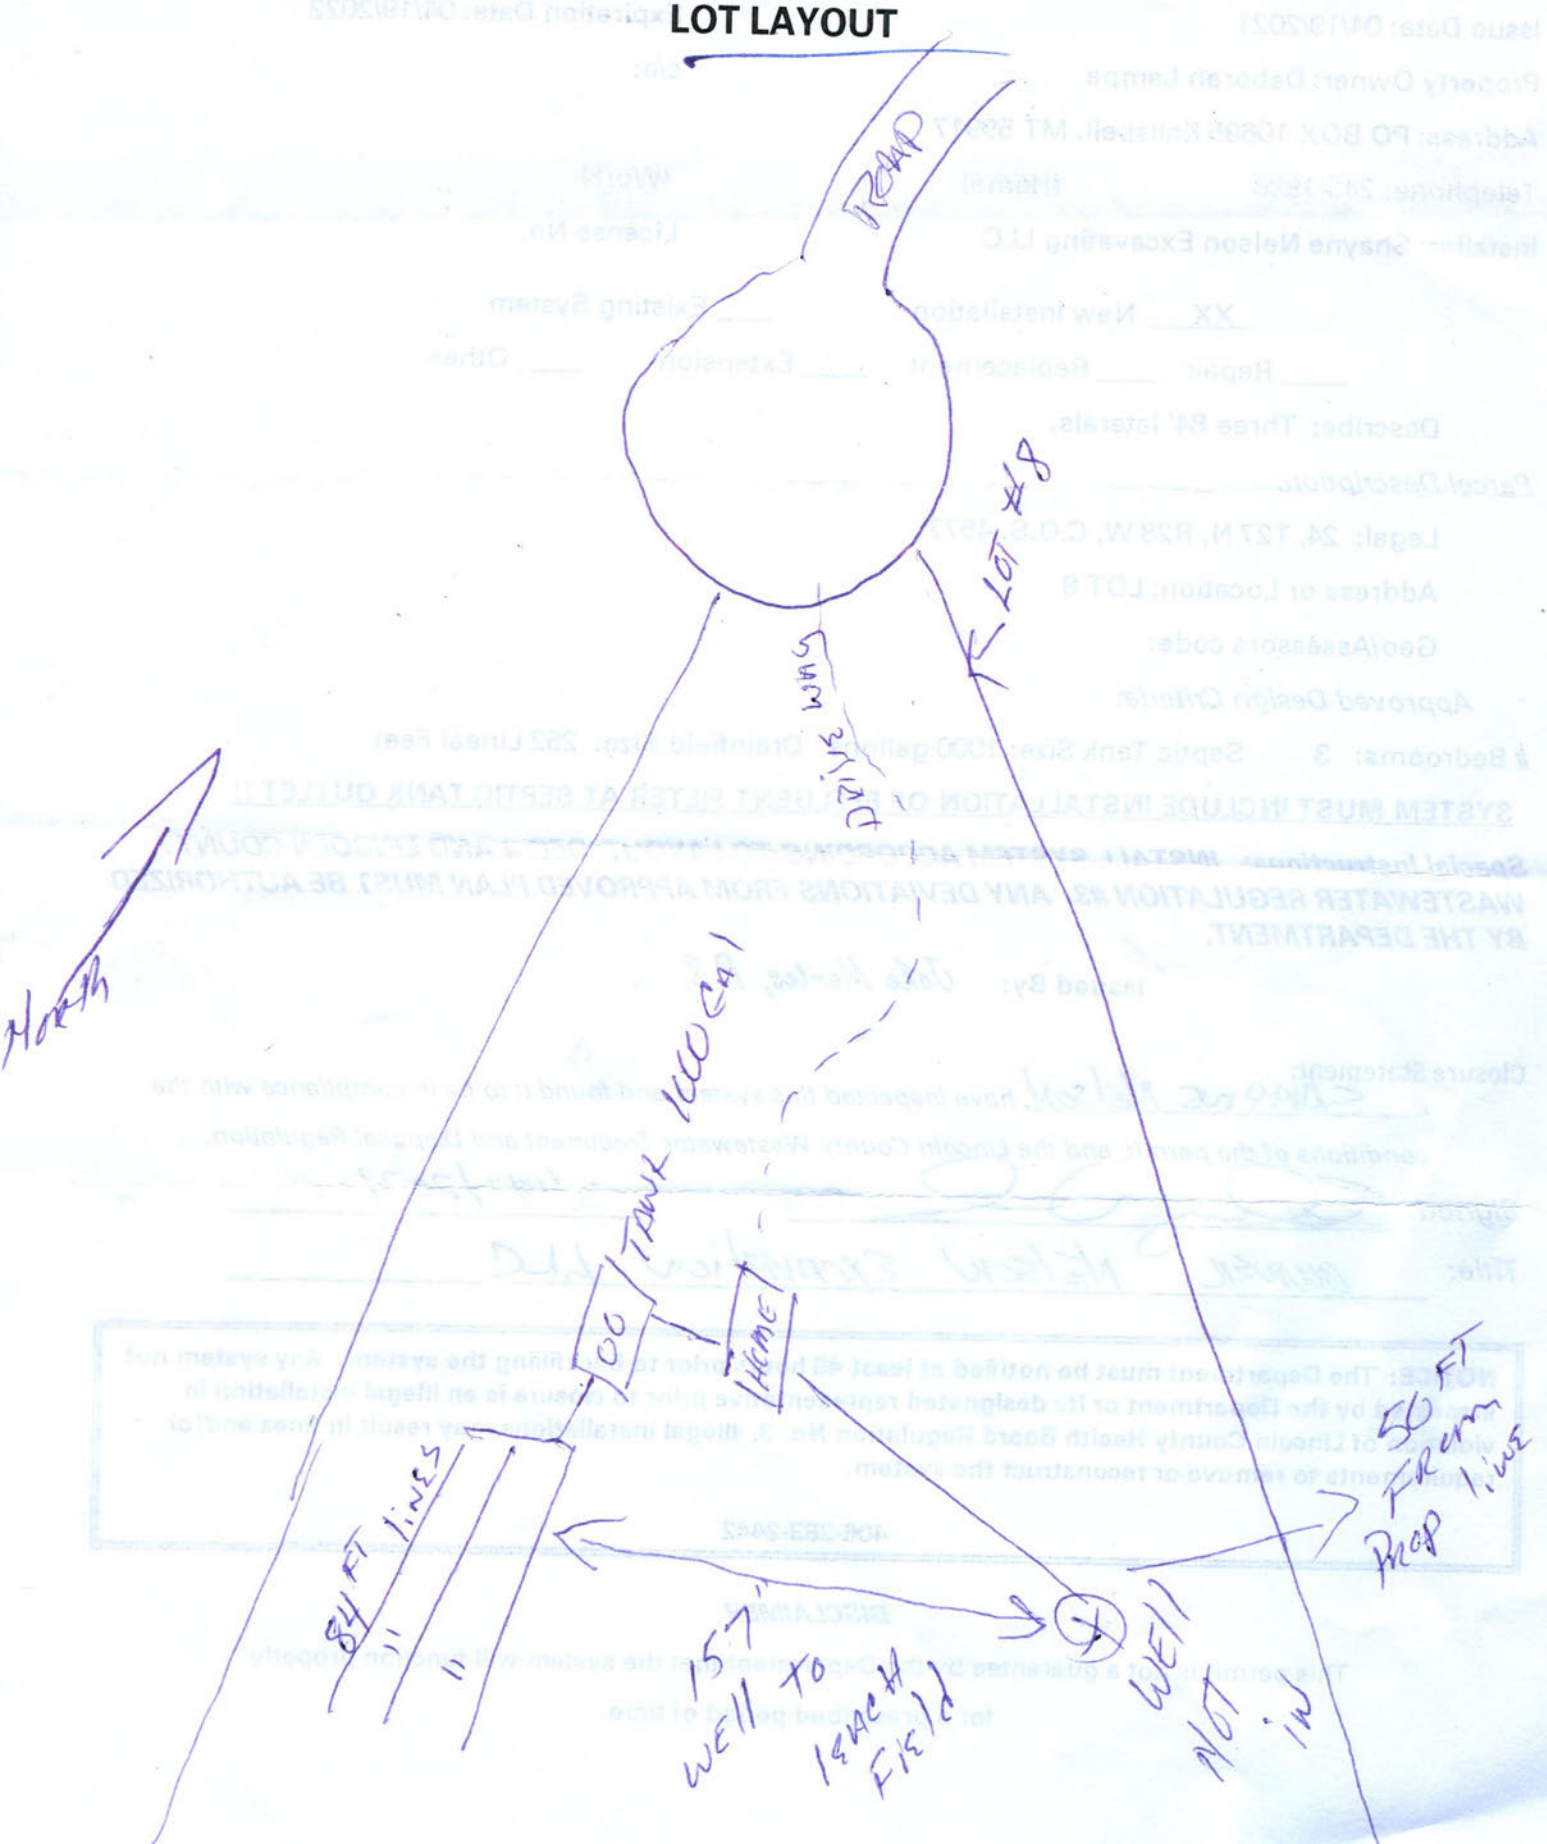
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


ROAD
LOT #8
DRIVE WAY
North
TANK 1000 GAL
CC
HOME
84 FT LINES
"
"
157' WELL TO ISAACH FIELD
WELL NOT IN
50 FT FROM PROP LINE