

**LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT**

Issue Date: 10/7/2021

Expiration Date: 10/6/2022

Property Owner: Shirin Lamp

Mailing Address: [REDACTED]

Telephone: [REDACTED]

E-mail: [REDACTED]

Installer: Melvin Smith

License #: 99

Approved Work: (Check One)

☒ New Installation

☐ Existing System

☐ Replace Drainfield

☐ Replace Tank

☐ Extension

Describe: Gravity system with standard 2' wide trenches, chambers

Parcel Description:

Legal: S32 T37N R31W, COS 3832FC, Vrendenburg Family Transfer, Parcel B, 13.74 acres

Property Address: Bentston Lane, Troy

Assessment Code: 53649

Approved Design Criteria:

of Bedrooms: 3

Septic Tank Size: 1000 gallons

Drainfield Size: 450 square feet

of Laterals: 3

Length of Laterals: 75 lineal feet

Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria, modified lot layout EQ #08-1569 and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: *[Signature]*

Date: *2-7-23*

☒ Lincoln County Health Department (LCHD)

☐ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

Modified LOT LAYOUT

EQ#08-1569

PARCEL B, COS 3832FC

HES no. 481, SECTION 32, T.37N., R.31W., P.M., MT.
LINCOLN COUNTY, MONTANA


FOR: LAMP

DATE: REVISED February 01, 2023

RECEIVED

FEB 02 2023

MT DEQ PUBLIC WATER
& SUBDIVISIONS

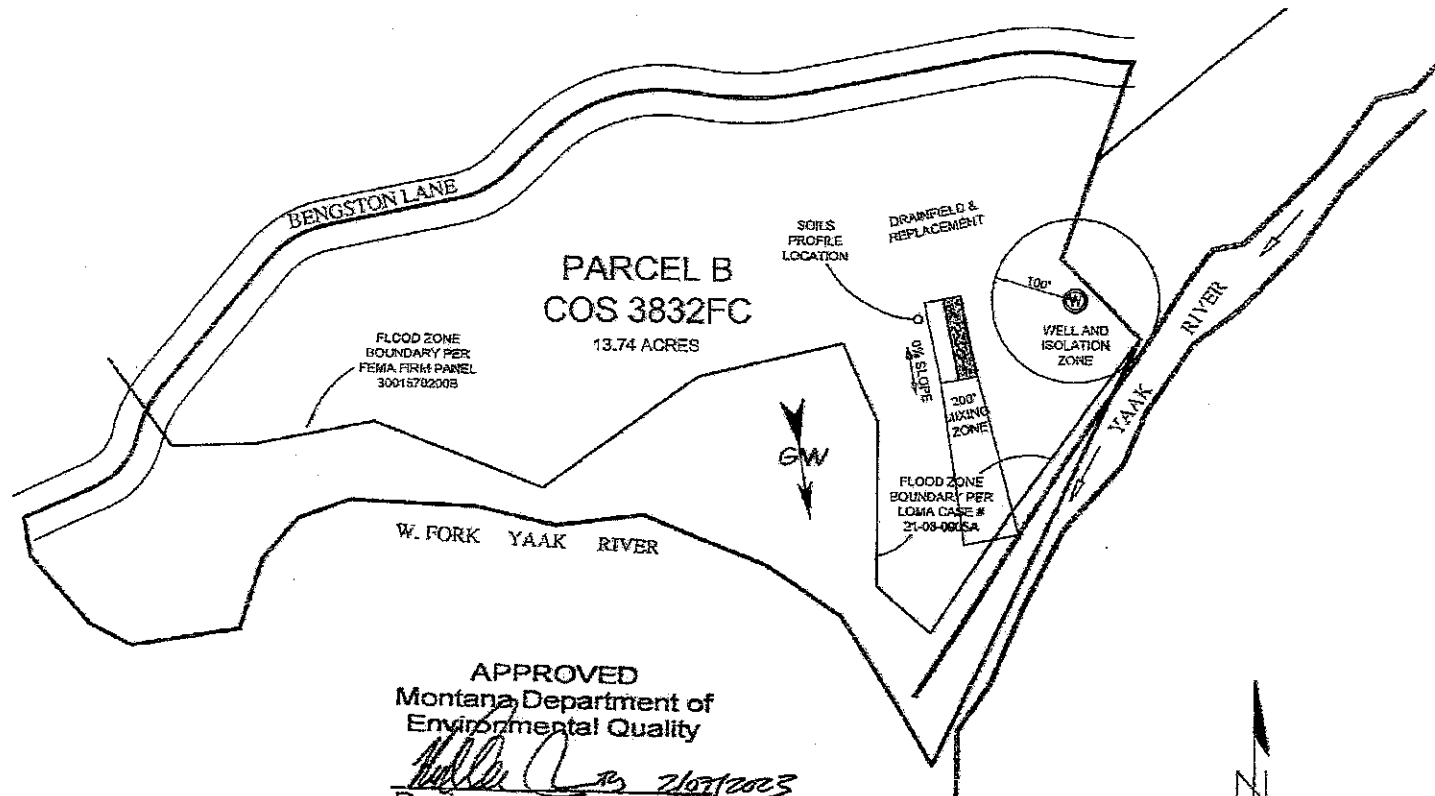

APPROVED
Montana Department of
Environmental Quality

[Signature] 2/07/2023
Reviewer Date

EQ# 08-1569

Enviro-Tech
Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795