LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/26/07 Expiration Date: 06/27/08

Property Owner: James H. Jr. & Cynthia Low c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Corey McNew License No. 130

_XX_ New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Septic tank and lift station for connection to public system.

Parcel Description:

Legal: SW-1/4 S29 T29 R33

Address or Location: Lot 29 in Bull Lake Estates --- 360 North Shore Road

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: Public System

Pumping Tank Size: 500 gallons

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: ***INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

Issued By: Kenka J Lind R.S

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 8-12-07

Title: Installer

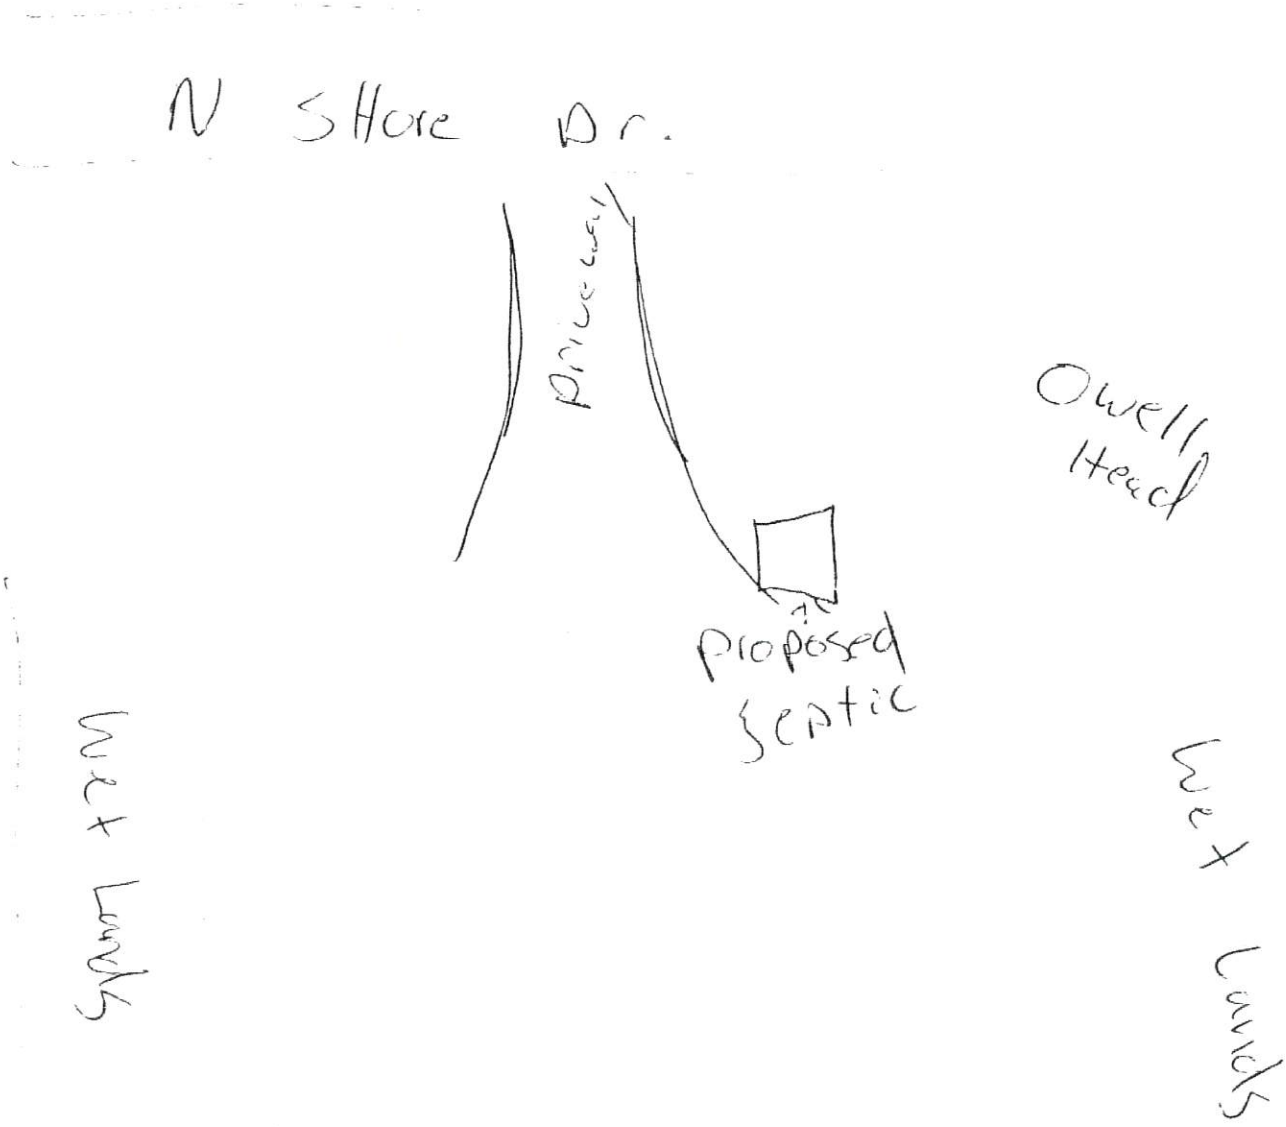
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


N Shore Dr.
Driveway
Owell Head
Proposed Septic
Wet Lands
Wet Lands