LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date:10/21/2021 Expiration Date: 10/21/2022

Property Owner: Andrew Lowe

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Mountain Contracting License No. 3

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other- Renewal (MD)

Describe: Three 85' laterals using infiltrators.

Parcel Description:

Legal: WHISPERING PINES KOOCANUSA 5, S06, T34 N, R26 W, Lot 20, ACRES 5.035

Address or Location: Lot 20

Geo/Assessors code: 0000000872

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 225 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Richard Luciano, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 11/4/21

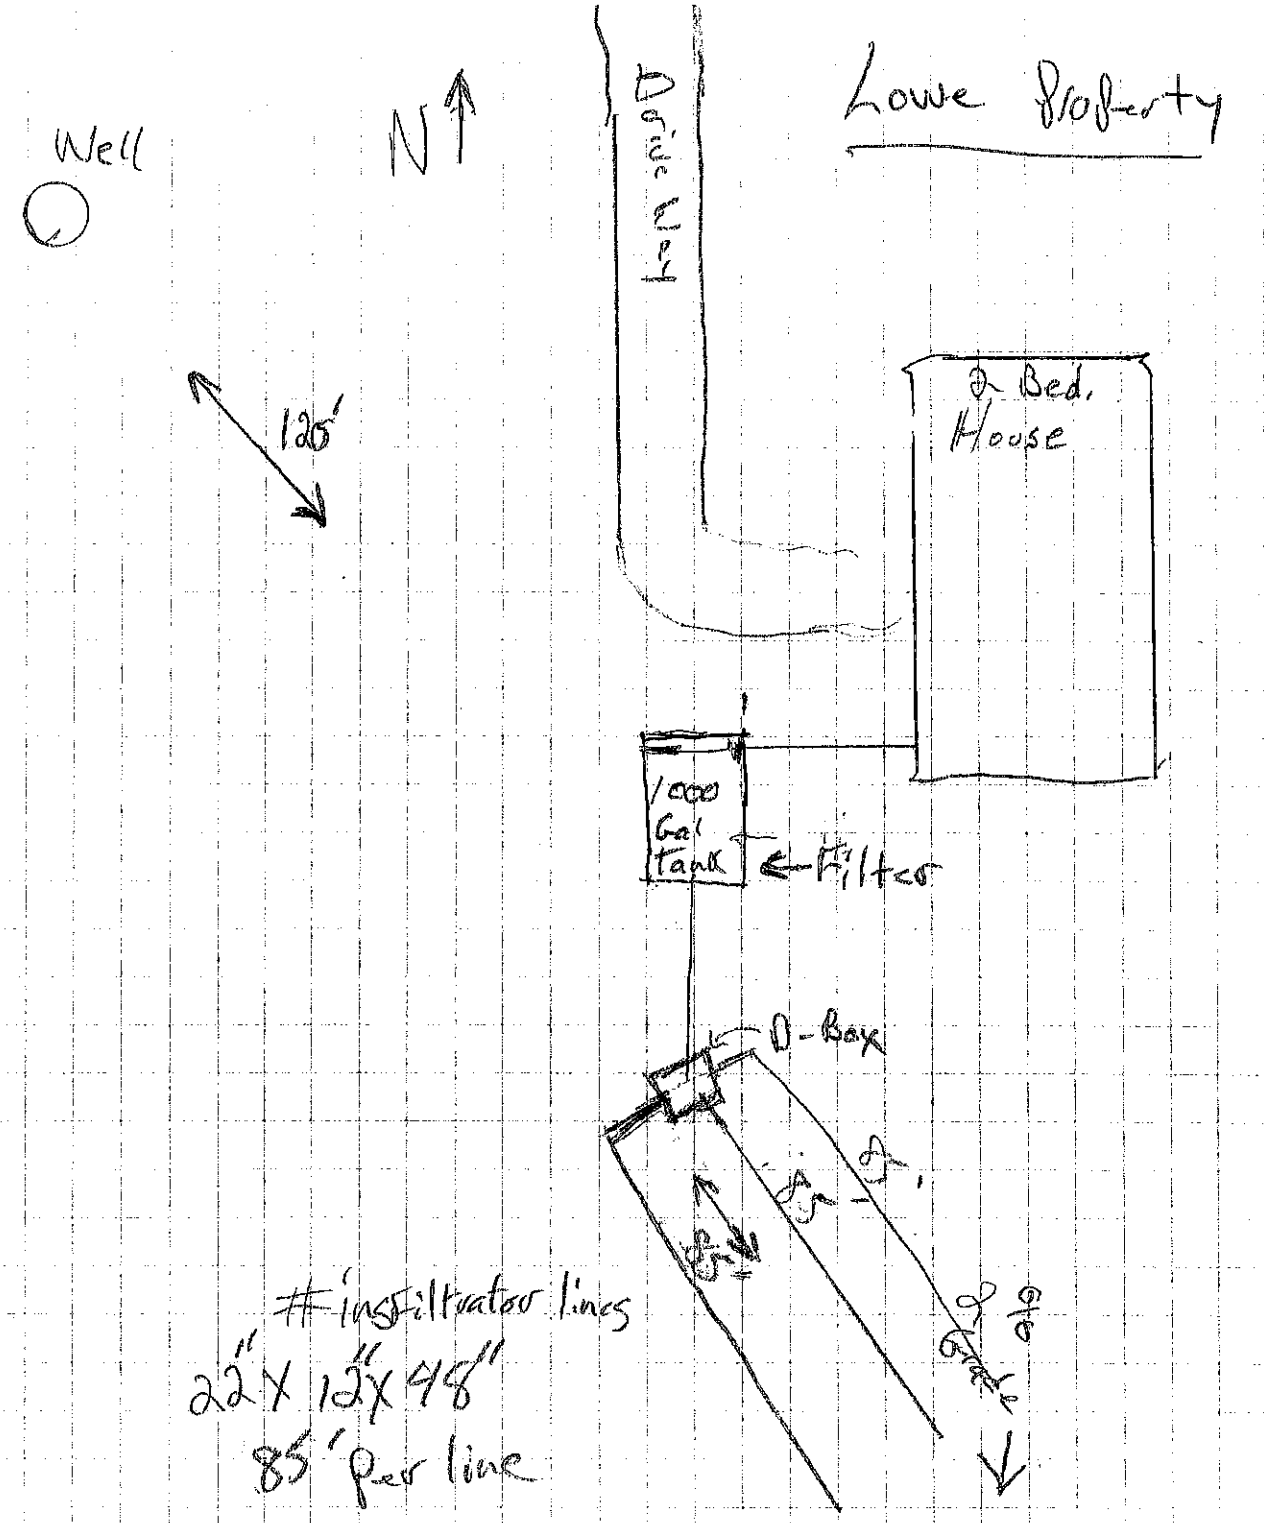
Title: Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lowe Property
Well
N
Drive In
125'
2 Bed. House
1000 Gal tank
Filter
D-Box
infiltrator lines
22" X 12" X 48"
85' per line