LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/16/2021 Expiration Date: 06/16/2022

Property Owner: Morrison Family Trust/Cindy Morrison c/o:

Address: PO BOX 1484 Eureka, MT 59917

Telephone: (Home) (Work)

Installer: Bradley Persson License No. 159

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 65' laterals using chambers.

Parcel Description:

Legal: GATEWAY VILLAGE UNIT 8, S03, T37 N, R27 W, ACRES 5.032, LOT 31

Address or Location: 59 Canview Rd Eureka, MT 59917

Geo/Assessors code: 0000017985

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 130 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Bradley S. Persson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* Jan. 22 2021

Title: 159 Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

RECEIVED
OCT 07 2021
BY:

LOT 31

LOT LAYOUT

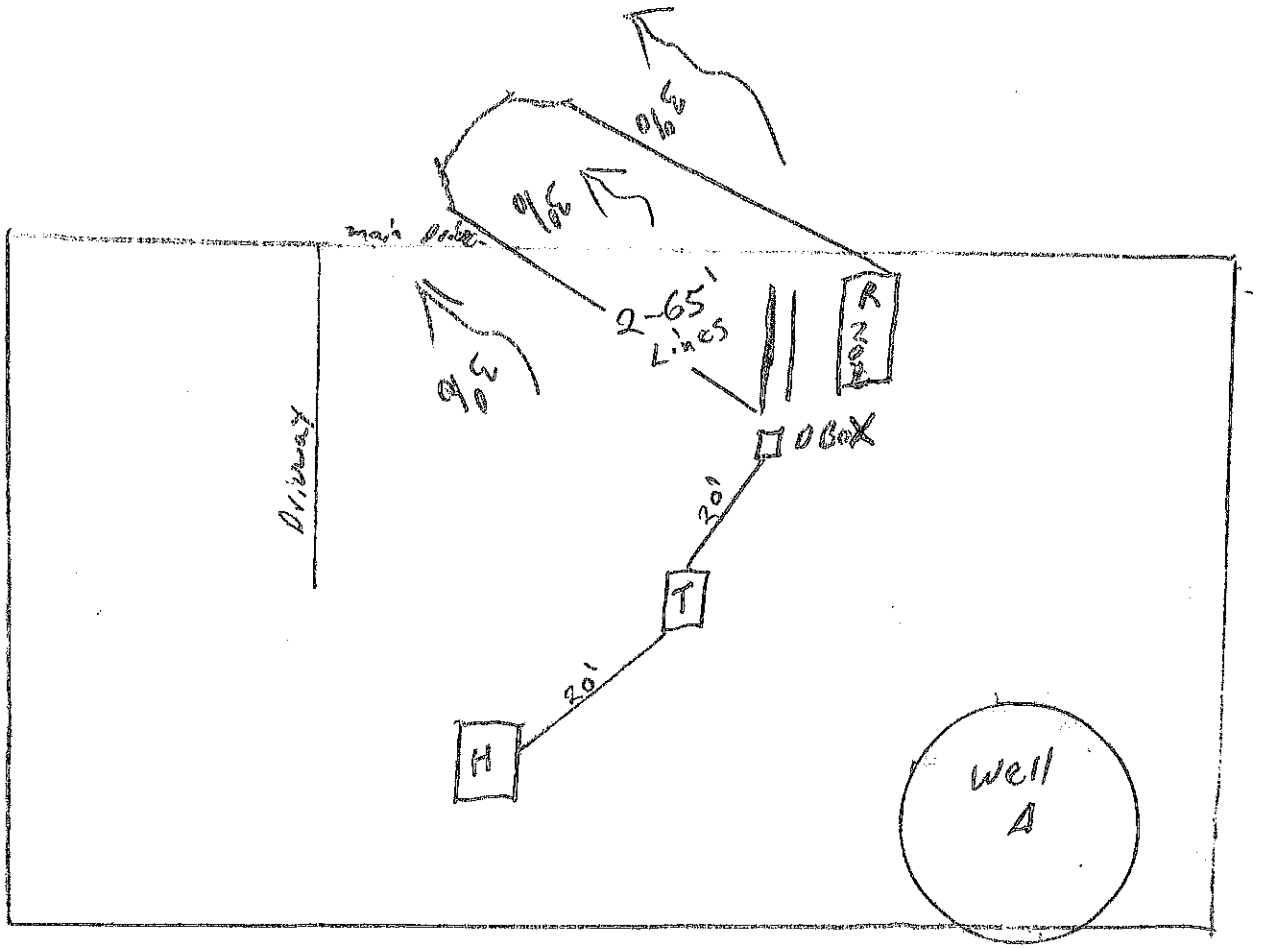

RECEIVED
AUG 10 2010