LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/18/2021 Expiration Date: 03/18/2022

Property Owner: Amy Mulholland c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: License No.

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 94' laterals using drain rock and perf pipe.

Parcel Description:

Legal: S23, T30 N, R31 W

Address or Location: Granite View Lot 1

Geo/Assessors code: 0000050511

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1500 gallons Drainfield Size: 282 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

"GRANITE VIEW SUBDIVISION"

NW¼ NE¼, SECTION 23, T.30N., R.31W. P.M., MT.
LINCOLN COUNTY, MONTANA

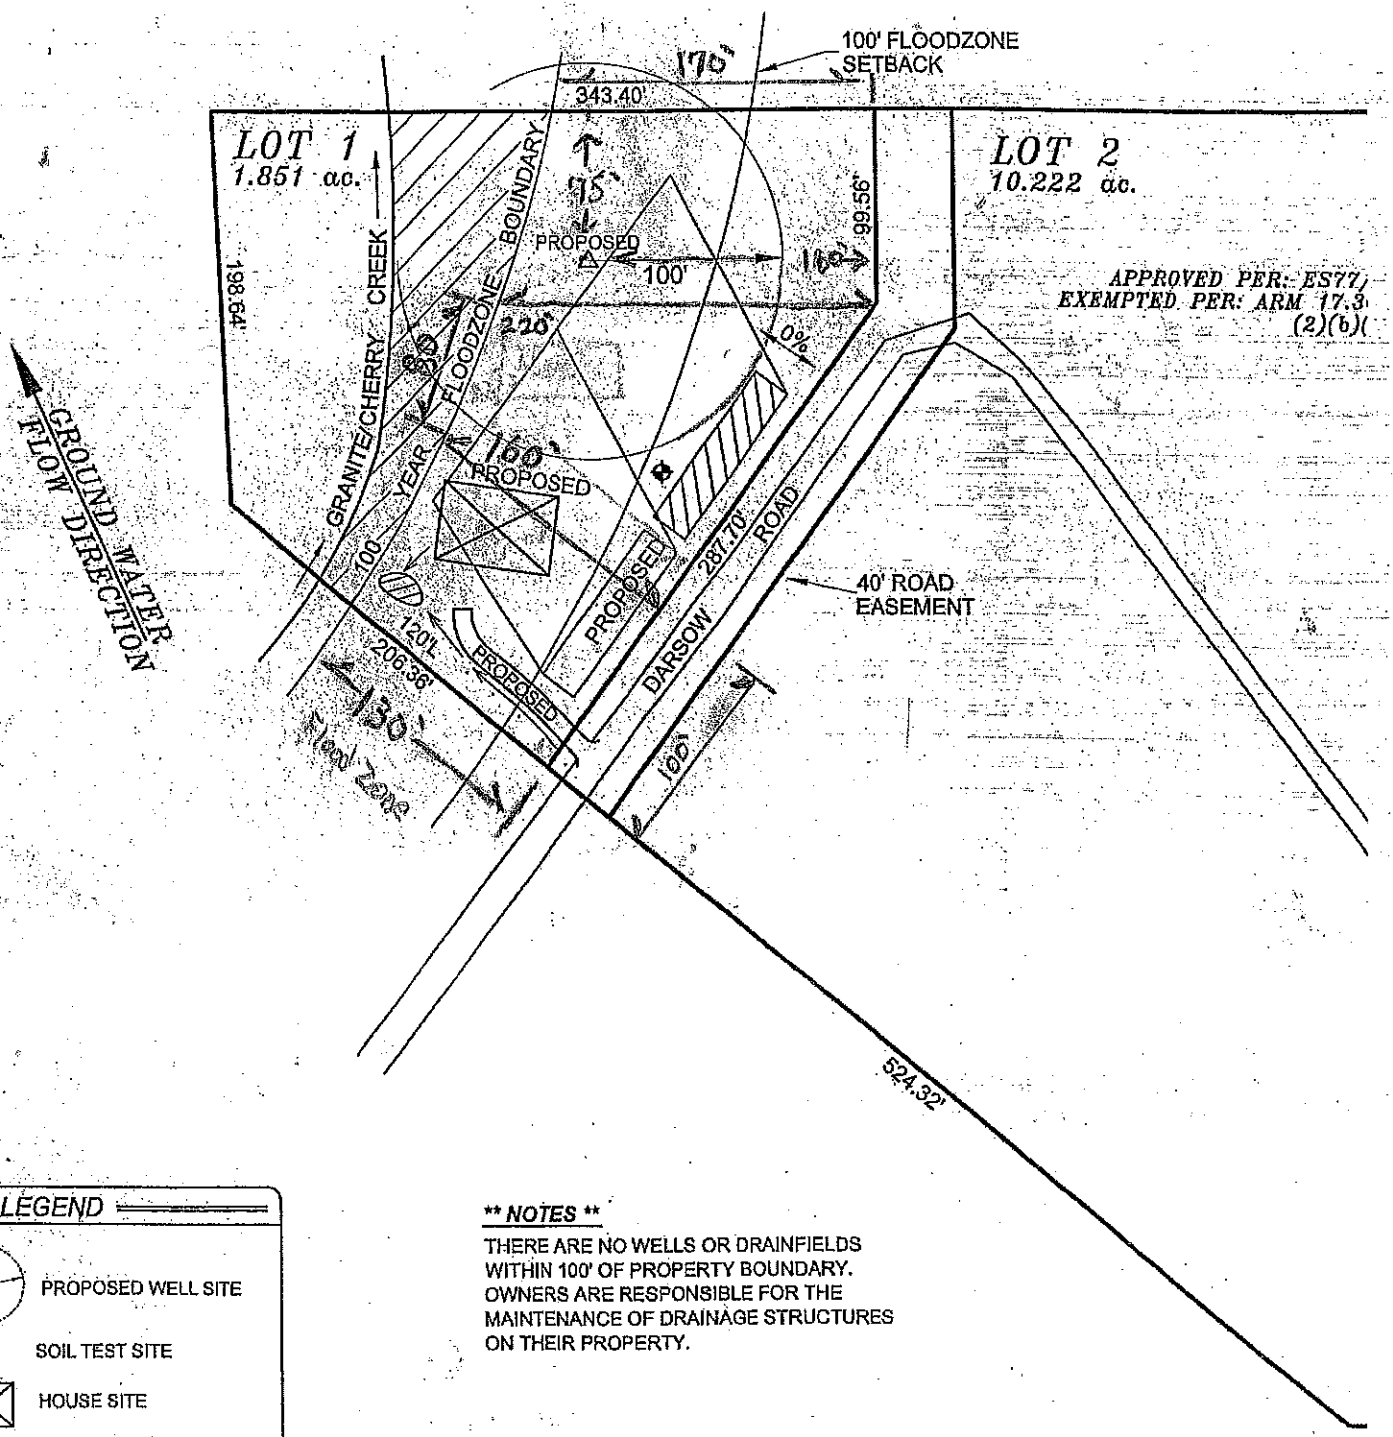

LEGEND

- PROPOSED WELL SITE
- SOIL TEST SITE
- HOUSE SITE
- DRAINFIELD AND REPLACEMENT AREA
- STORM WATER SWALE (12' L)
- DRAINAGE DITCH & STORMWATER FLOW

**** NOTES ****

THERE ARE NO WELLS OR DRAINFIELDS WITHIN 100' OF PROPERTY BOUNDARY. OWNERS ARE RESPONSIBLE FOR THE MAINTENANCE OF DRAINAGE STRUCTURES ON THEIR PROPERTY.

RECEIVED
FEB 05 2009
MT DEQ PUBLIC WATER
& SUBDIVISION BUREAU