LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date:11/08/2021 Expiration Date: 11/08/2022

Property Owner: Michael Murphy c/o:

Address: [redacted]

Telephone: (Work)

Installer: Logan Munts License No. 160

XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other- Renewal (MD)

Describe: **Two 50' laterals w/infiltrators.**

Parcel Description:

Legal: BULL VALLEY TRACTS, S05, T29 N, R33 W, ACRES 10.93, LOT 1 PM 6703 IN E2

Address or Location: LOT 1

Geo/Assessors code: 0000052483

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000 gallons Drainfield Size: 125 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Logan Munts *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 3/17/22

Title: Sawtooth Excavating LLC

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Murphy (2)

LINCOLN COUNTY MONTANA
LOT LAYOUT

LOT 1 OF BULL VALLEY TRACTS PER PLAT NO. 6703
IN SOUTH 1/2 OF SECTION 5, TWP 29 N., R. 33 W., P.M.M.
FOR: MICHAEL MURPHY
DATE: APRIL 2021 EQ 06-1649

SCALE
200 0 100 200
1 INCH = 200 FEET

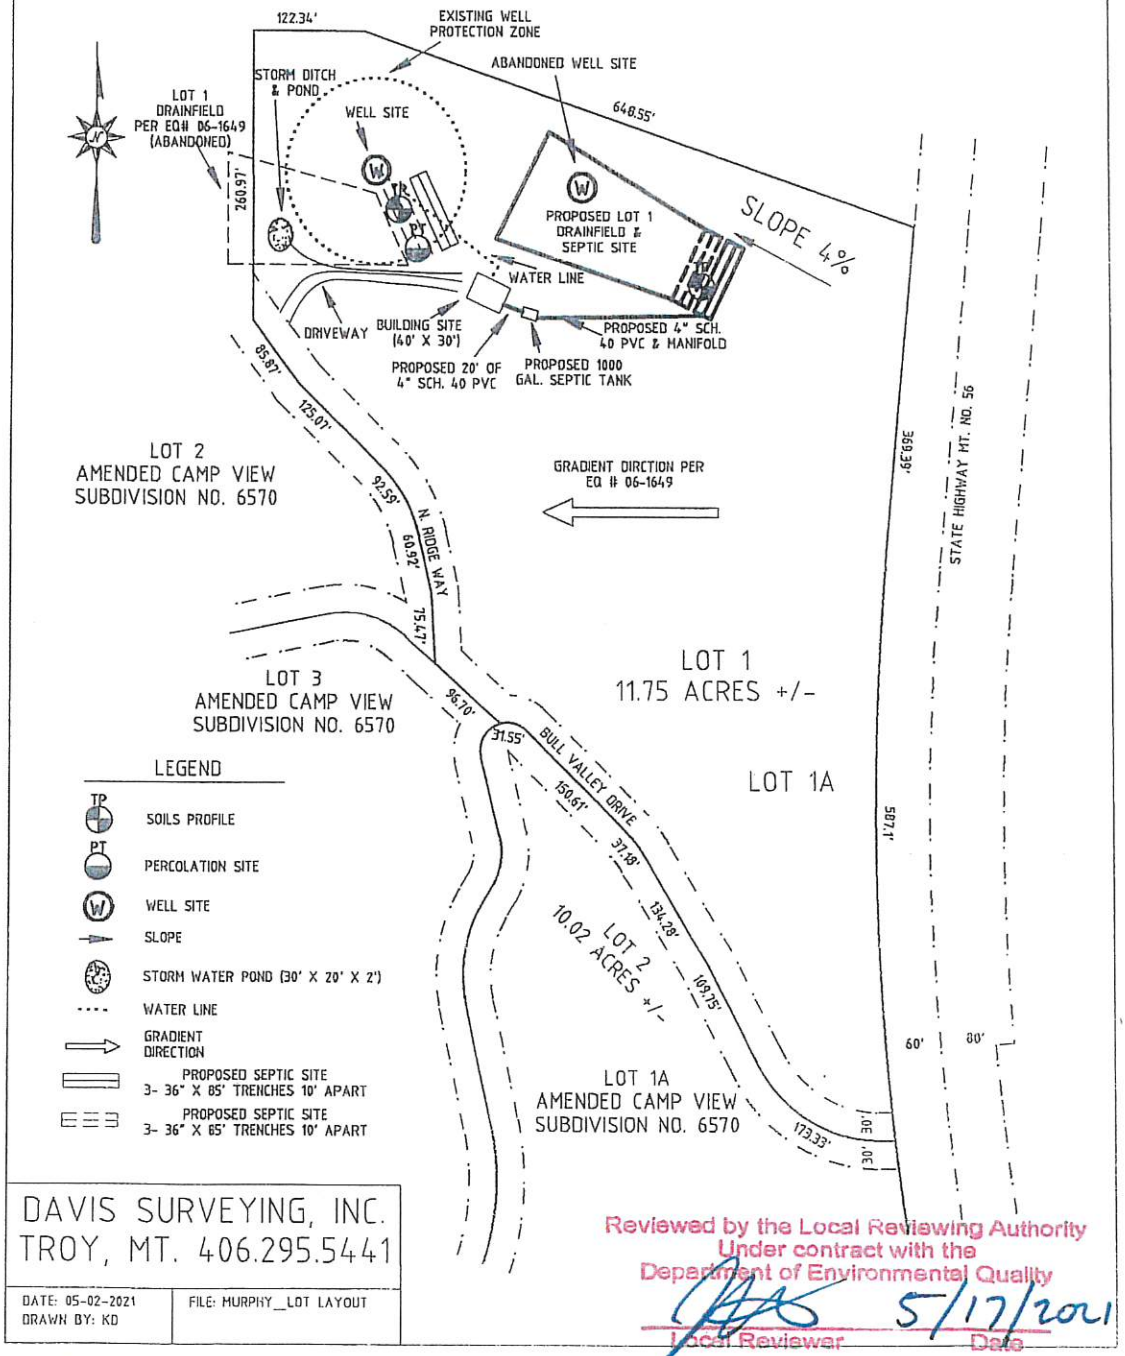

LEGEND

- TP — SOILS PROFILE
- PT — PERCOLATION SITE
- W — WELL SITE
- SLOPE
- STORM WATER POND (30' X 20' X 2')
- WATER LINE
- GRADIENT DIRECTION
- PROPOSED SEPTIC SITE 3- 36" X 85' TRENCHES 10' APART
- PROPOSED SEPTIC SITE 3- 36" X 65' TRENCHES 10' APART

DAVIS SURVEYING, INC.
TROY, MT. 406.295.5441

DATE: 05-02-2021
DRAWN BY: KD
FILE: MURPHY_LOT LAYOUT

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Local Reviewer 5/17/2021
Date

Accepted under contract

N/A
DEQ Representative Date