LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date:11/07/2021

Expiration Date: 11/05/2022

RECEIVED
DEC 06 2021
BY: AR

Property Owner: Ed Netherton

c/o:

Address: [redacted]

Telephone: [redacted]

(Work)

Installer: Self

License No.

XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other- Renewal (MD)

Describe: **Pressure dosed system required per DEQ Circular 4. Two 70' laterals sand lined.**

Parcel Description:

Legal: O'NEAL, S32, T30 N, R33 W, ACRES 21.88, LOT 1 PM 7062

Address or Location: Lot 1

Geo/Assessors code: 0000052702

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000/500 gallons Drainfield Size: 140 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Logan Mintz, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 11/29/21

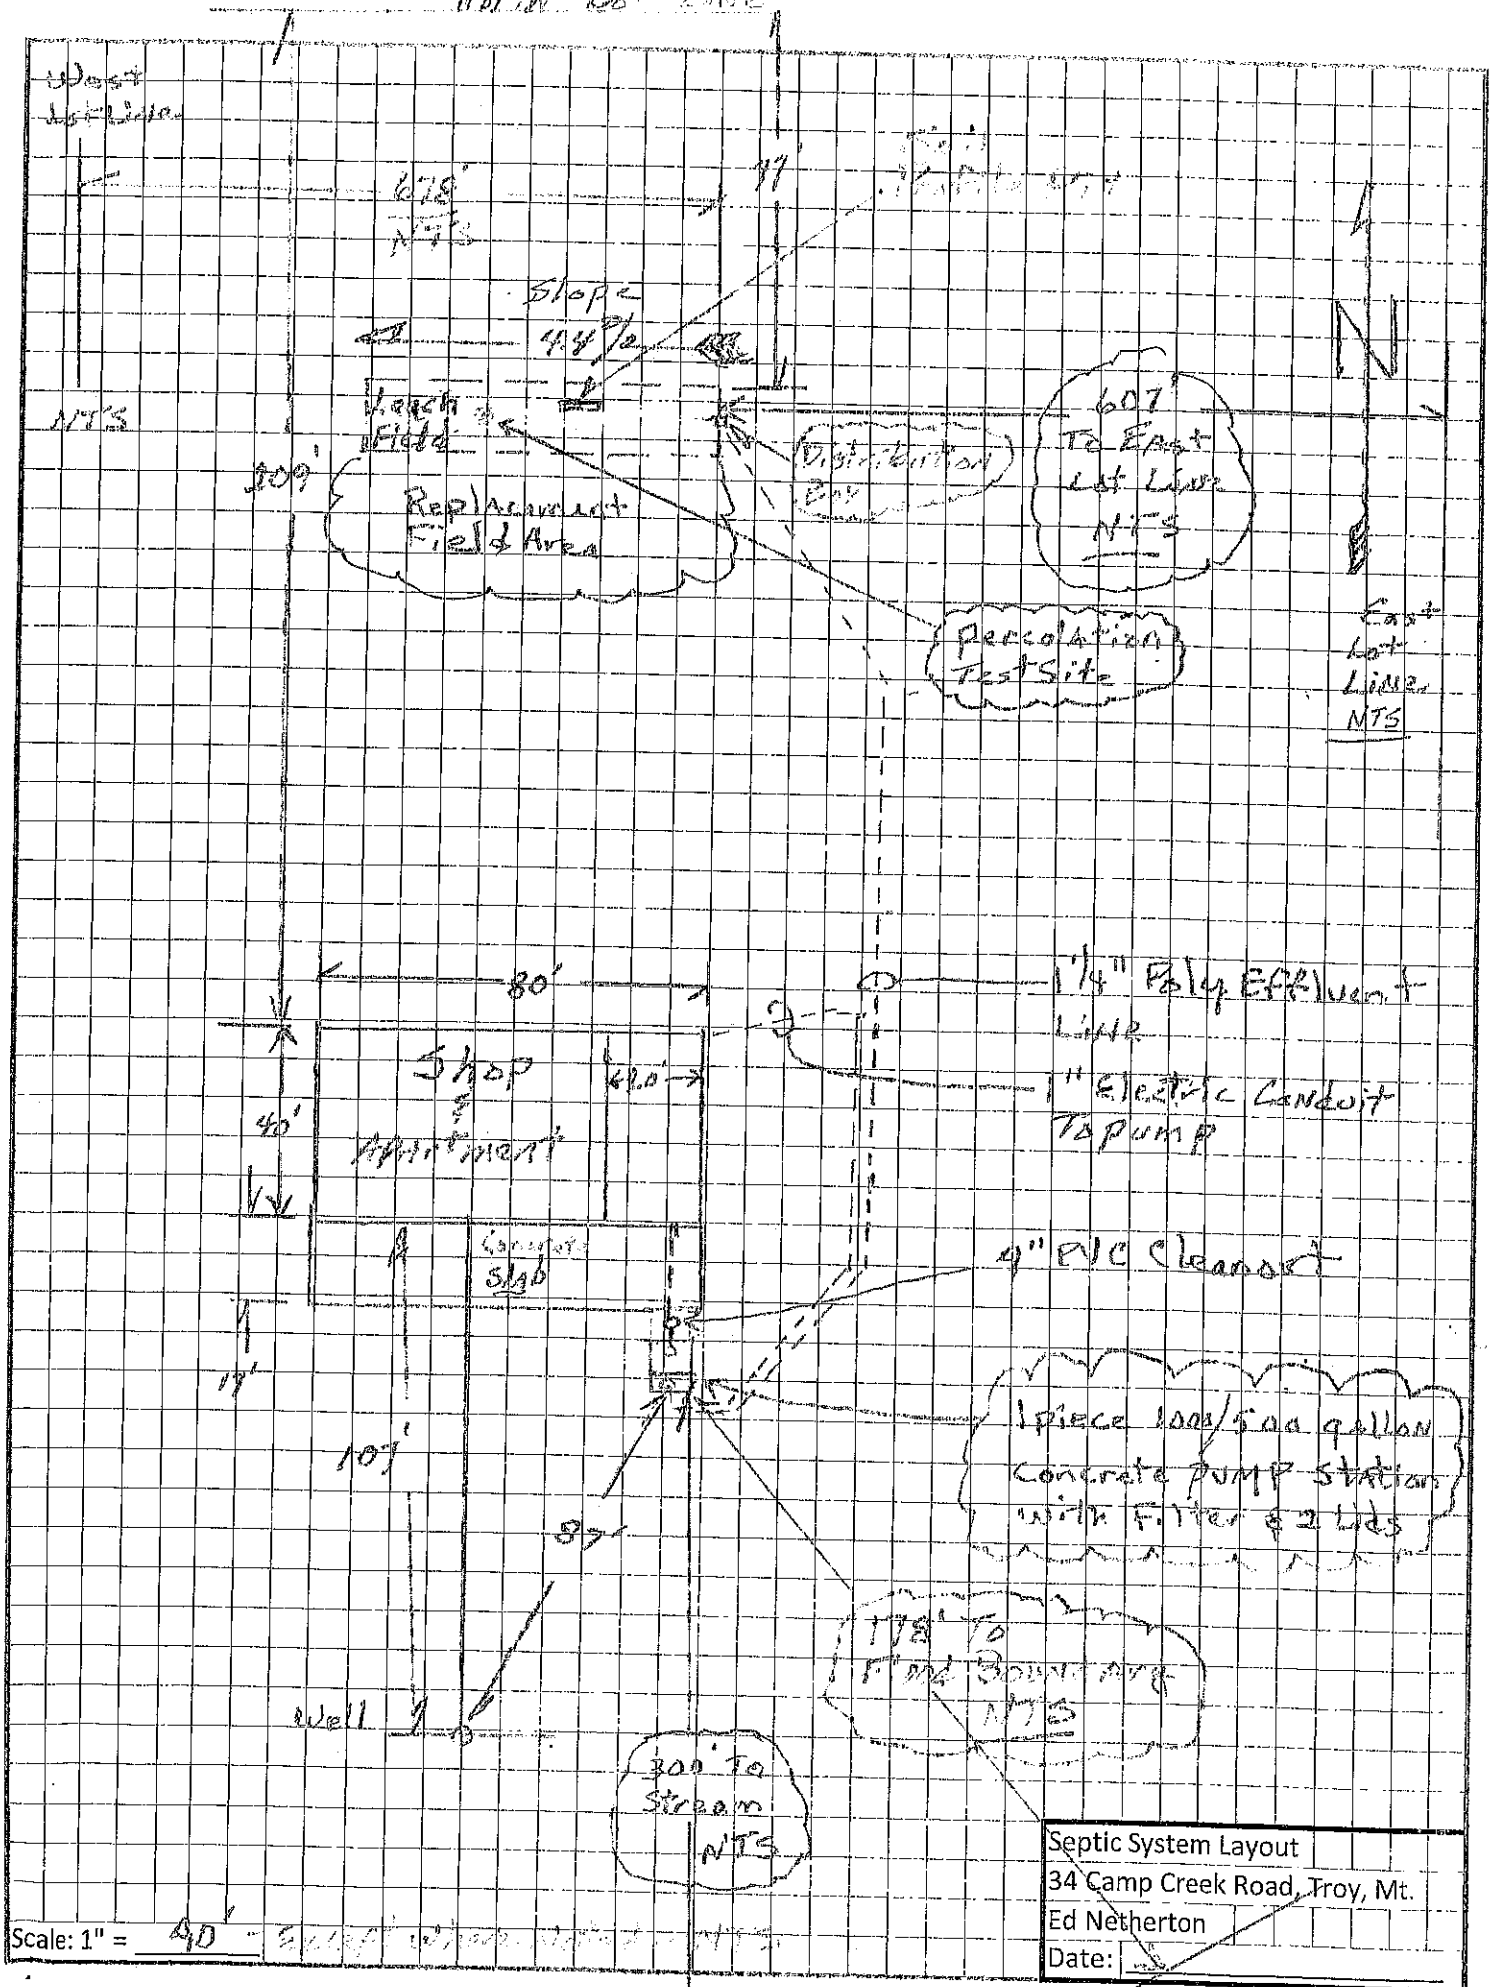
Title: Sunbeam Excavating

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


North Lot Line
West Lot Line
NTS
678'
NTS
97'
Slope
4.4%
N
Leach Field
609'
Replacement Field Area
Distribution Box
607'
To East Lot Line
NTS
Percolation Test Site
East Lot Line
NTS
80'
1 1/4" Poly Effluent Line
Shop & Apartment
40.0'
45'
1" Electric Conduit To Pump
Concrete Slab
4" PVC Cleanout
19'
10'
1 piece 1000/500 gallon Concrete Pump Station with Filter & 2 Lids
85'
175' To Property Boundary
NTS
Well
300' To Stream
NTS
Septic System Layout
34 Camp Creek Road, Troy, Mt.
Ed Netherton
Date:
Scale: 1" = 40'
FEMA Flood
Camp Creek Stream