LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/22/2021 Expiration Date: 12/22/2022

Property Owner: Pensco Trust Co FBO c/o: Mack Excavating

Address: [redacted]

Telephone: [redacted]

Installer: Mack Excavating License No. 111

XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 1,000 gallon septic tank with effluent filter. Gravity system with gravelless trenches (infiltrators). 2 laterals @ 76-feet each in length.

Parcel Description: EM KAYAN VILLAGE LOT 29

Legal: EM KAYAN VILLAGE, S04, T30 N, R30 W, ACRES 0.972, LOT 29

Address or Location: 229 Yellowtail Rd., Libby, MT 59923

Geo/Assessors code: 0000009041

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1,000 gallon Drainfield Size: 152 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, Keith Mack, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 1-4-24

Title: Owner

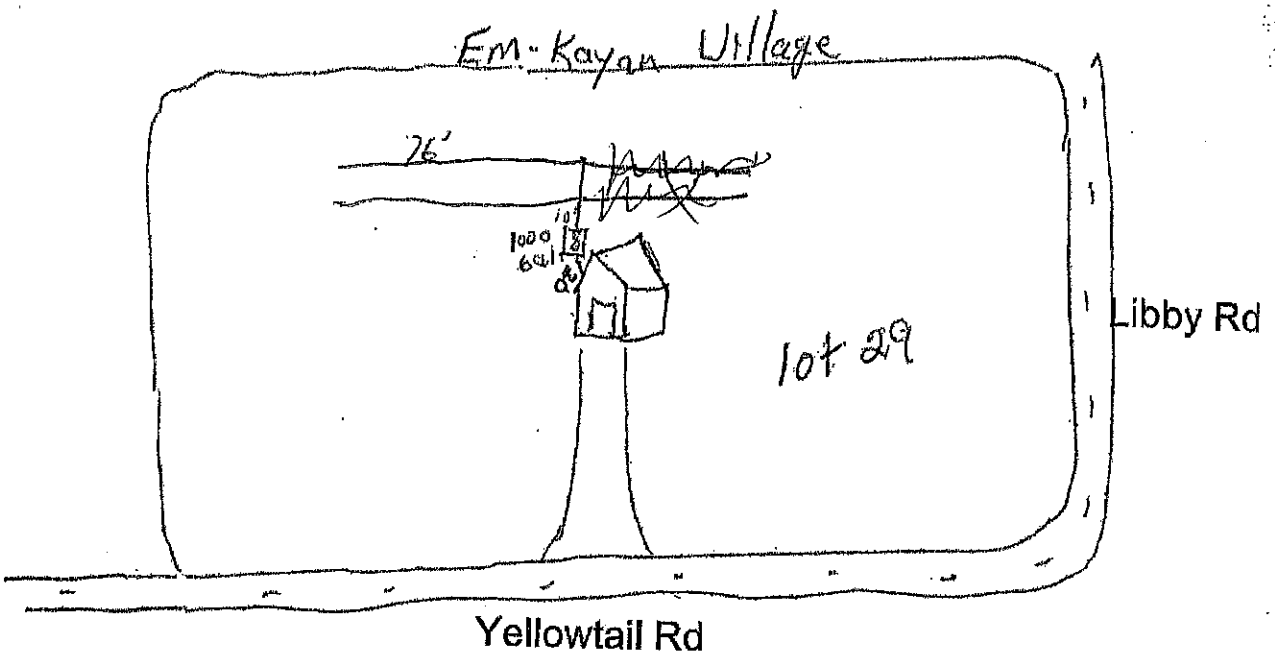
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


Em-Kayan Village
26'
1000 Gal
lot 29
Libby Rd
Yellowtail Rd