LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/16/2021 (revised 7/20/22) Expiration Date: 08/16/2022

Property Owner: Darwin D Pluid c/o:

Address: PO BOX 368 Eureka, MT 59917

Telephone: [redacted] (Home) (Work)

Installer: Earth Works License No. 164

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Parcel Description:

Legal: AJ ESTATES, S14, T37 N, R27 W, ACRES 1.72, LOT 10 PM 6477

Address or Location: LOT 10

Geo/Assessors code: 0000054431

Approved Design Criteria:

Three 48' laterals using chambers, 3' wide trenches, pressure dosed

Bedrooms: 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 144 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Maranda Davis, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Maranda Davis *Date:* 8/10/22

Title: Envir. Health Tech

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


SV

Luciano Dr

183

1/8" = 5' feet

New Proposed Layout.

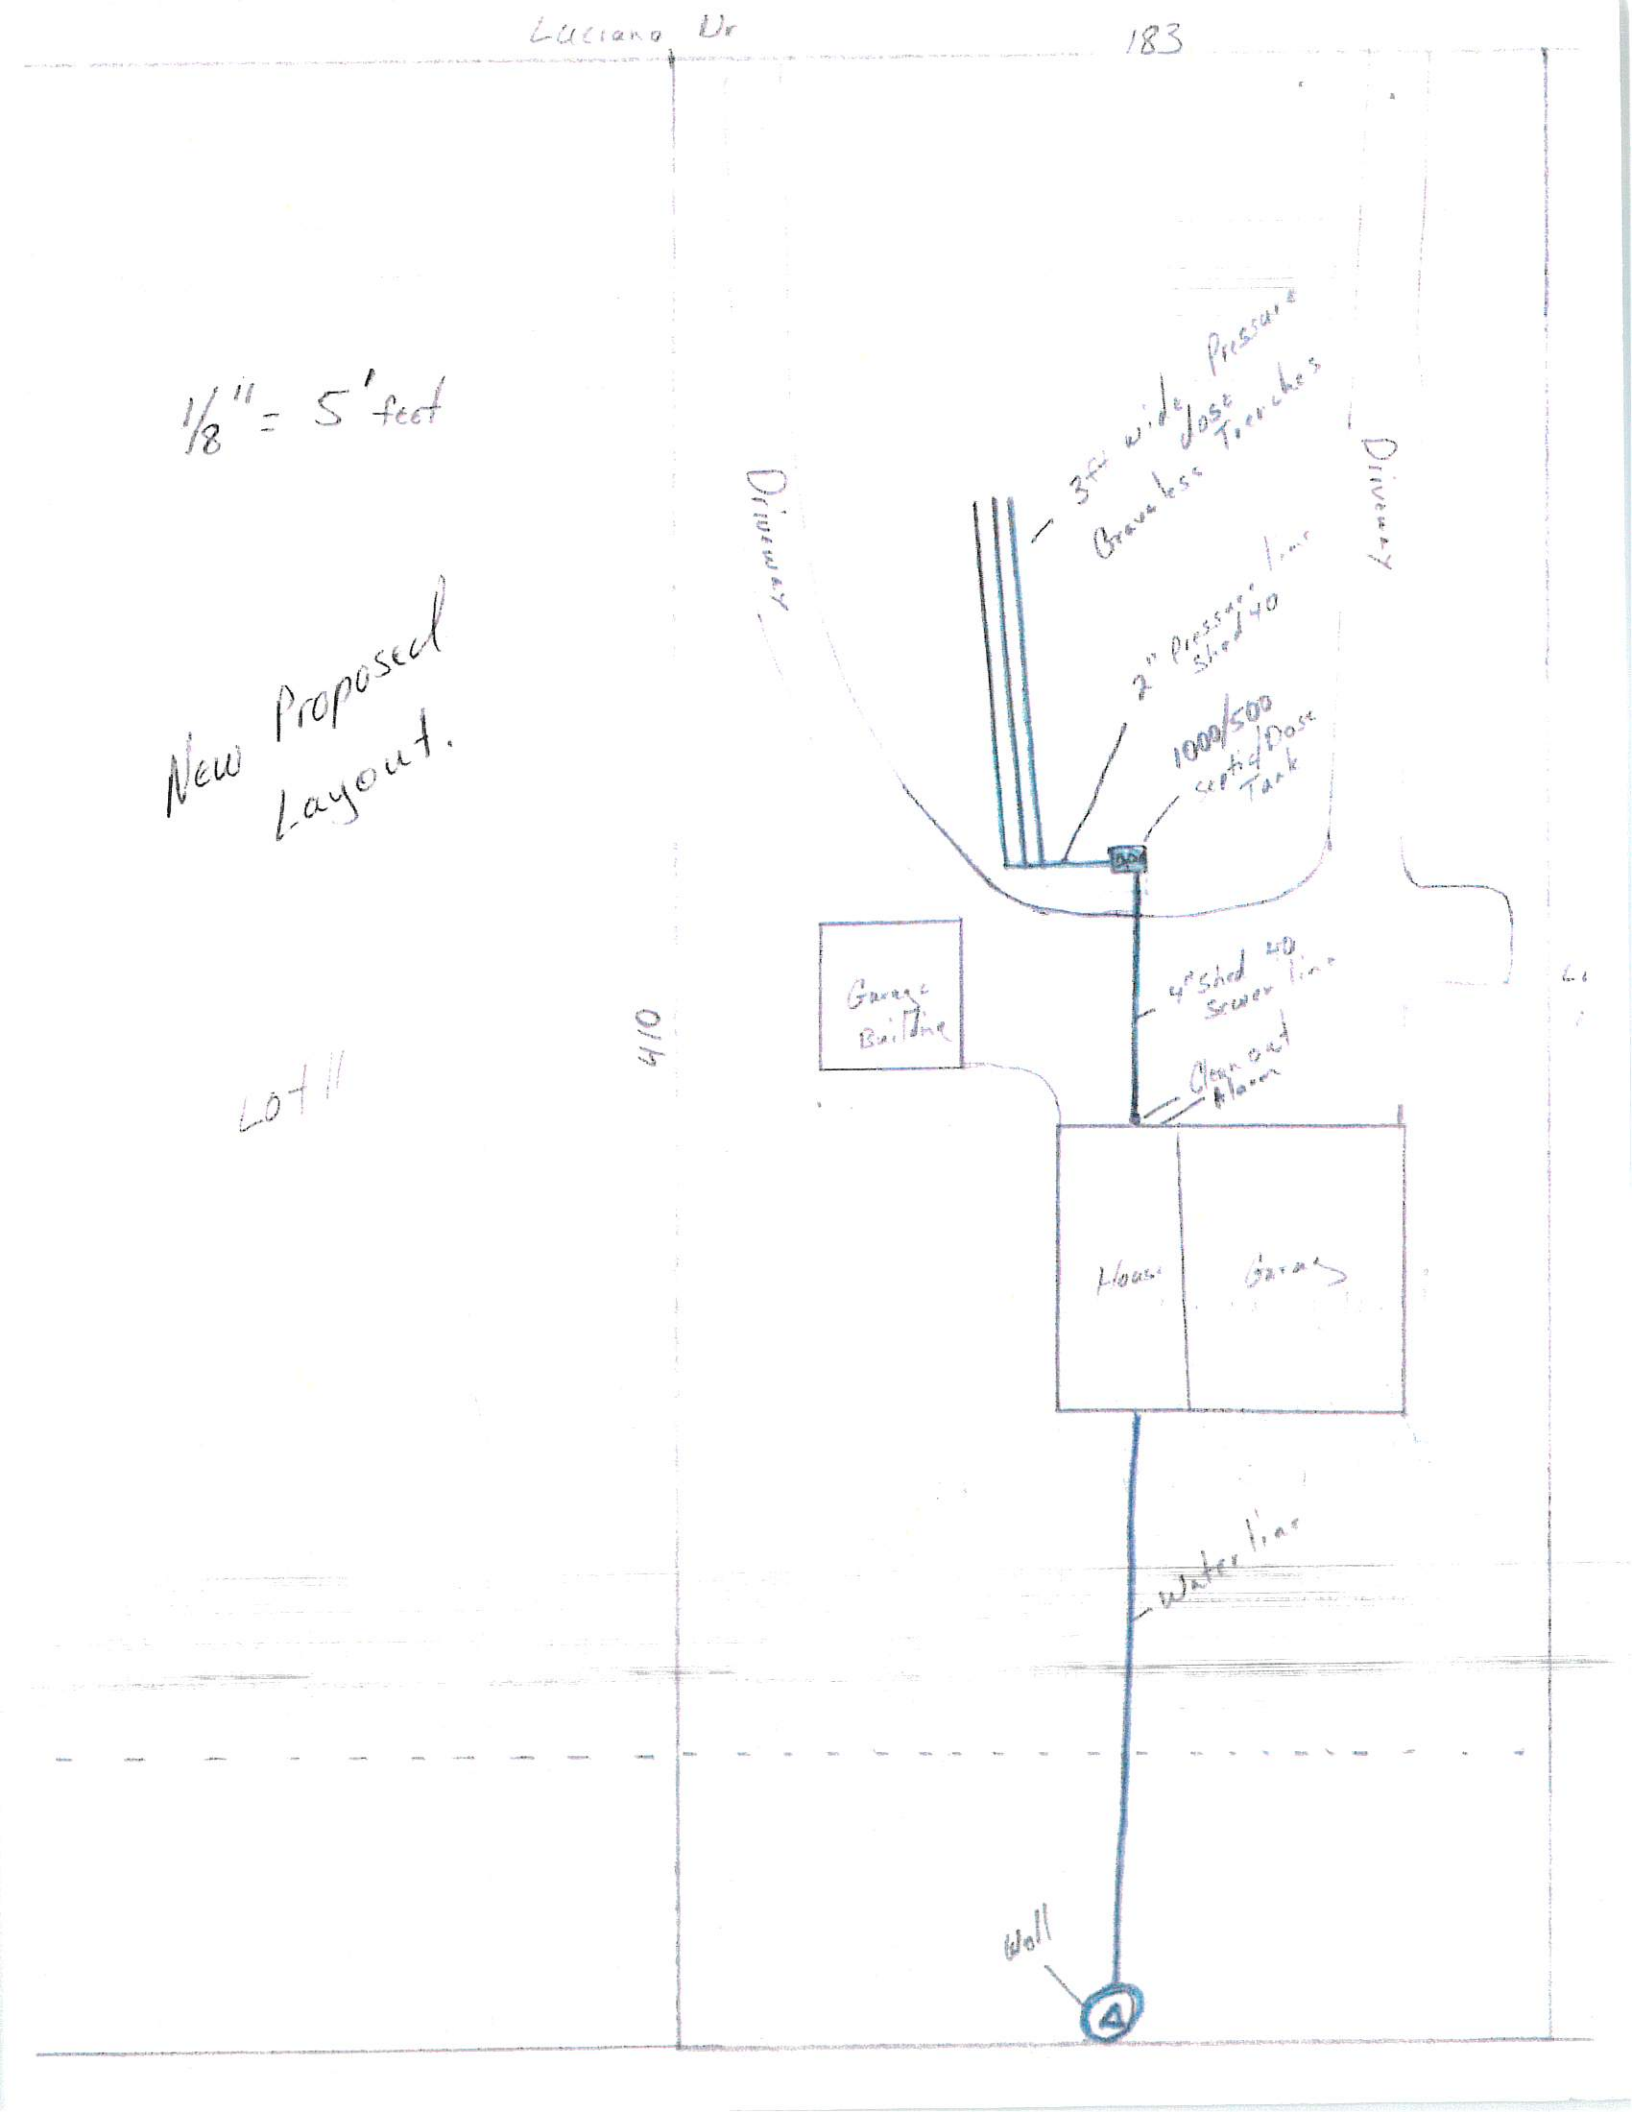

Lot 11

Lot