LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

file
pd. #1692

Issue Date: 10/12/21 Expiration Date: 10/11/22

Property Owner: John Pritchett c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Paul Dalziel License No. 175

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: Two 75' laterals using gravelless domes

Parcel Description:

Legal: Yaak Meadows 1st Addn, HES 403, S31 T36N R31W, Block 2, Lot 6

Address or Location: 434 N Tamarack Ln

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 150 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi J. Hooper, R.S.

Closure Statement:

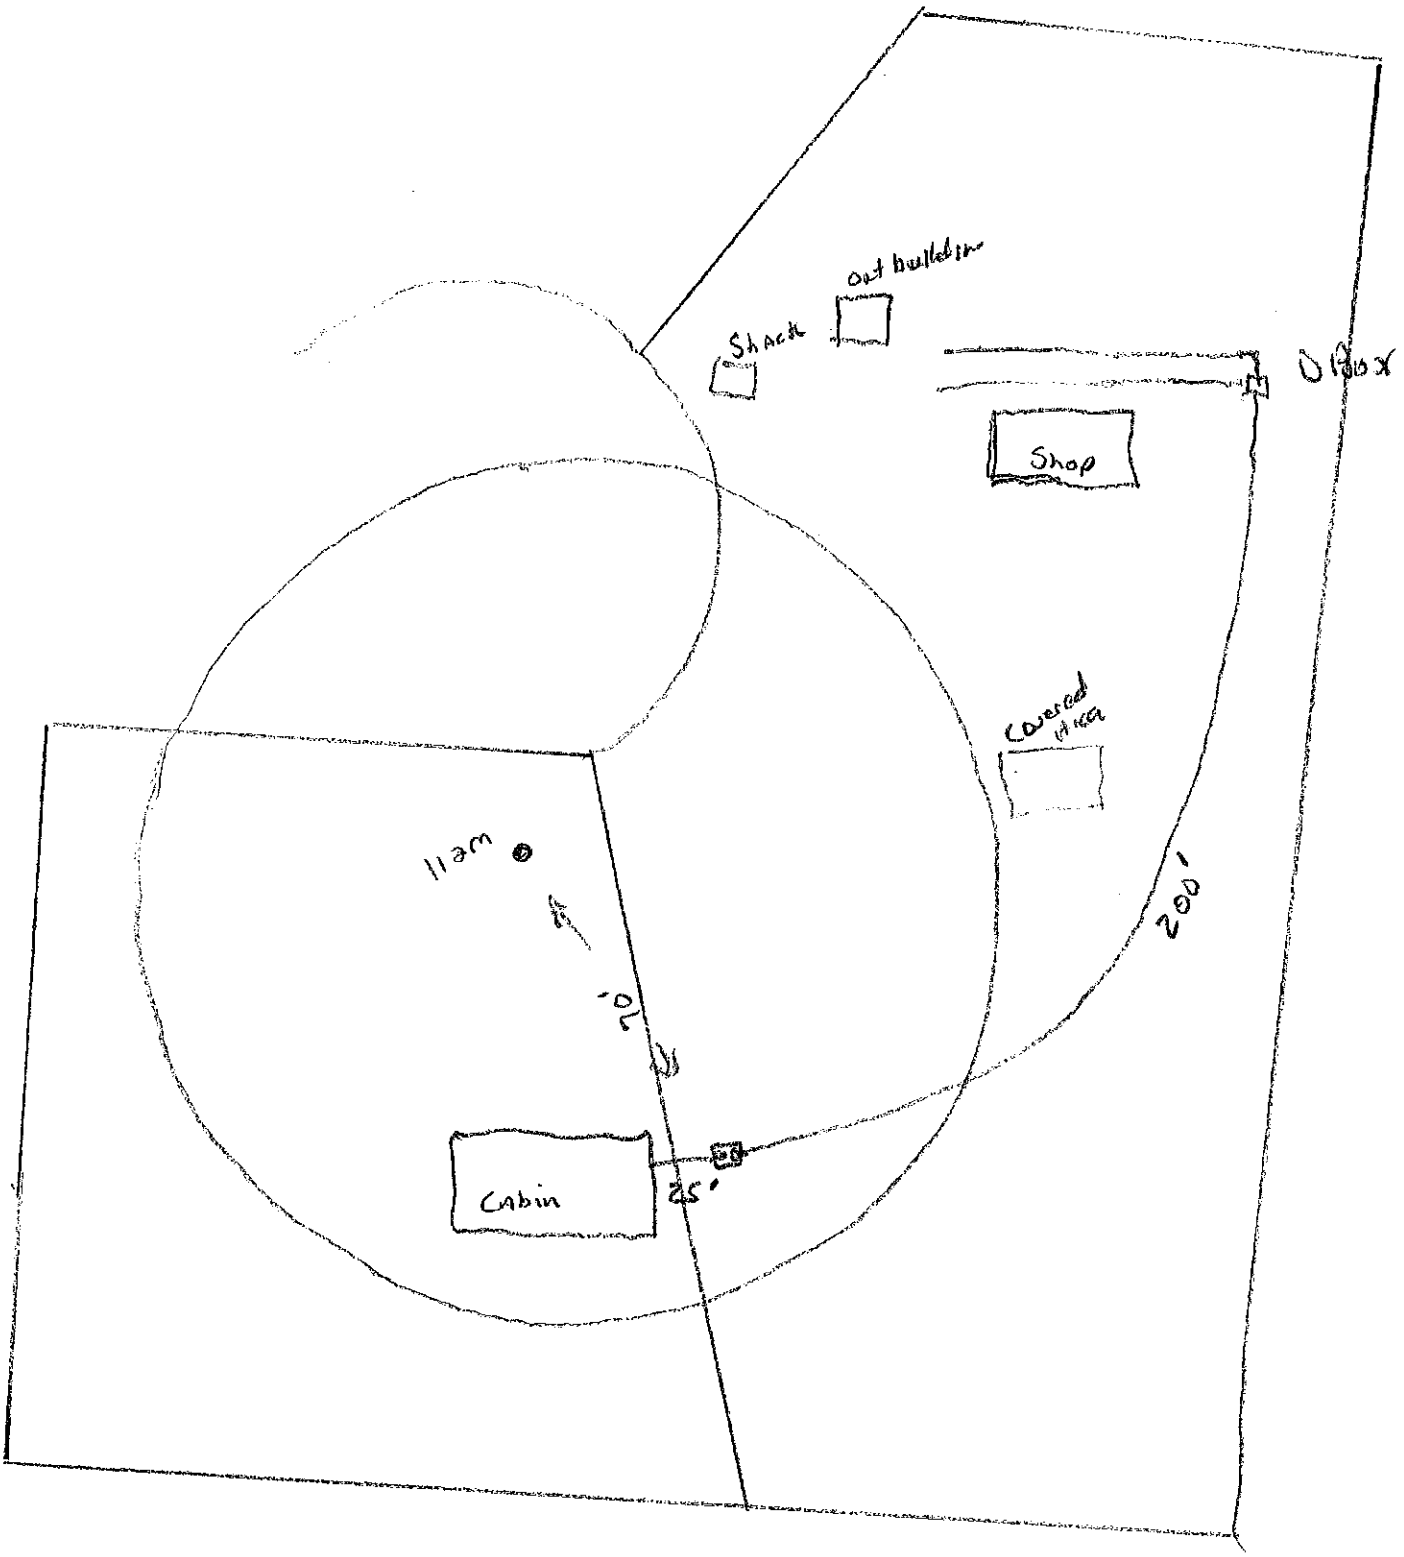
I, Paul Dalziel, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Paul Dalziel *Date:* 8-30-2022

Title: #175

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


Shack
out building
Shop
Covered area
well
70'
200'
Cabin
25'