DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date:11/02/2021 Expiration Date: 11/02/2022

Property Owner: Randy & James Raan c/o:

Address: [redacted]

Telephone: (Work)

Installer: Tally Hoe License No. 1

XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other- Renewal (MD)

Describe: 3' wide rockless chambers

Parcel Description:

Legal: S20, T30 N, R33 W, C.O.S. 4252, PARCEL A & B, ACRES 33.72

Address or Location: C.O.S. 4252, PARCEL A & B

Geo/Assessors code: 0000006024

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000 gallons Drainfield Size: 200 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 11-18-21

Title: owner operator

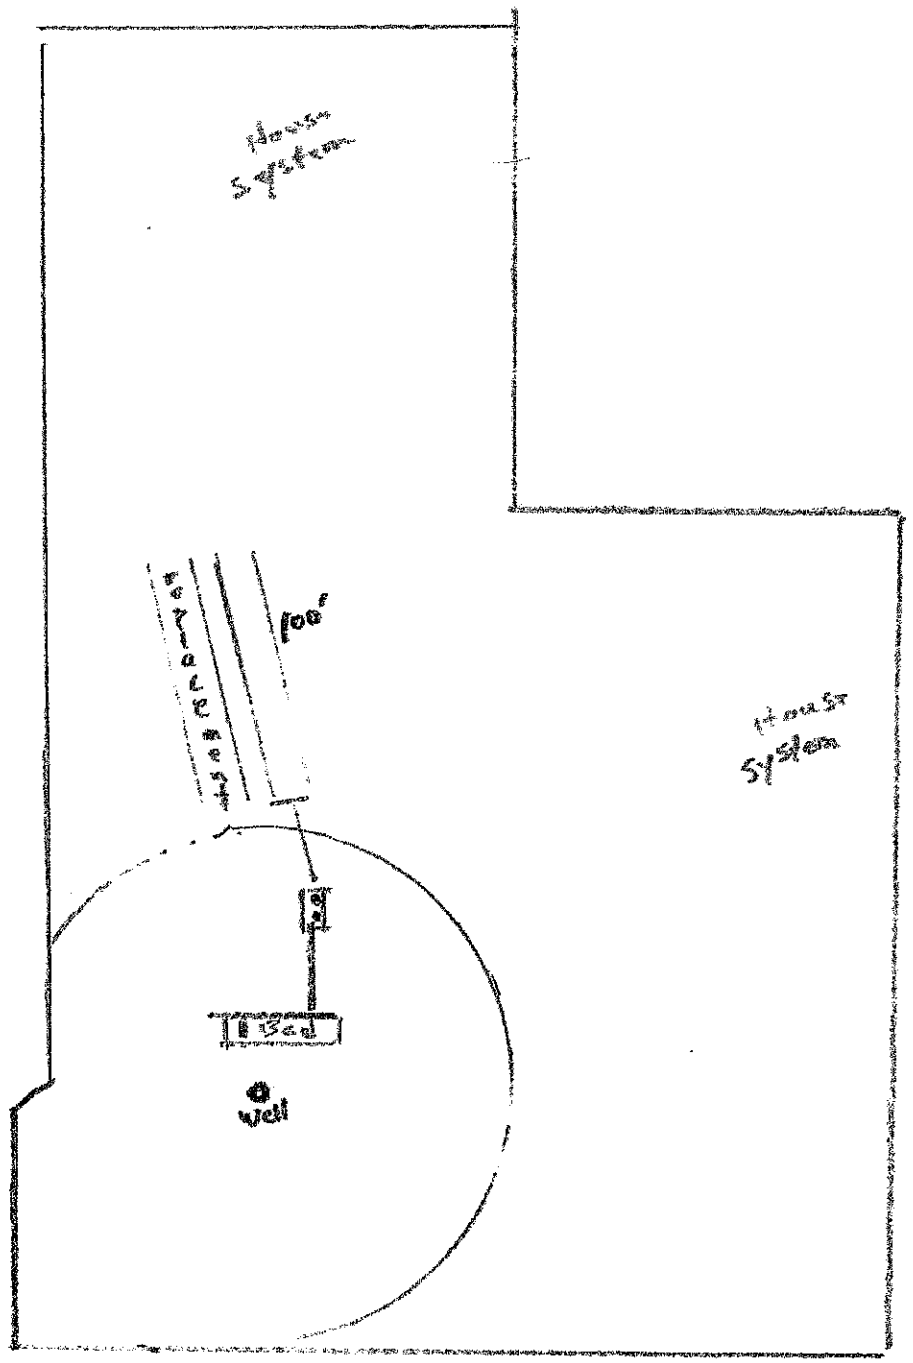
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5/


N
Slope
1
1%
House
System
Septic
100'
Tank
Bed
Well
House
System