LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/24/2021 Expiration Date: 08/24/2022

Property Owner: Edward Ray c/o:

Address:

Telephone: [redacted] (Home) (Work)

Installer: Dallas Pluid License No. 135

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 100' laterals.

Parcel Description:

Legal: ASPEN GLEN, S35, T36 N, R26 W, ACRES 2.49, LOT 4 PM 6650

Address or Location: LOT 4

Geo/Assessors code: 0000054627

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 500 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, BUCK SCHERMERHORN *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Buck Schermerhorn *Date:* 3/30/22

Title: PRESIDENT


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

REV	DESCRIPTION	BY/DATE	APPD/DATE

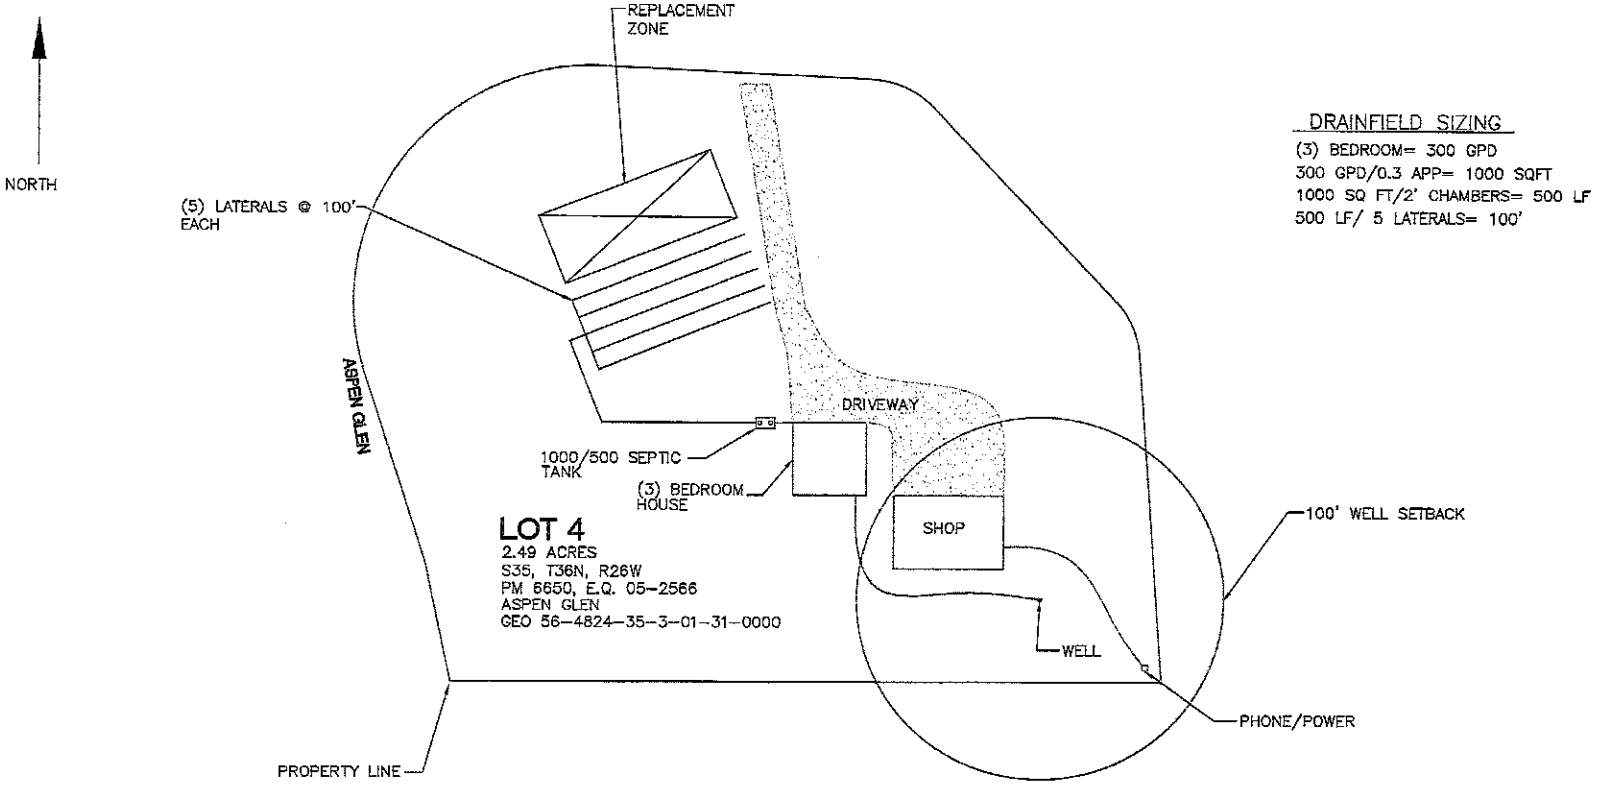

DRAINFIELD SIZING

(3) BEDROOM= 300 GPD
300 GPD/0.3 APP= 1000 SQFT
1000 SQ FT/2' CHAMBERS= 500 LF
500 LF/ 5 LATERALS= 100'

EDWARD RAY SITE MAP

⑥	⑤	④	③	②	

REV	DATE	COMPANY	SCALE:		D&H HAULING RAY SEPTIC		
		DH	1/16 IN = 10 FEET		SITE LAYOUT		
		CONTRACT:	DATE:				
		VERBAL	5/2021				
		PLOT PLN	WEIGHT				
		1941-0001			001-001		