LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/06/2021 Expiration Date: 05/06/2022

Property Owner: Mark Stoddard c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work) [redacted]

Installer: Montana Design Services Inc. License No. 160

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 78' laterals in 3' wide sand lined pressure dosed.

Parcel Description:

Legal: S11, T37 N, R27 W, C.O.S. 4380, PARCEL B, ACRES 121.03

Address or Location Parcel B

Geo/Assessors code: 0000007450

Approved Design Criteria:

Bedrooms: 8 Septic Tank Size: 2500/500 gallons Drainfield Size: 3X78' Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Buck Schermerhorn, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Buck Schermerhorn *Date:* 8/15/22


Title: President

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

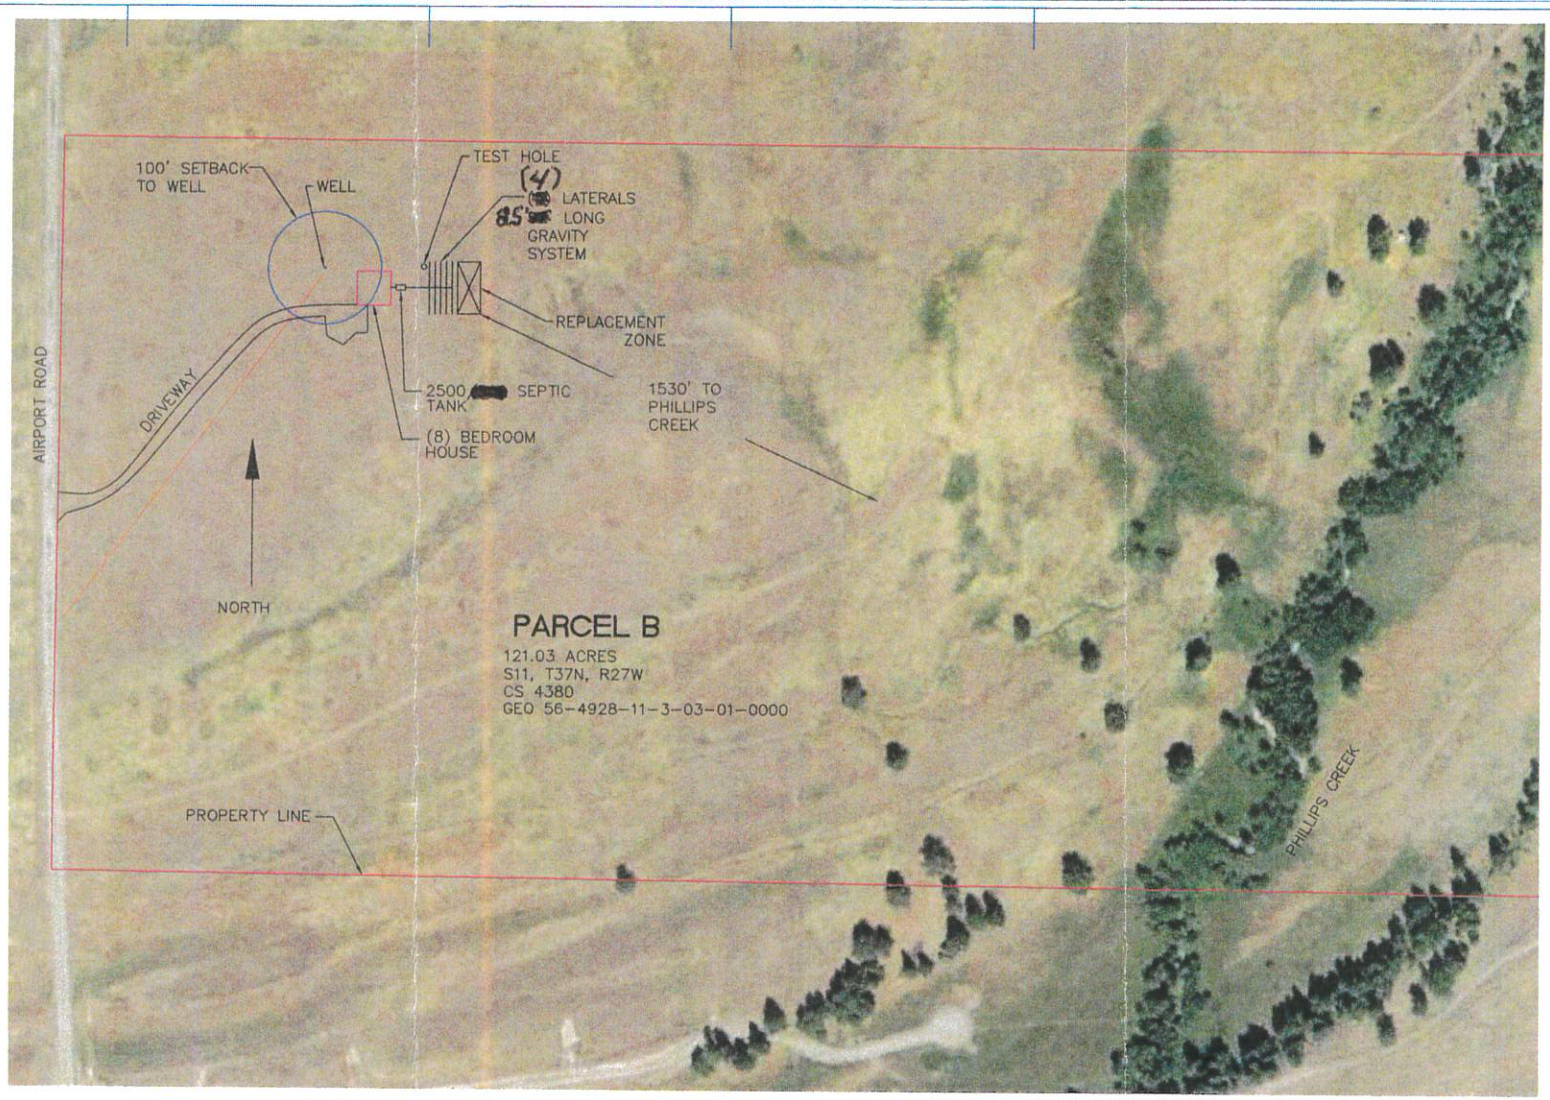

STODDARD SITE LAYOUT

THIS DRAWING IS PROPERTY OF KEI UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

REV	DATE	COMPANY	SCALE:
		KEI	1/16 = NOTED
		CONTRACT:	DATE:
		VERBAL	2/2021
		PLOT FILE:	WEIGHT
		PML-0001	

DWG TOLERANCES: .xx +/-.03" .xxx +/-.010" 1/2+/-1/64" FINISH

KOOCANUSA EXCAVATING
STODDARD SEPTIC
SITE LAYOUT
CONFIRMATION 3/10/21
S. MCNAMARA 3/10/21
203-001 1