LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/11/2021

Expiration Date: 05/11/2022

Property Owner: Shane Storkson

c/o:

Address: [redacted]

Telephone: [redacted] (Home)

(Work)

Installer: [redacted] Home Owner Installed

License No. 175

XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 70' laterals using chambers.

Parcel Description:

Legal: S27, T33 N, R34 W, ACRES 3.24, TR 1B2 in NE SOUTH OF YAAK RIVER RD

Address or Location: 95 Yaak River Rd Troy, MT 59935

Geo/Assessors code: 0000021014

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 140 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Paul Dalziel, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Paul Dalziel *Date:* 6-22-2021

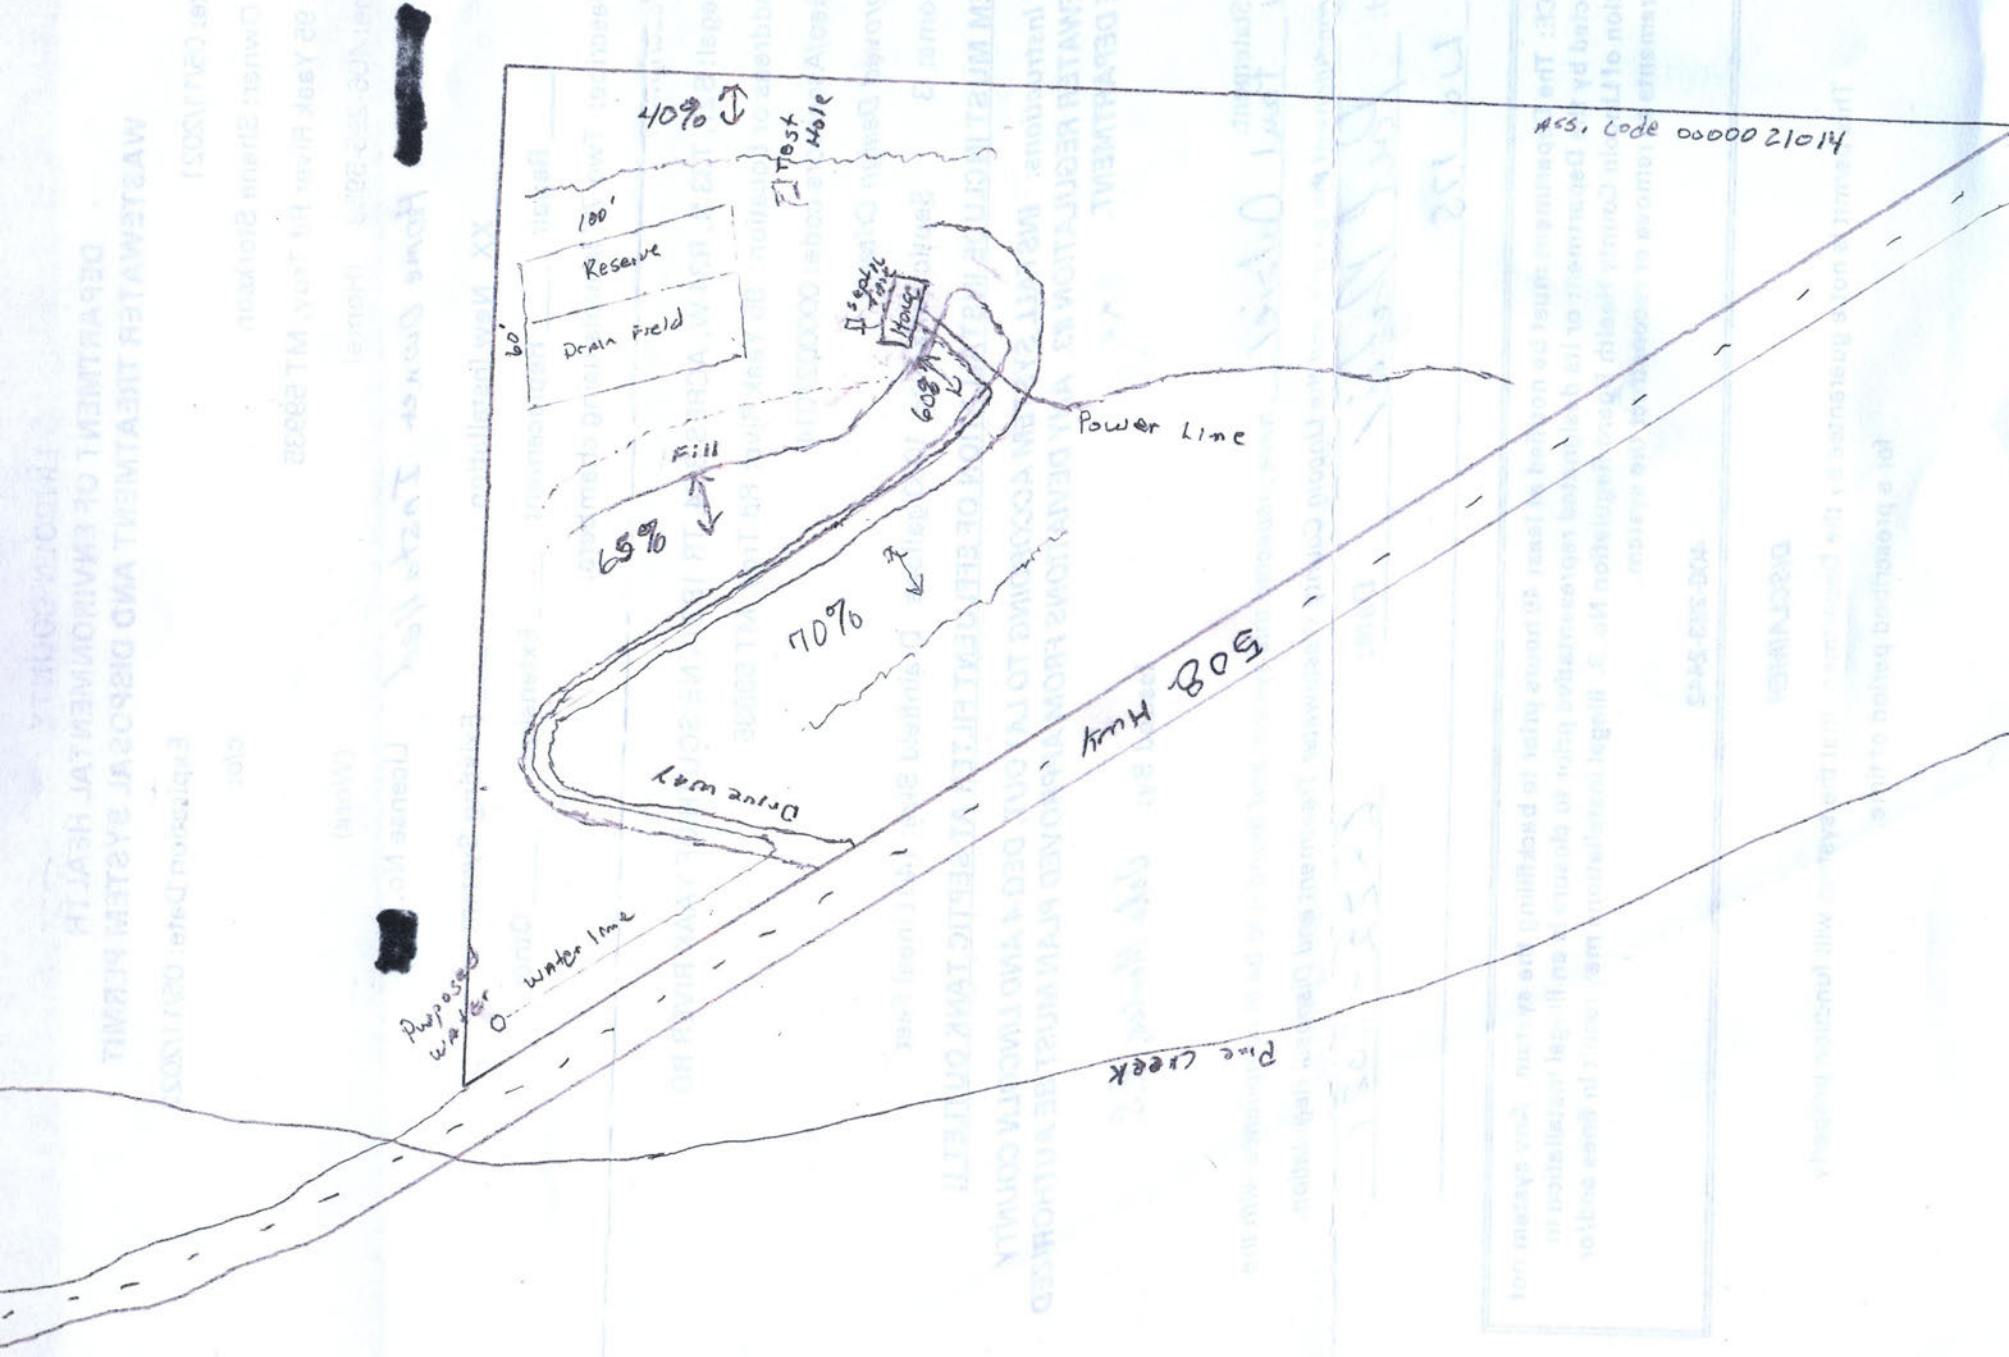
Title: Lic. 175

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


40%
Test Hole
100'
Reserve
Drain Field
60'
Septic Tank
House
60'
Fill
65%
70%
Power Line
Drive way
Hwy 805
Pine Creek
Proposed water line
Ass. Code 00000 21014