County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/07/2021 Expiration Date: 06/07/2022

Property Owner: Strope Holding LLC c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

____ New Installation __XX__ Existing System

____ Repair ____ Replacement __XX__ Extension ____ Other

Describe: 252' of rockless chamber in leach bed shape 20' yd wash rock.

Parcel Description:

Legal: RIVERSIDE DRIVE, S32, T31 N, R31 W, TRS 10 & 11 OR PARCELS A & B CS 3333

Address or Location: 12 LEWIS LOOP LOT 23

Geo/Assessors code: 0000008513

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 20'x30' Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 6-10-21

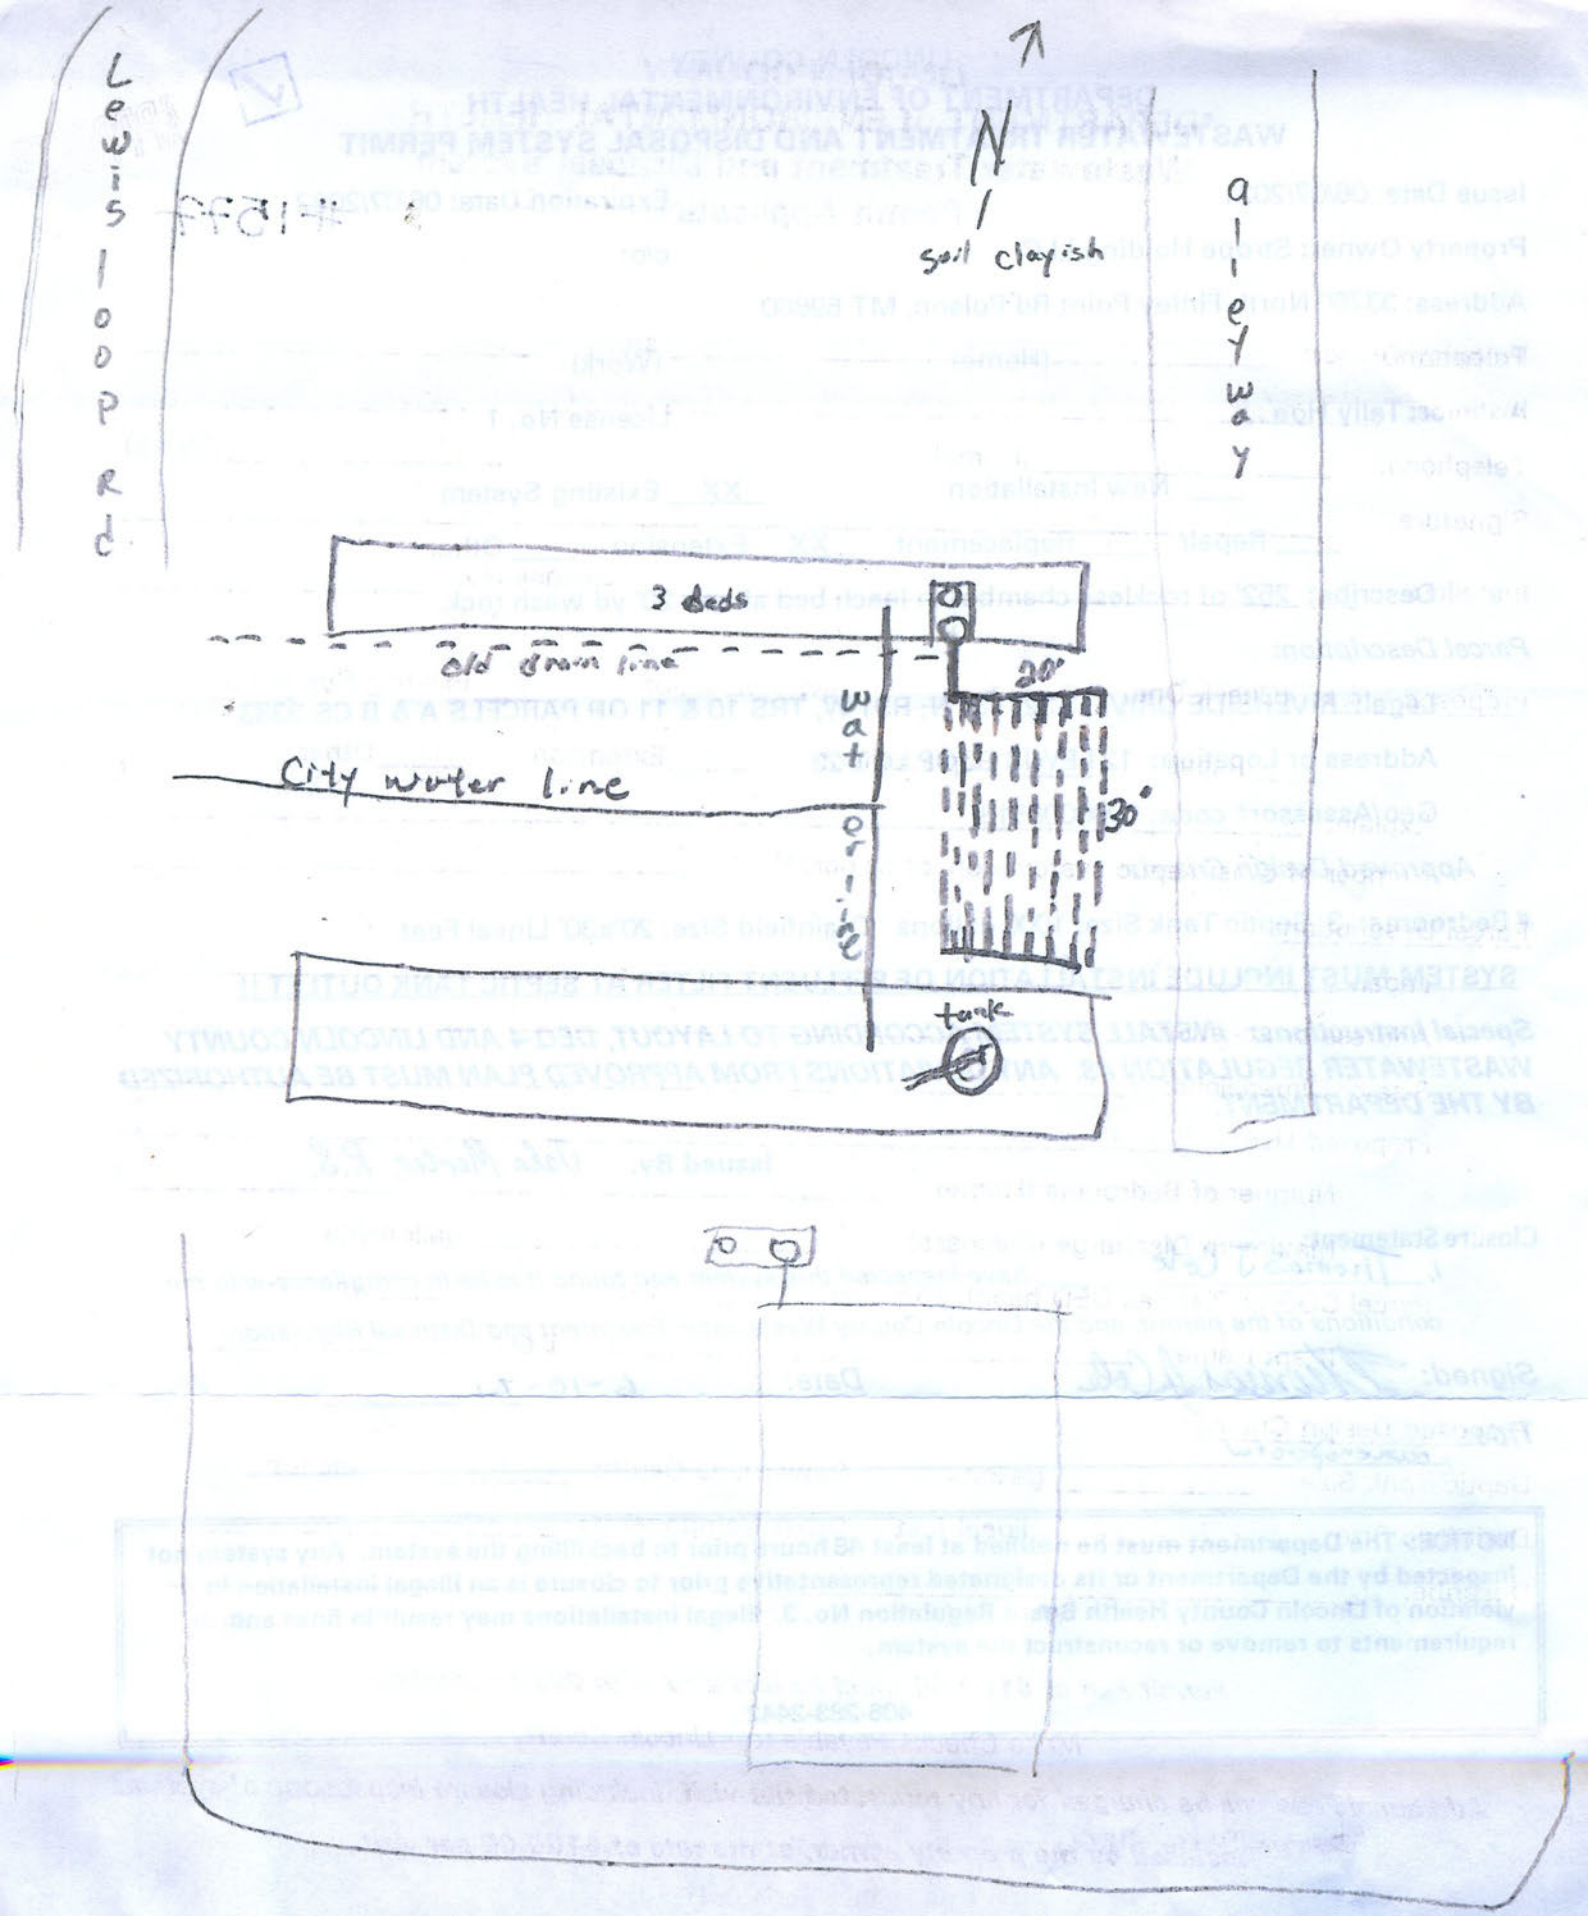
Title: owner operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lewis loop Rd
N
soil clayish
alley way
3 beds
old drain line
20'
water
City water line
30'
tank
Vanderwood street