# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/15/2022 Expiration Date: 03/15/2023

Property Owner: Thompson, Levi c/o: Svendsby, Jessica

Address: [redacted]

Telephone: [redacted]

Installer: TBD License No. __

XX New Installation ____ Existing System ____ Repair ____ Replacement

____ Extension ____ Other

Describe: Gravity feed system with 1,000 gallon tank and effluent filter. Traditional absorption trenches with 3 laterals @ 100-feet in length each. Laterals to be separated by at least 5-feet between trench walls.

*Parcel Description:*

Legal: MOUNT SNOWY VISTA, S11, T29 N, R31 W, Lot 4

Address or Location: Mount Snowy Vista Lot 4, Libby, MT 59923

Geo/Assessors code: 0000055022

*Approved Design Criteria:*

# Bedrooms 1 Septic Tank Size: 1,000 gallon Drainfield Size: 300 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

*Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.* **Septic tank to be installed at least 10-feet from foundation walls and 10-feet from drainfield. All other setback requirements in DEQ-4 must be followed.**

**Issued By:** Nicholas Raines

Closure Statement:

I, Levi Thompson, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

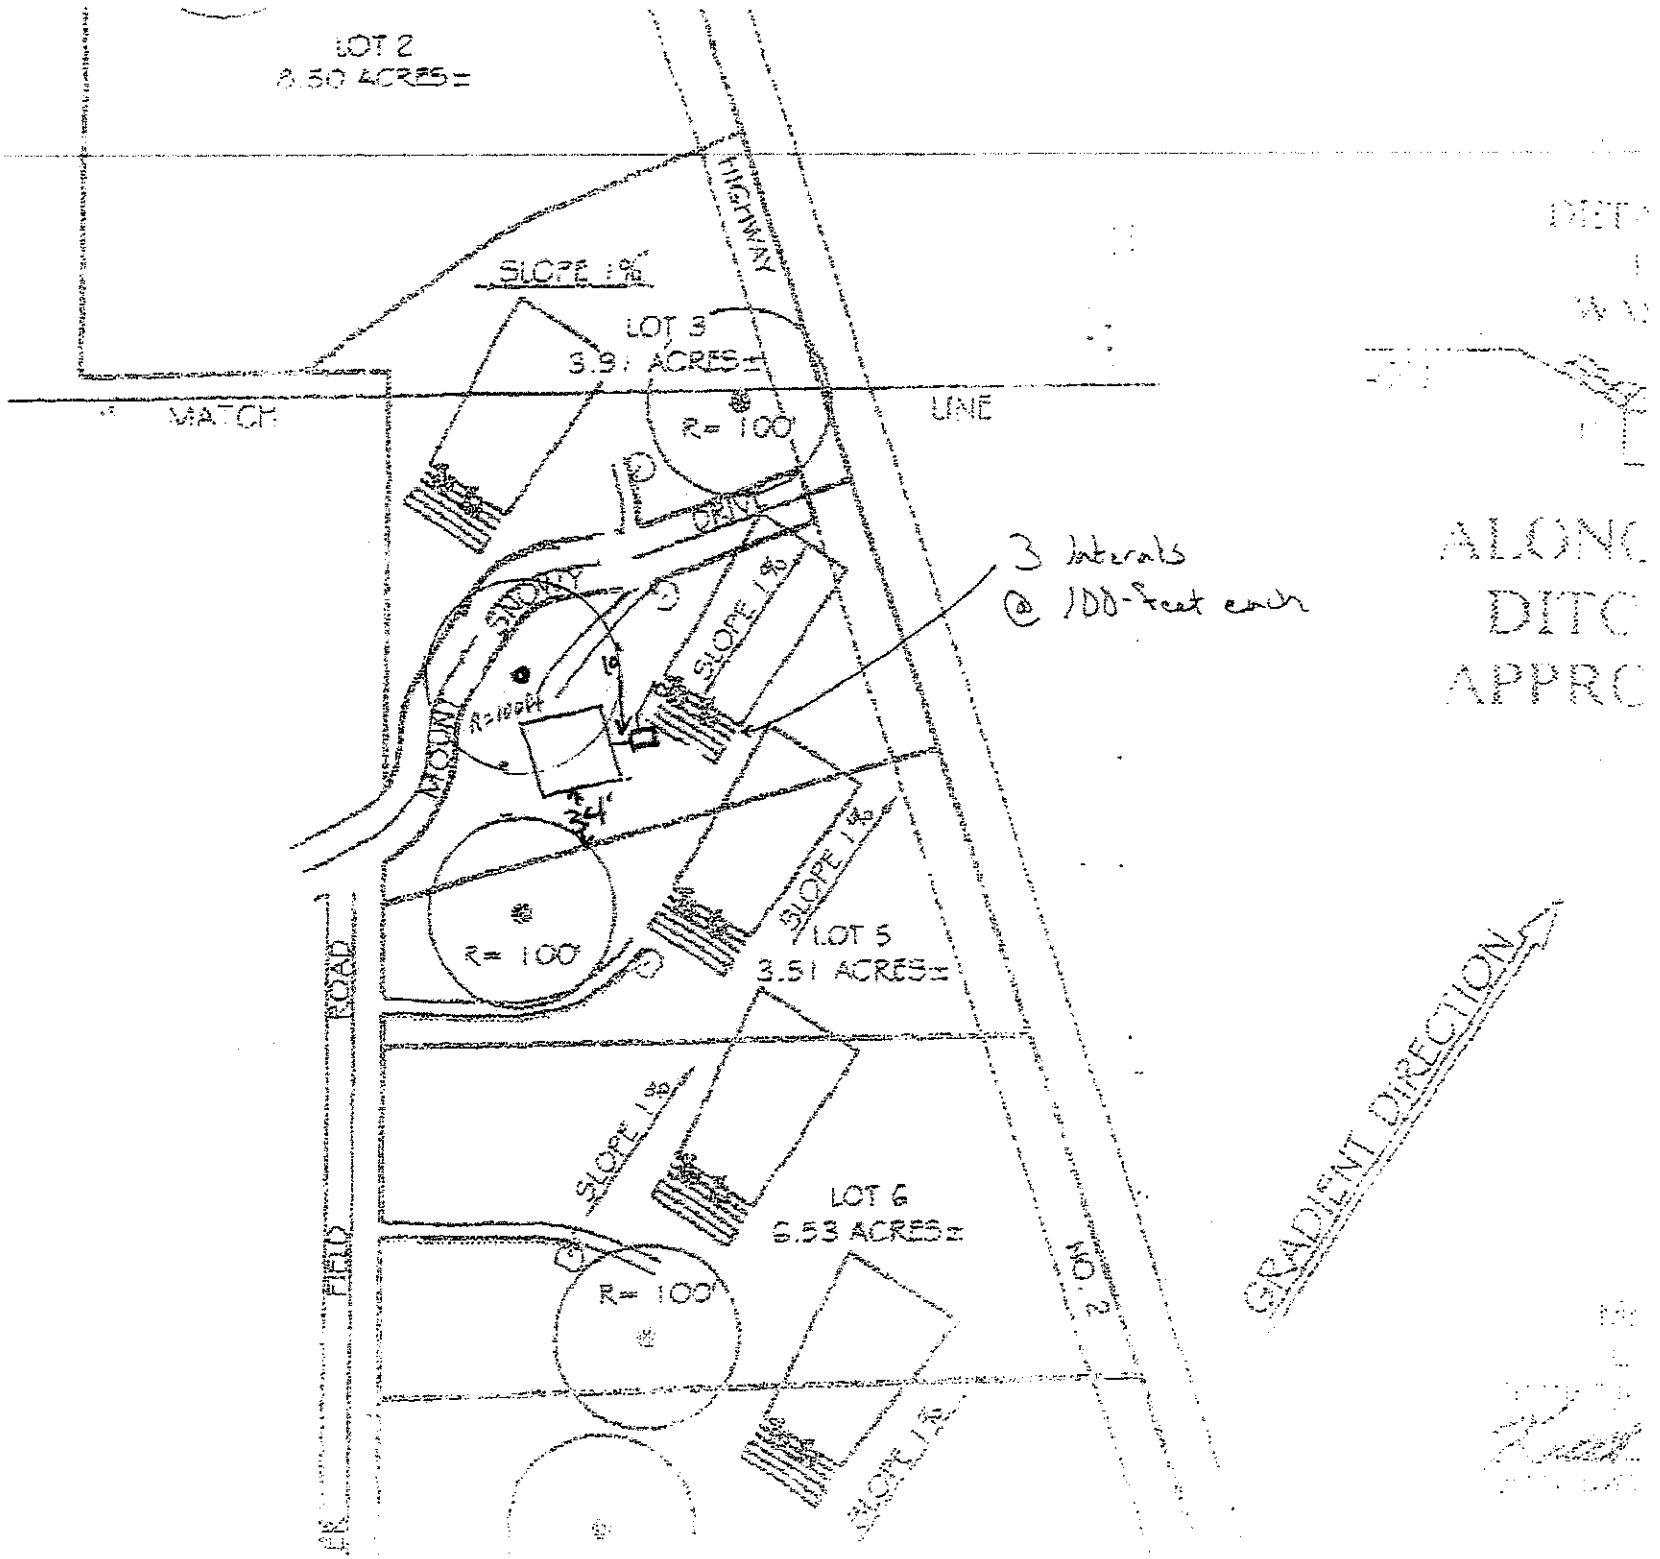
*Signed:* [signature] *Date:* 11/18/2022

*Title:* Maarda Davis, Envir. Health Tech. Inspected 11/16/22.

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**
**406-283-2442**

*DISCLAIMER*

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT 2
8.50 ACRES±
SLOPE 1%
HIGHWAY
LOT 3
3.91 ACRES±
MATCH
LINE
R= 100'
DRIVE
SWALE
SLOPE 1%
3 Intervals
@ 100-feet each
R=100ft
MOUND
SLOPE 1%
R= 100'
LOT 5
3.51 ACRES±
ROAD
FIELD
SLOPE 1%
LOT 6
6.53 ACRES±
R= 100'
SLOPE 1%
GRADIENT DIRECTION