LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/07/2021 Expiration Date: 07/07/2021

Property Owner: Orville & Donna Vandergriend c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Paul Dalziel License No. 175

XX New Installation ____ Existing System

____ Repair ____ Replacement Extension Other

Describe: Two 60' laterals using chambers. Size reduced per 0.8 app rate.

Parcel Description:

Legal: S28, T37 N, R31 W, HES 499 LESS TRACTS TR-5A OF HES 500 156.7041 ACRES

Address or Location: TR-5A 355/408 Upper Ford Cut off Yaak, MT

Geo/Assessors code: 0000000404

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 160 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Paul Dalziel, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Paul Dalziel *Date:* 7-15-2020

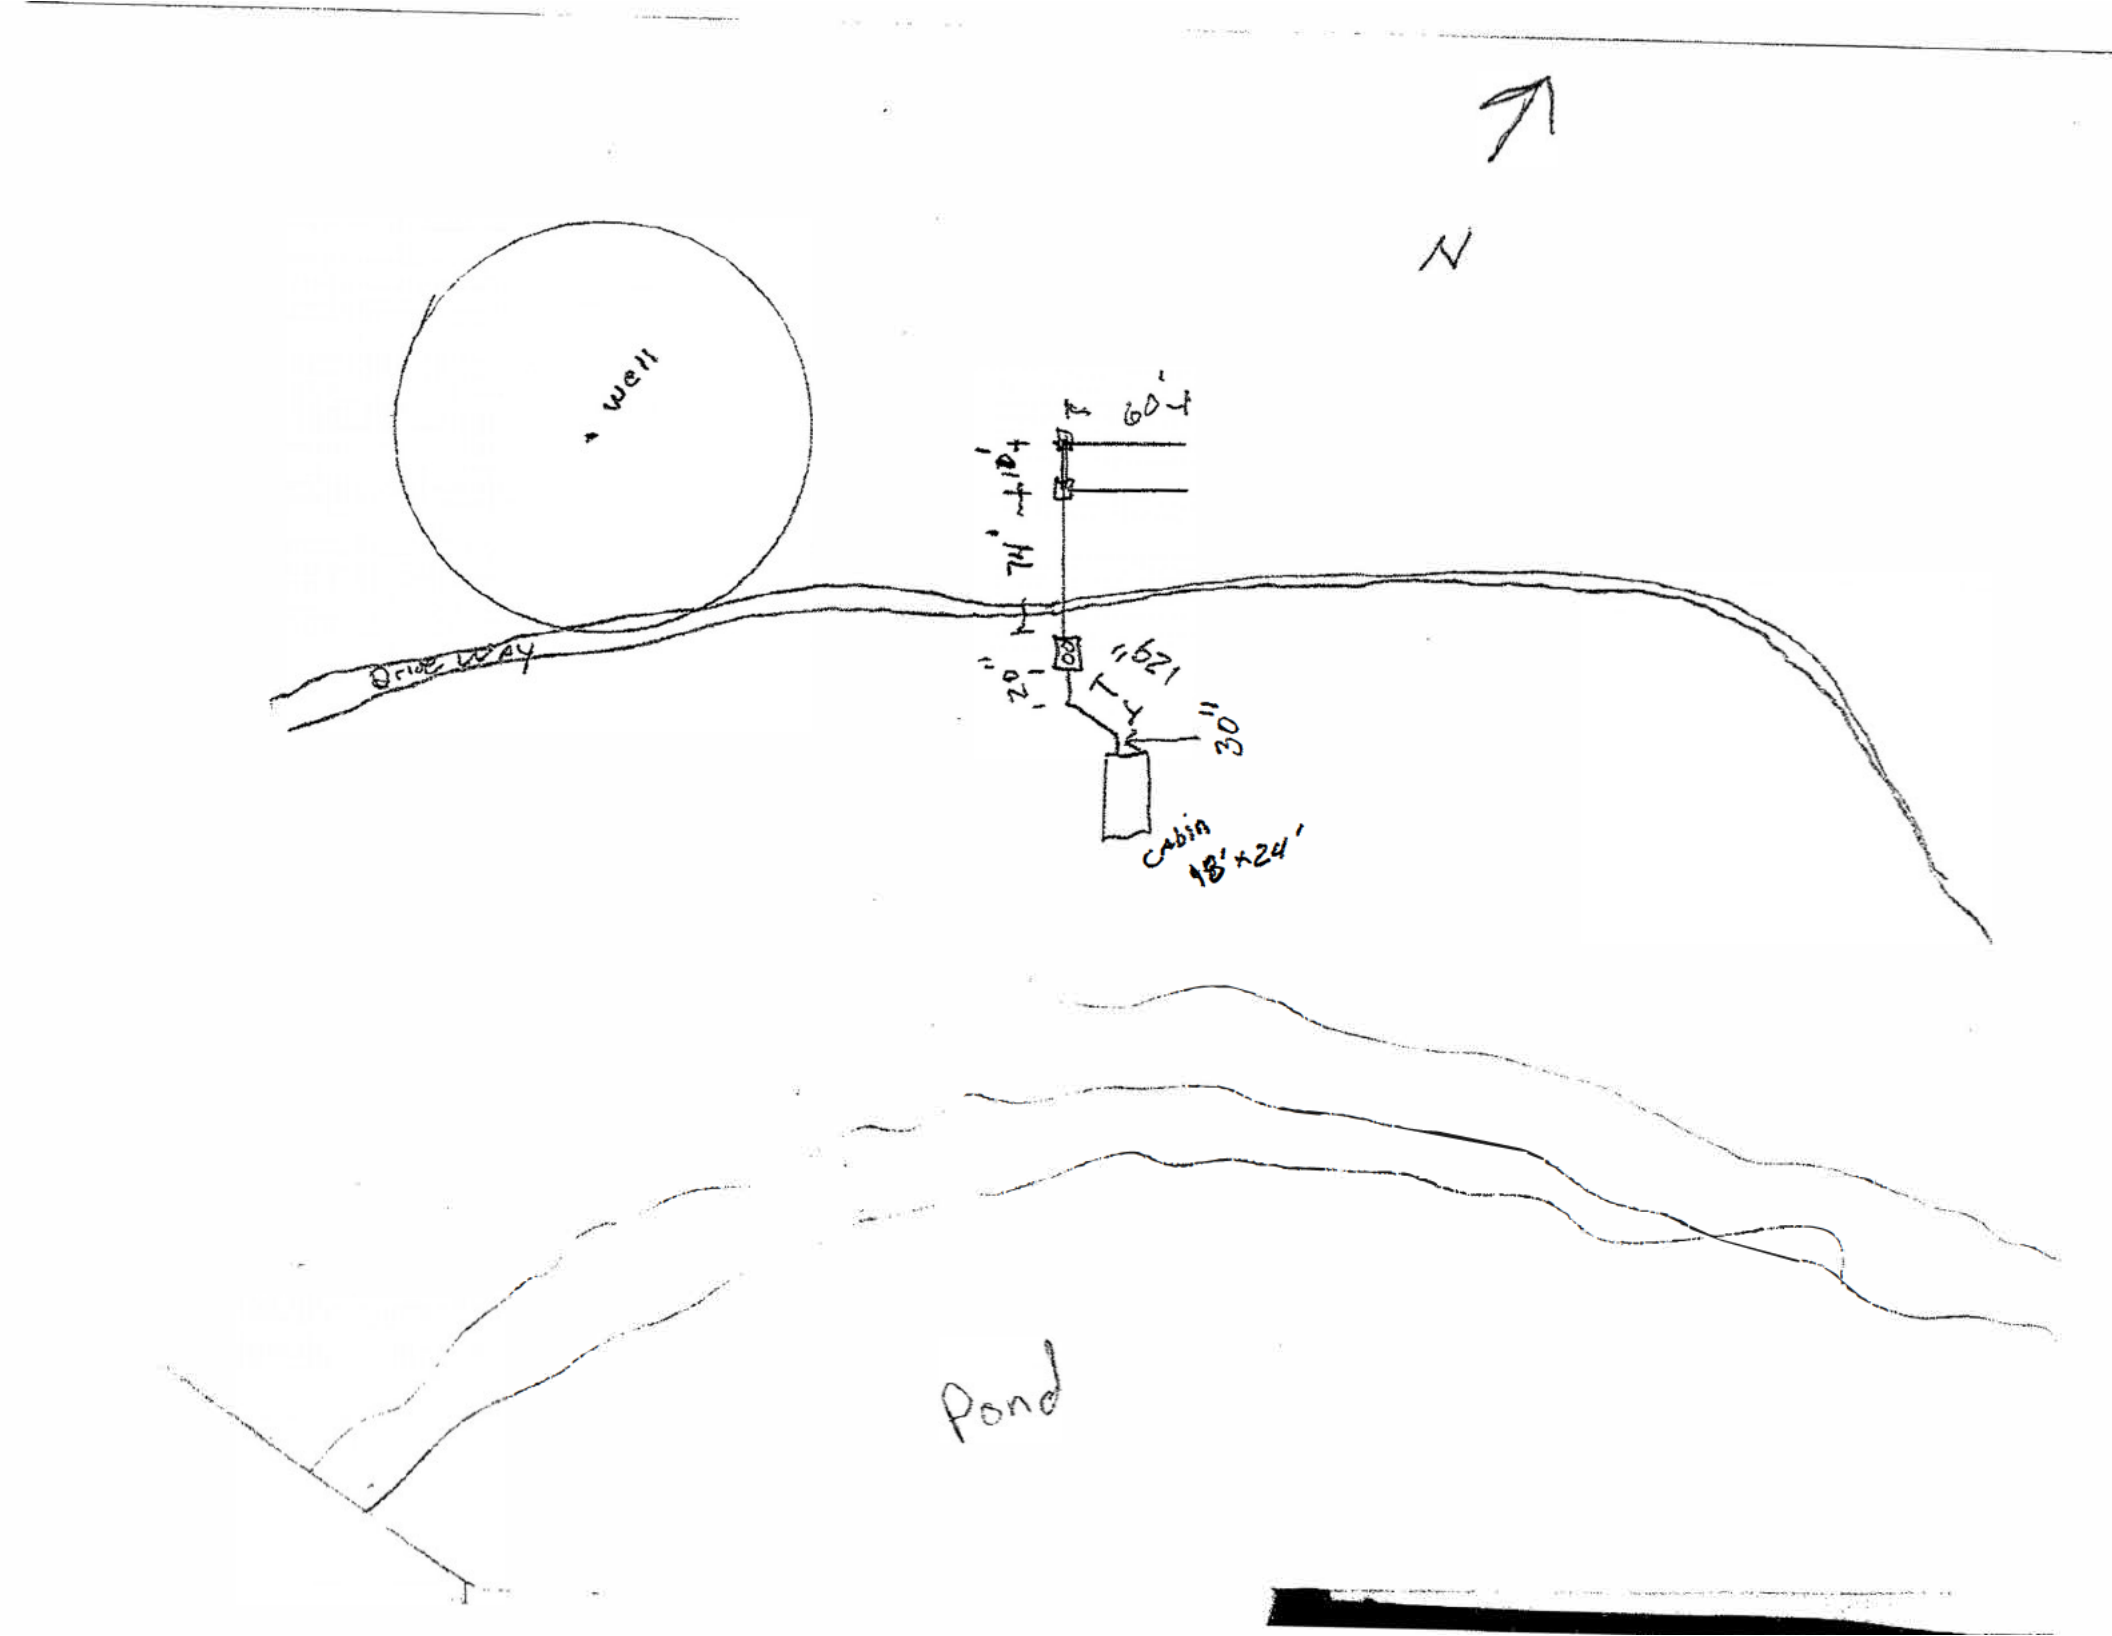
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time


N
well
60'
14'
Driveway
20'
621
30'
Cabin
18'x24'
Pond