LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/15/2022 Expiration Date: 03/15/2023

Property Owner: Warnick, Richard & Leslie c/o: Johnson, Jere

Address: [redacted]

Telephone: [redacted]

Installer: Royden Caldwell License No. 171

XX New Installation ____ Existing System ____ Repair ____ Replacement

____ Extension ____ Other

Describe: Pressure-dosed (siphon) system serving a 4-bed house and 1-bed guest house. System will include 1,500 gal septic tank, 1,000 gal septic tank, 1,000 dosing tank (413 siphon), and effluent filter. Traditional absorption trenches with 5 laterals at 84 feet in length each.

Parcel Description:

Legal: S04, T35 N, R26 W, C.O.S. 1672, PARCEL D, ACRES 26.837, or TR 6B IN SESW & SWSE

Address or Location: 360 Maranatha Rd, Eureka, MT 59917

Geo/Assessors code: 0000011846

Approved Design Criteria:

Bedrooms 4+1 Septic Tank Size: 1,500&1,000gal tanks and 1,000 gal pressure-dosing

Drainfield Size: 420 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

WARNICK PROPERTY
WATER AND SEWER
LOT LAYOUT

SECTION 4-T35N-R26W
LINCOLN COUNTY

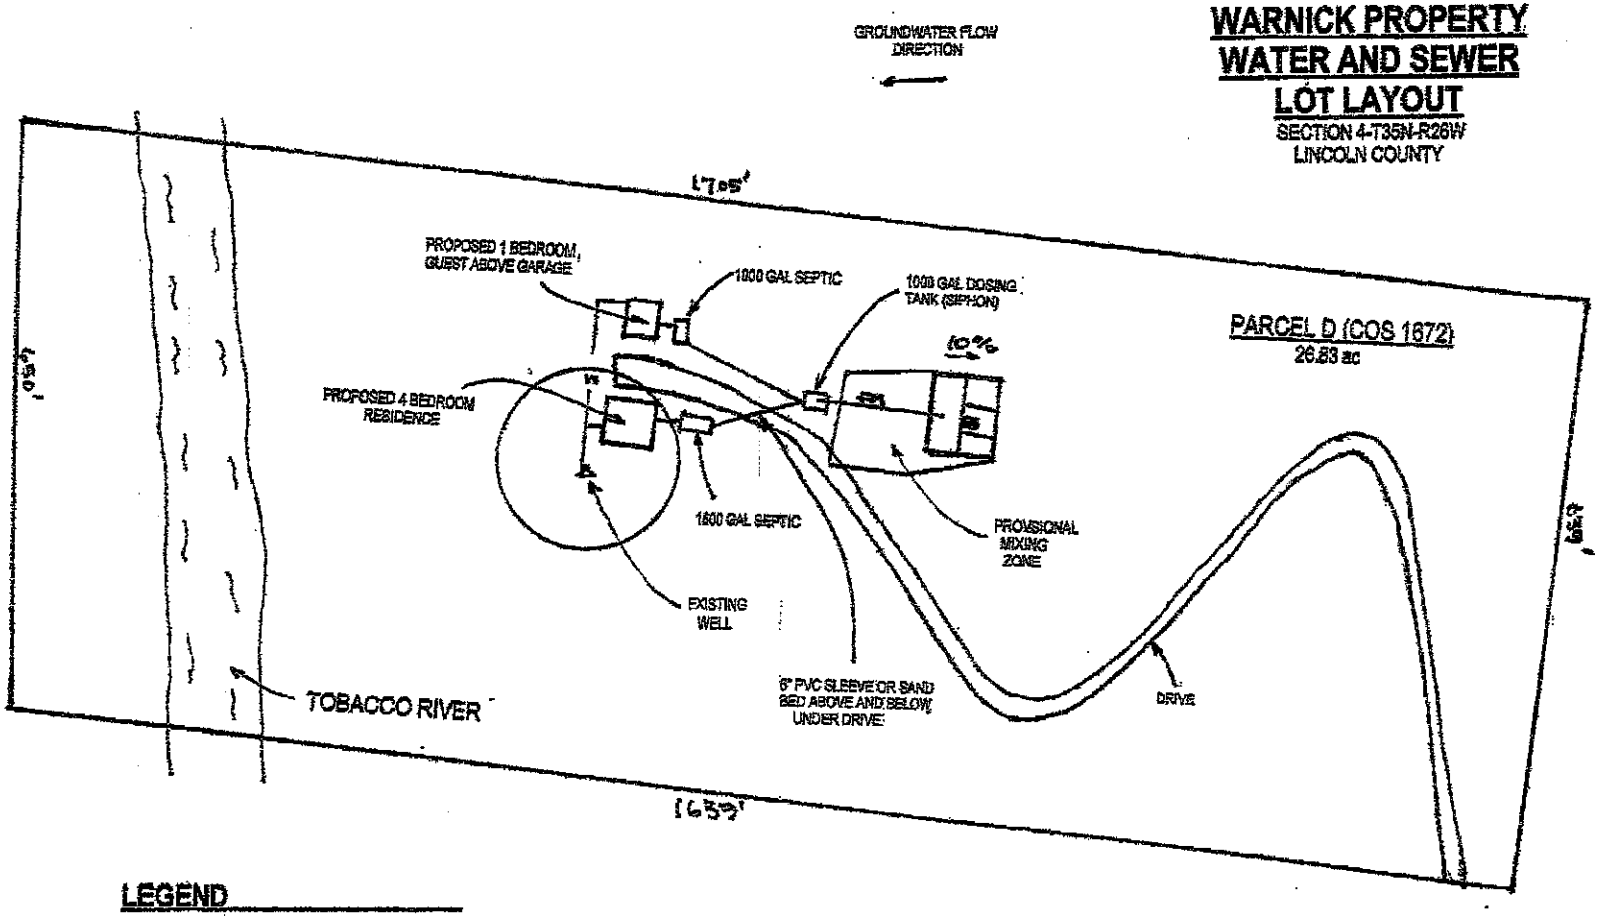

LEGEND

PROPOSED PRIMARY/REPLACEMENT DRAINFIELDS

N

TEST HOLE/ GROUNDWATER PIPE

1" = 200'

-FM- SEWER FORCEMAIN

-W- WATER LINE

Jere Johnson, RS
4572 Whitefish Stage Road
Whitefish MT 59937