LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/14/2021 Expiration Date: 06/14/2022

Property Owner: Kurt Westenbarger c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Koocanusa Excavating License No. 135

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 84' pressure dosed laterals in 3' wide trenches.

Parcel Description:

Legal: MOUNTAIN FOOTHILLS ESTS PH 1, S07, T36 N, R26 W, ACRES 6.02, LOT 8A CS 4583

Address or Location: LOT8A

Geo/Assessors code: 0000055601

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 336 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Burk Schermerhorn, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Burk Schermerhorn *Date:* 9/15/22


Title: President

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

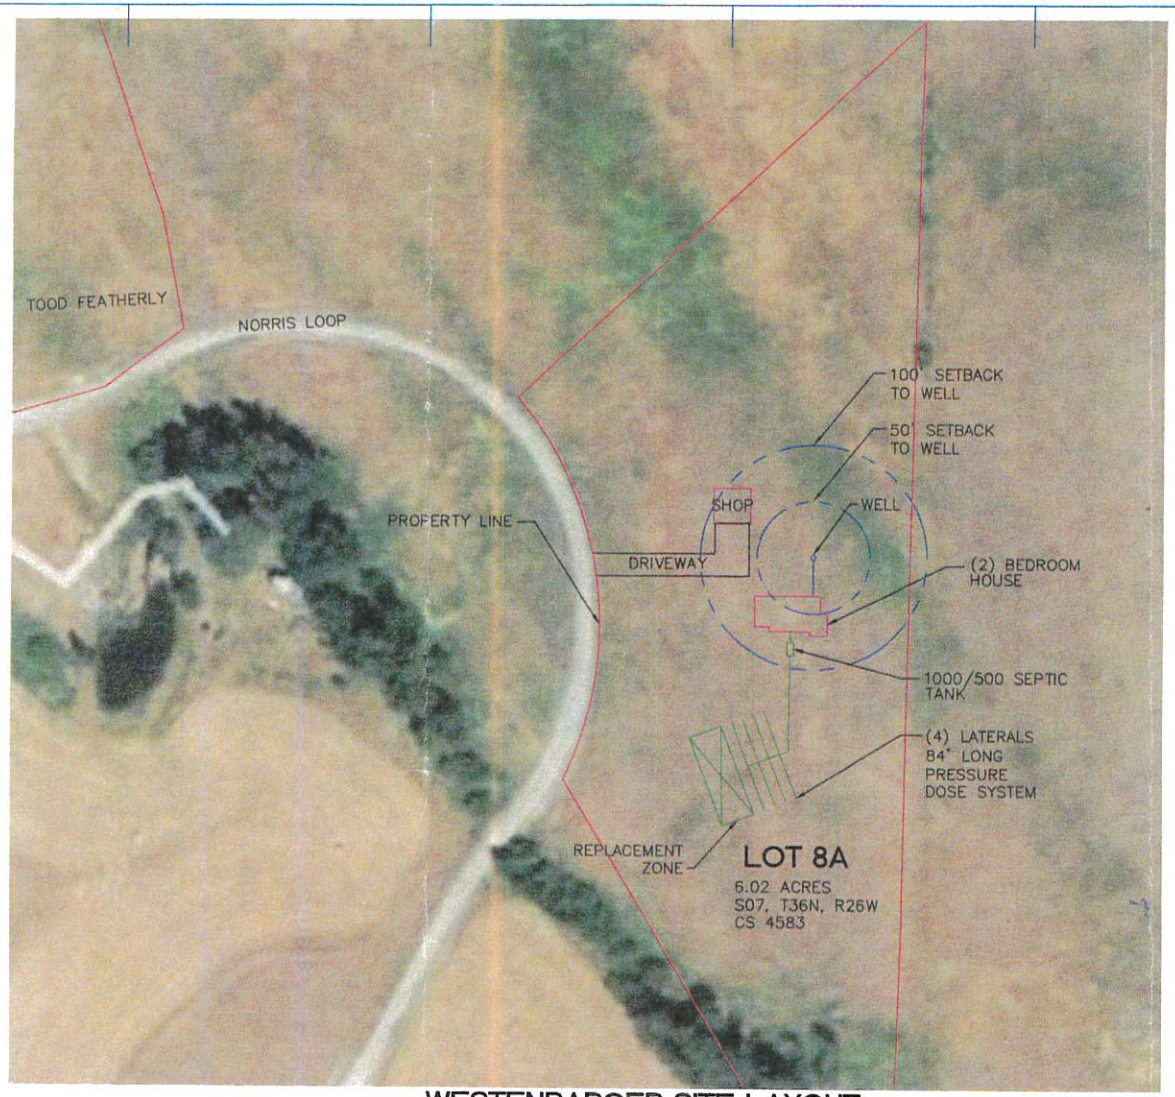

DRAINFIELD SIZING:

(3) BEDROOM– 1500 SQFT
(2) BEDROOM– 1000 SQFT
1000 SQFT/3 FT GALLERIES= 333LF
(4) LATERALS @ 84' EACH= 336LF

WESTENBARGER SITE LAYOUT

REV	DATE	COMPANY	SCALE:	KOOCANUSA EXCAVATING WESTENBARGER SEPTIC
		KEI	1/16 = NOTED	SITE LAYOUT
		CONTRACT:	DATE:	DRAWN BY: 4/20/21
		VERBAL	1/2021	S. MCNAMARA 4/20/21
		PLOT FILE:	WEIGHT	JOB NO. 202-001 SHEET NO. 1
		PML-0001	----	

THIS DRAWING IS PROPERTY OF KEI UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

⑥ ⑤ ④ ③ ②