LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/08/2021 Expiration Date: 04/08/2022

Property Owner: Wilderness Preserve c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Earth Works License No. 164

___ Direct Connection __XX__ Grinder Pump Connection_____ Lift Tank Connection

Describe: Sewer line connection to sewer main for approved drain field.

Parcel Description:

Legal: WILDERNESS CLUB PH 2, S32, T37 N, R27 W, Lot 178, ACRES 0.961, PM 6896

Address or Location: LOT 178

Approved Design Criteria:

This lot is approved for 3 bedrooms. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 300 gallons per day. Any proposed increase in wastewater flows must be reviewed by and receive the approval of the HOA Review Board and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL DIRECT SEWERLINE CONNECTION TO THE SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE LOT LAYOUT AND DEQ APPROVAL STATEMENT E.Q. 06-3006. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE *Wilderness Club Homeowners/*ENVIRONMENTAL REVIEW BOARD, DEQ AND THE DEPARTMENT.

Issued By: *Jake T. Mertes*

Closure Statement:

I, Darwin Reid, *have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.*

Signed: Darwin Reid *Date:* 5/27/21

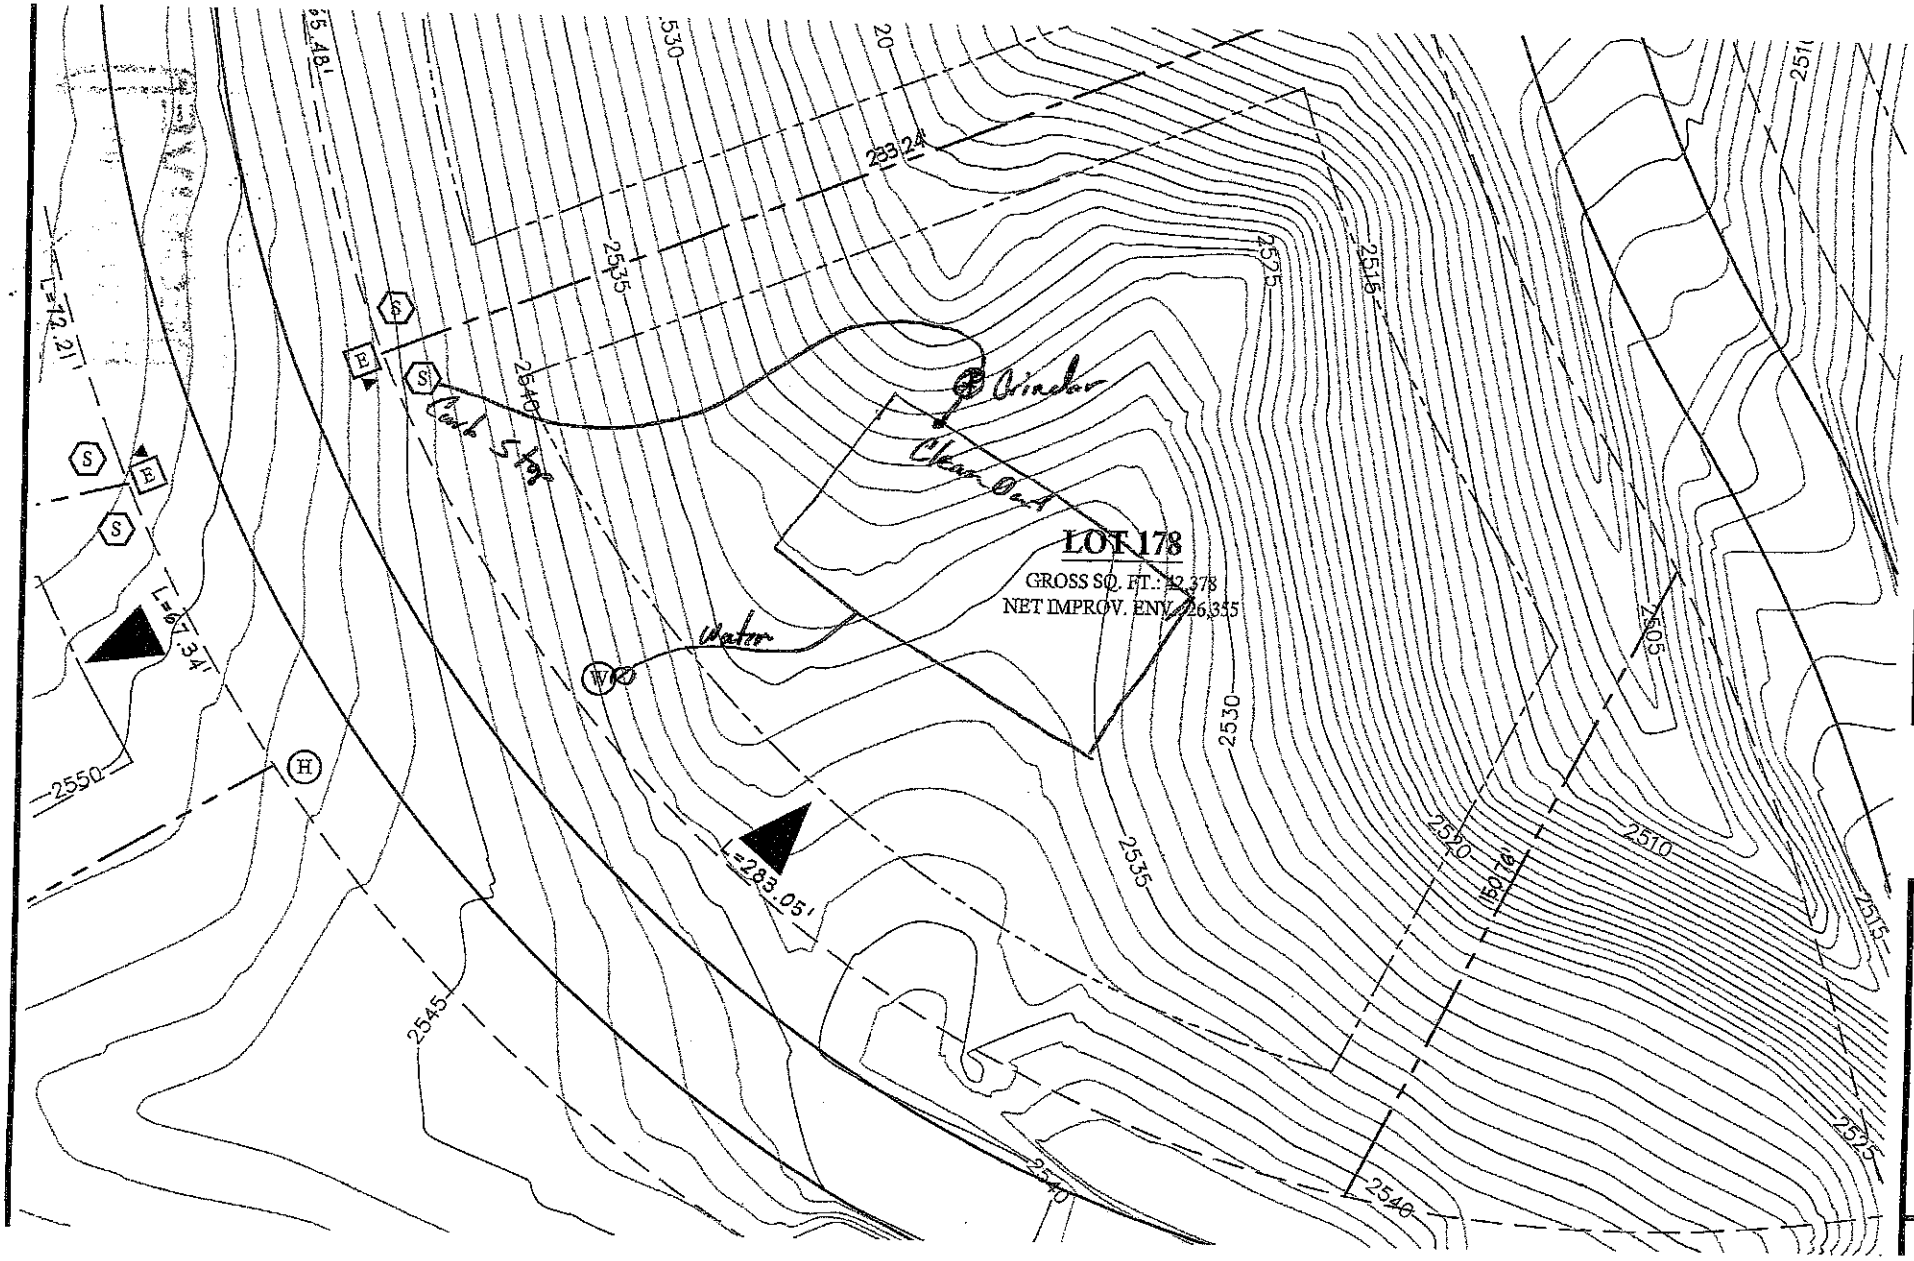
Title: Owner Earth Works #164

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.

RECEIVED
SEP 22 2021
BY:


LOT 178
GROSS SQ. FT.: 32,378
NET IMPROV. ENV.: 26,355
Water
Clean Out
Cable TV
L=72.21'
L=67.34'
L=283.05'
283.24'
2550
2545
2540
2535
2530
2525
2520
2515
2510
2505
2530
2535
2540
2545
2550
SIDE
N
S
E
W