

**LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT**

Issue Date: 10/22/2021

Expiration Date: 10/22/2022

Property Owner: Michael D Williams

c/o:

Address: [REDACTED]

Telephone: [REDACTED]

(Work)

Installer: Terry Oedewaldt

License No.

XX New Installation

Existing System

Repair

Replacement

Extension

Other- Renewal (MD)

Describe: Four 28' laterals using pressure dosed sand mound system.

Parcel Description:

Legal: MCGINNIS CREEK FLATS 4 PH 1, S08, T26 N, R28 W, ACRES 6.42, LOT 3A PM 7059

Address or Location: LOT 3A

Geo/Assessors code: 0000056311

Approved Design Criteria:

Bedrooms: 2

Septic Tank Size: 1000/500 gallons

Drainfield Size: 112 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi Hooper, R.S.*

Closure Statement:

I, Terry Oedewaldt, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: 

Date:

7/27/2022

Title:

Permittee

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

2

MIKE WILLIAMS SEPTIC

7/27/2022

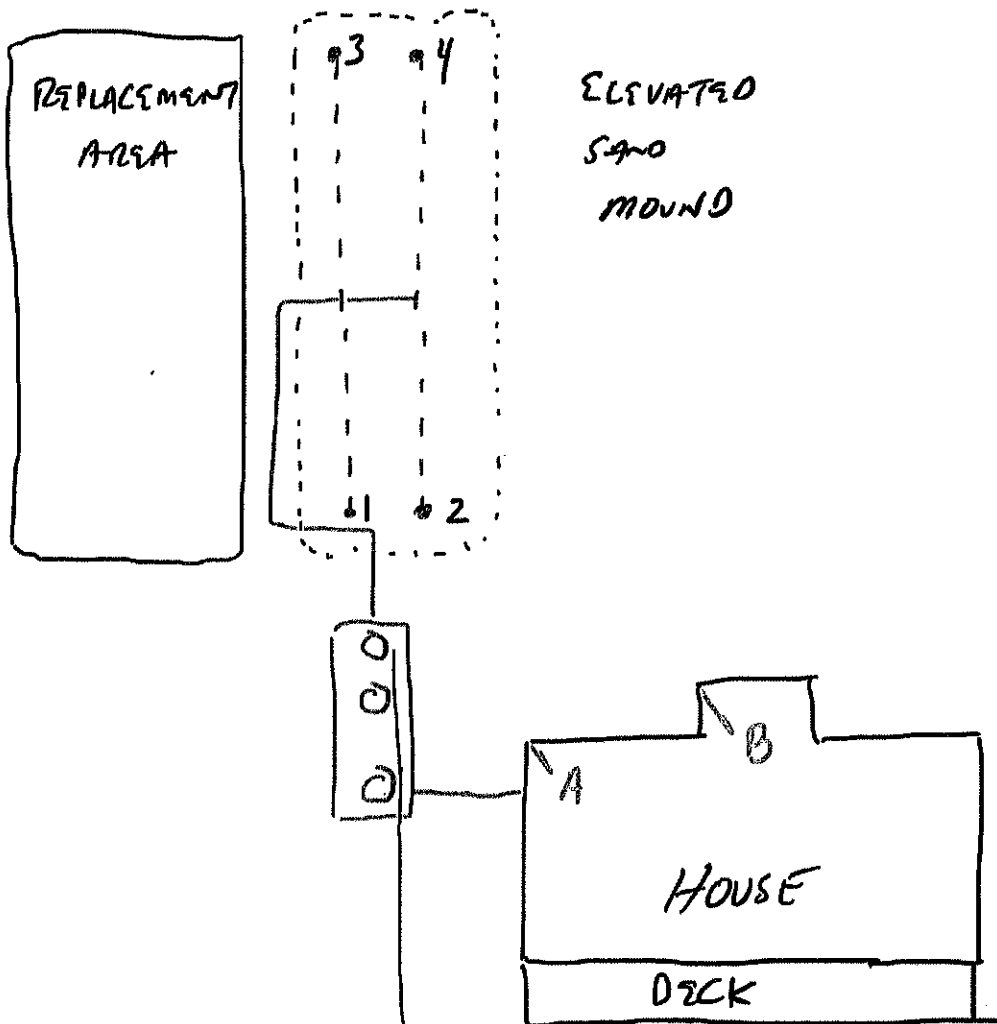

ELEVATED
SAND
MOUND

LOCATIONS: A B

INLET	12'4	27'4
FILTER	13'6	25'1
PUMP	15'8	24'8
1	24'6	28'8
2	21'6	23'6
3	80'6	74'2
4	79'6	72'4

UG POWER

WATER

TO
WELL

DRIVEWAY