LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

ssue Date: 08/17/2020 Expiration Date: 08/17/2021

Property Owner: Angelina Beltram c/o: Daniel Beltram

Address: [redacted]

Telephone: [redacted] (Home) (Work) [redacted]

nstaller: Bradley Persson License No. 159

__XX__ New Installation ____ Existing System

____ Repair ___ Replacement ____ Extension ____ Other

Describe: Four 84' pressure dosed laterals in 3' wide chambers.

Parcel Description:

Legal: S30, T36 N, R26 W, C.O.S. 4374, ACRES 10.007, TRACT 4 *56047*

Address or Location: Tripp Trail Tract 4

Geo/Assessors code: 0000056047

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1500 gallons Drainfield Size: 336 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Bradley S. Persson, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* Sept 14-2020

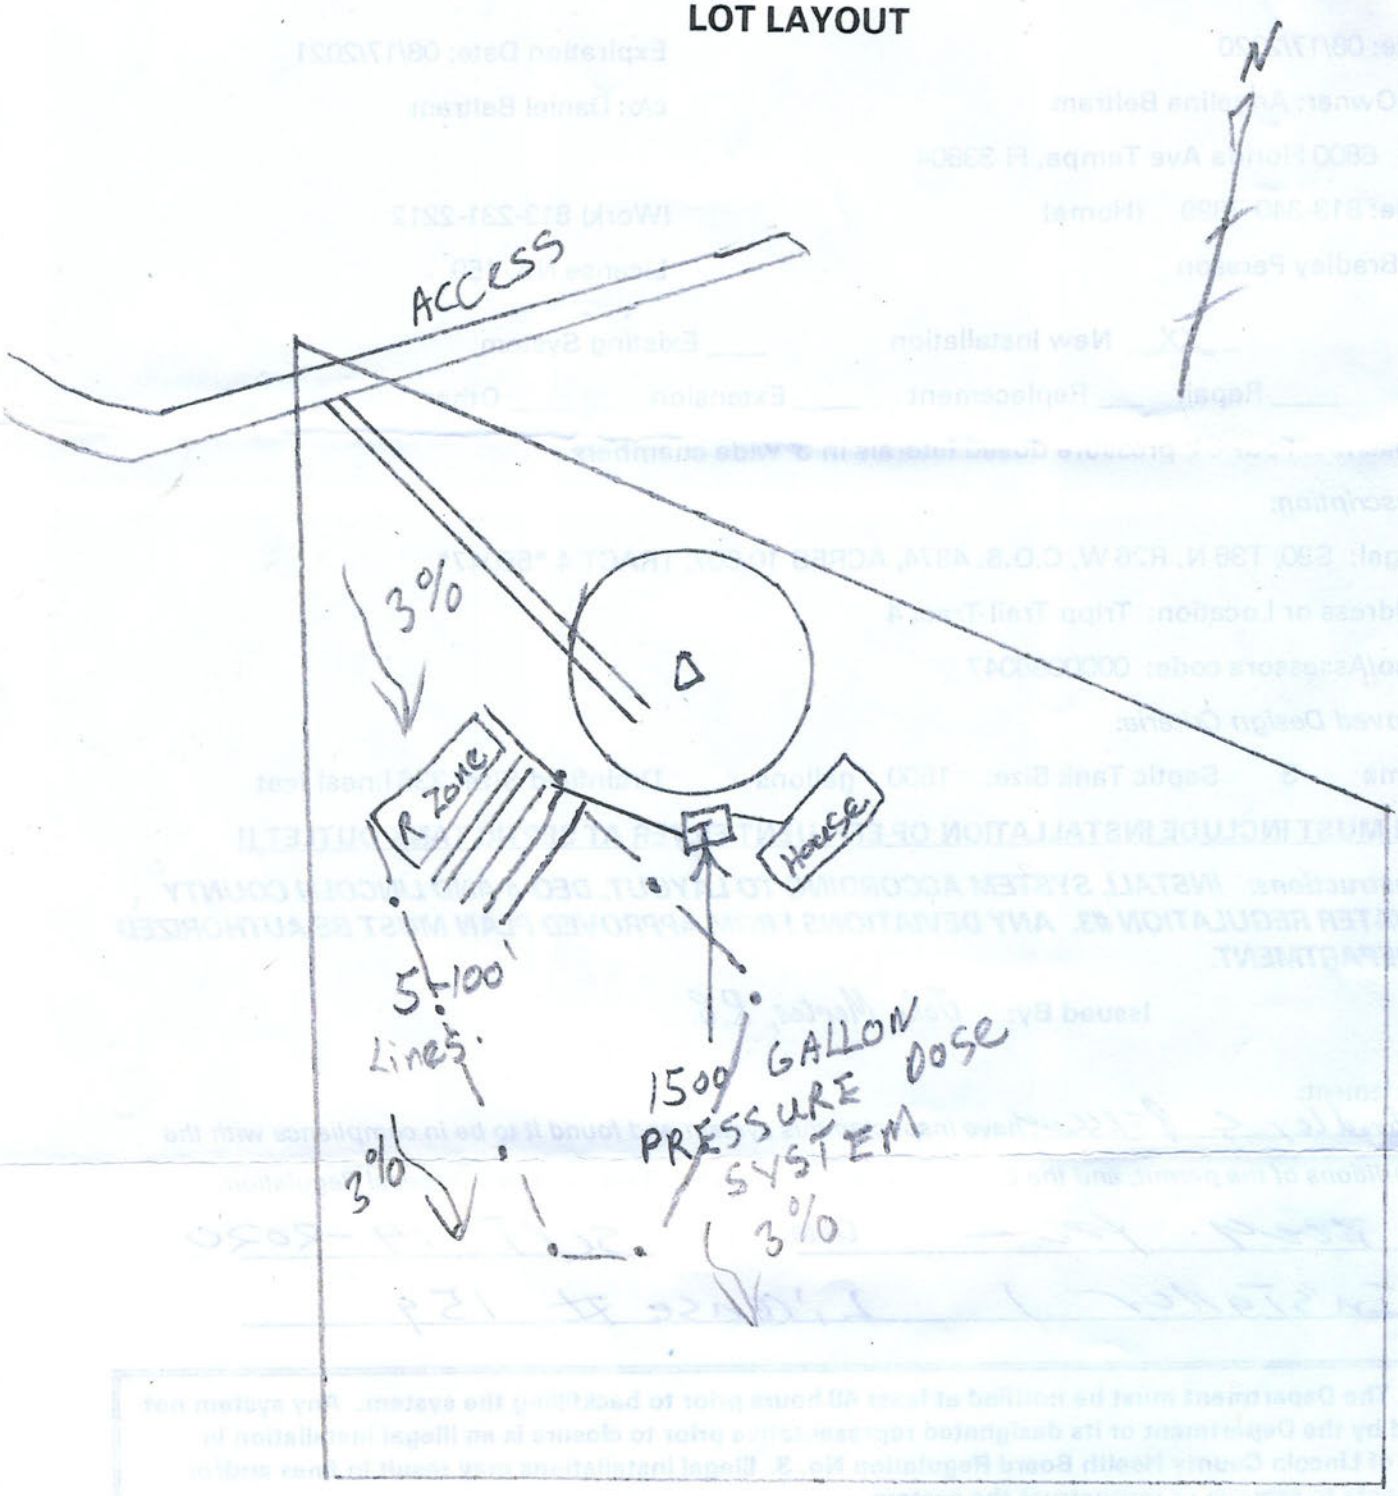
Title: Installer / License # 159

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

LOT LAYOUT


N
ACCESS
3%
R ZONE
HOUSE
5+100'
Lines
3%
1500 GALLON
PRESSURE DOSE
SYSTEM
3%