LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/24/2020 Expiration Date: 09/24/2021

Property Owner: Jerry & Amanda Benge c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Earth Works License No. 164

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Gravity system, 2ft Chambers, Sandlined

Parcel Description:

Legal: SOPHIE SHORES UNIT 2, S15, T37 N, R27 W, ACRES 16.205, LOT 6B

Address or Location: LOT 6B

Geo/Assessors code: 0000017835

Approved Design Criteria:

Bedrooms 7 Septic Tank Size: 2000 gallon Drainfield Size: 4X100 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Darwin D. Plank, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Darwin D. Plank *Date:* 11/5/20

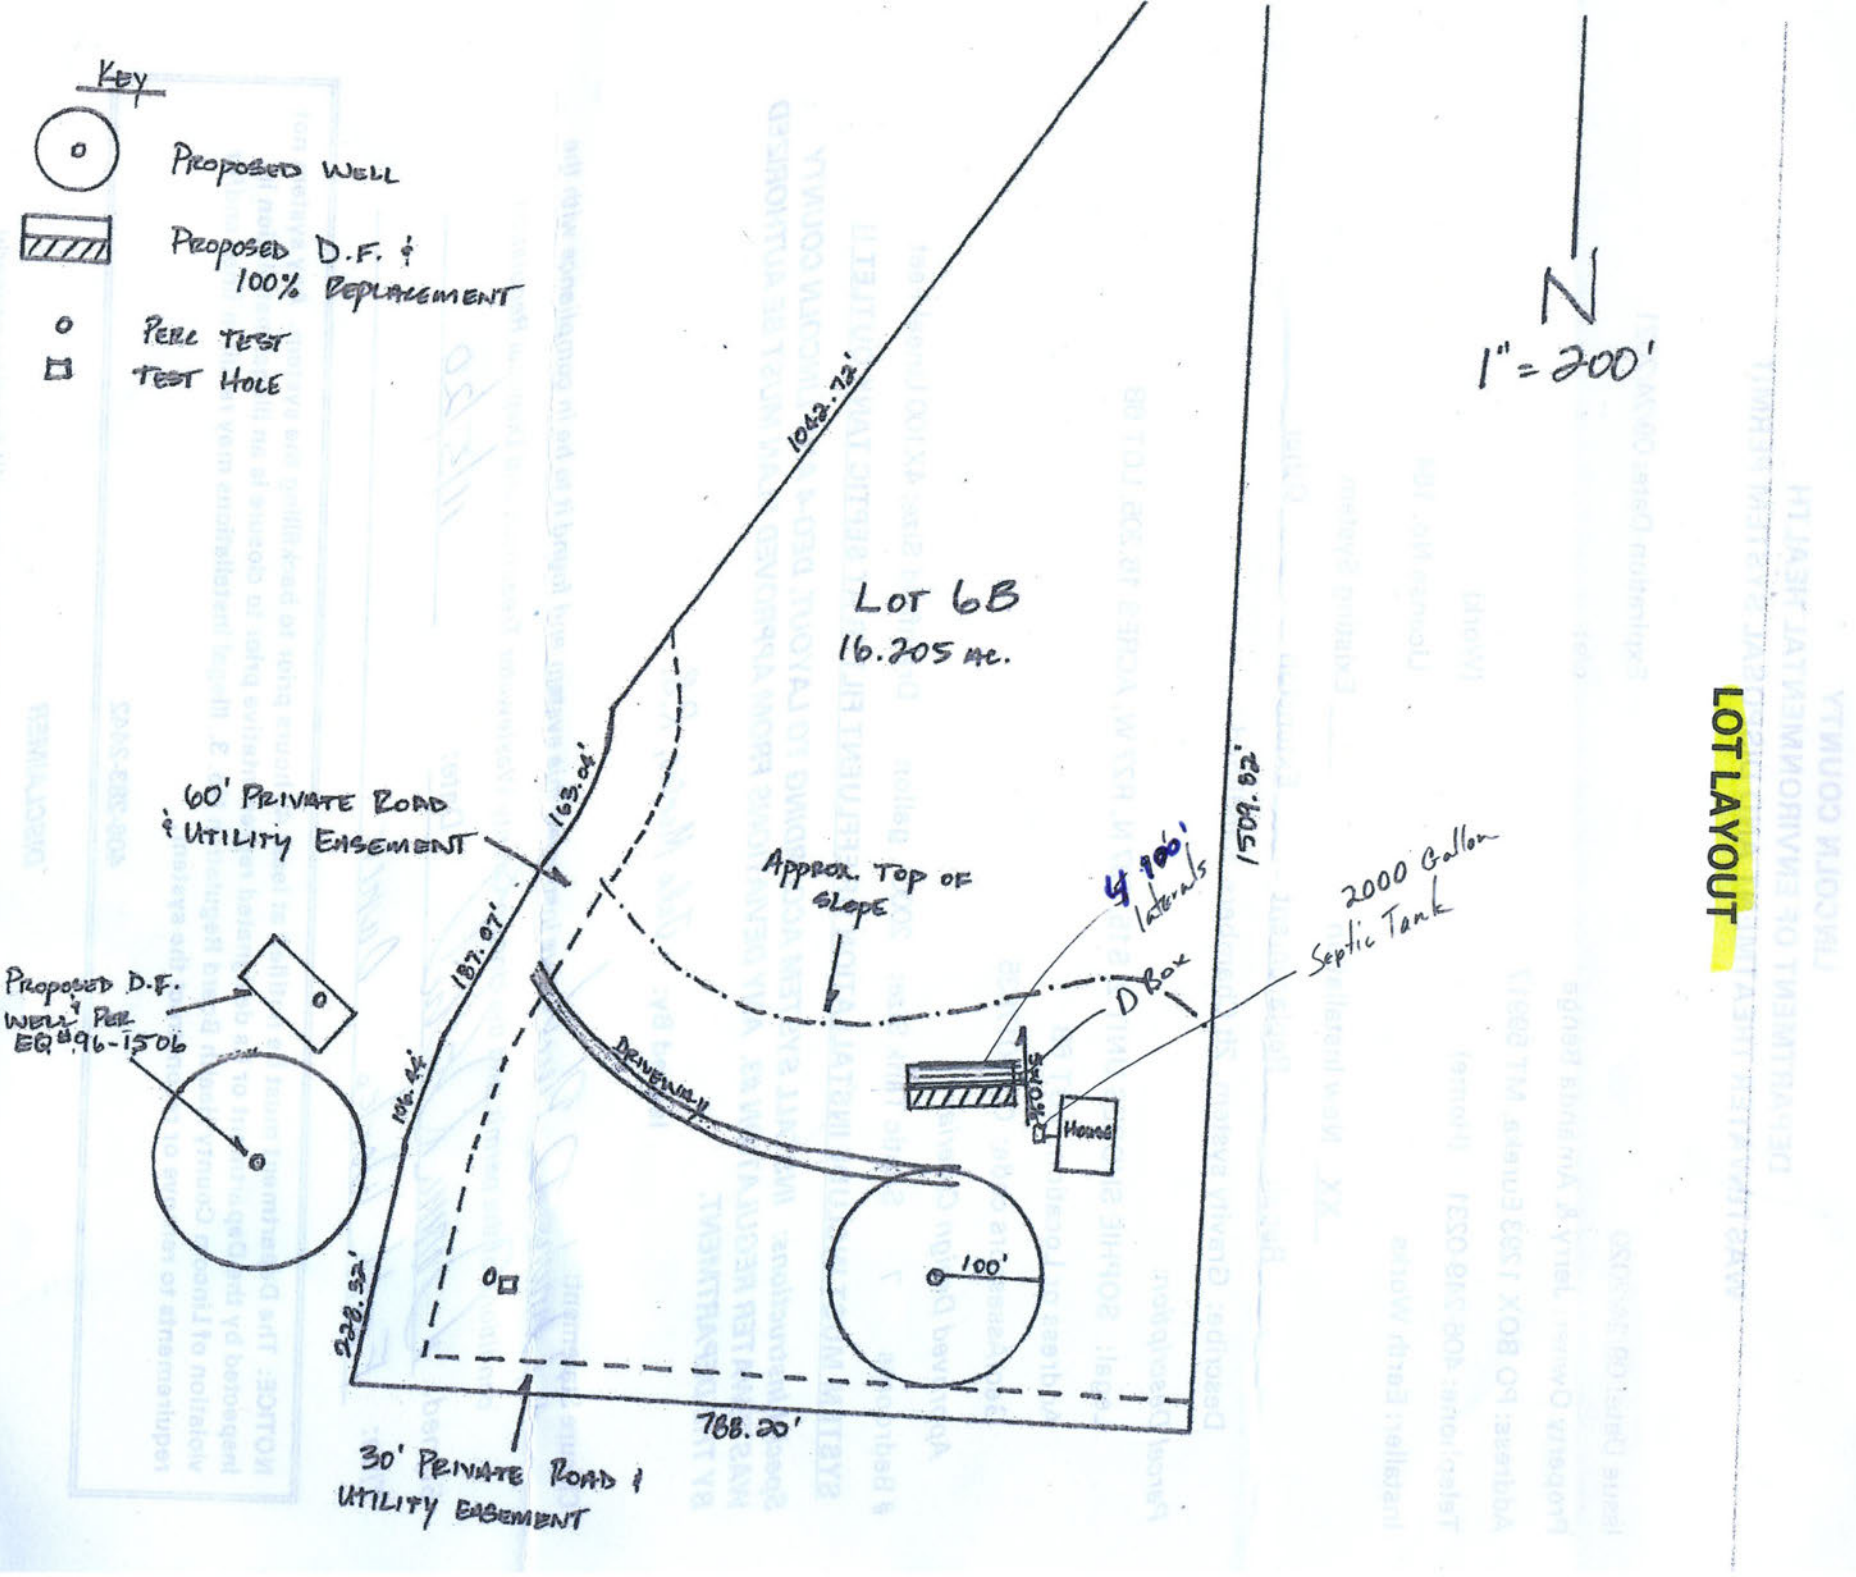
Title: Earth Works Owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Key
Proposed Well
Proposed D.F. & 100% Replacement
Perc Test
Test Hole
N
1" = 200'
LOT LAYOUT
Lot 6B
16.205 ac.
1042.72'
1509.92'
163.04'
187.07'
106.44'
228.52'
768.20'
60' Private Road & Utility Easement
30' Private Road & Utility Easement
Approx. Top of Slope
4 100' laterals
2000 Gallon Septic Tank
D Box
Driveway
House
Proposed D.F. Well per EQ #96-1506
100'