LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/13/2025 Expiration Date: 06/12/2026 Permit#25-55060

Property Owner: Brenda Berkhousen

Mailing Address: [redacted]

Installer: Doug Luchini License #: 183

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 2 Bedroom House.

Legal: MCGINNIS CREEK FLATS 3, S08, T26 N, R28 W, ACRES 13.72, LOT 3

Property Address: 262 McGinnis Creek Rd., Libby, MT 59923 Assessment Code: 55060

DEQ COSA: E.Q.# 08-1100 Date: 11/8/2007

Approved Design Criteria: Installation of new pressure dosed system for 2 Bedroom House with 4 Laterals @ 47'.

# of Bedrooms: 2 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 4 Length of Laterals: 47' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

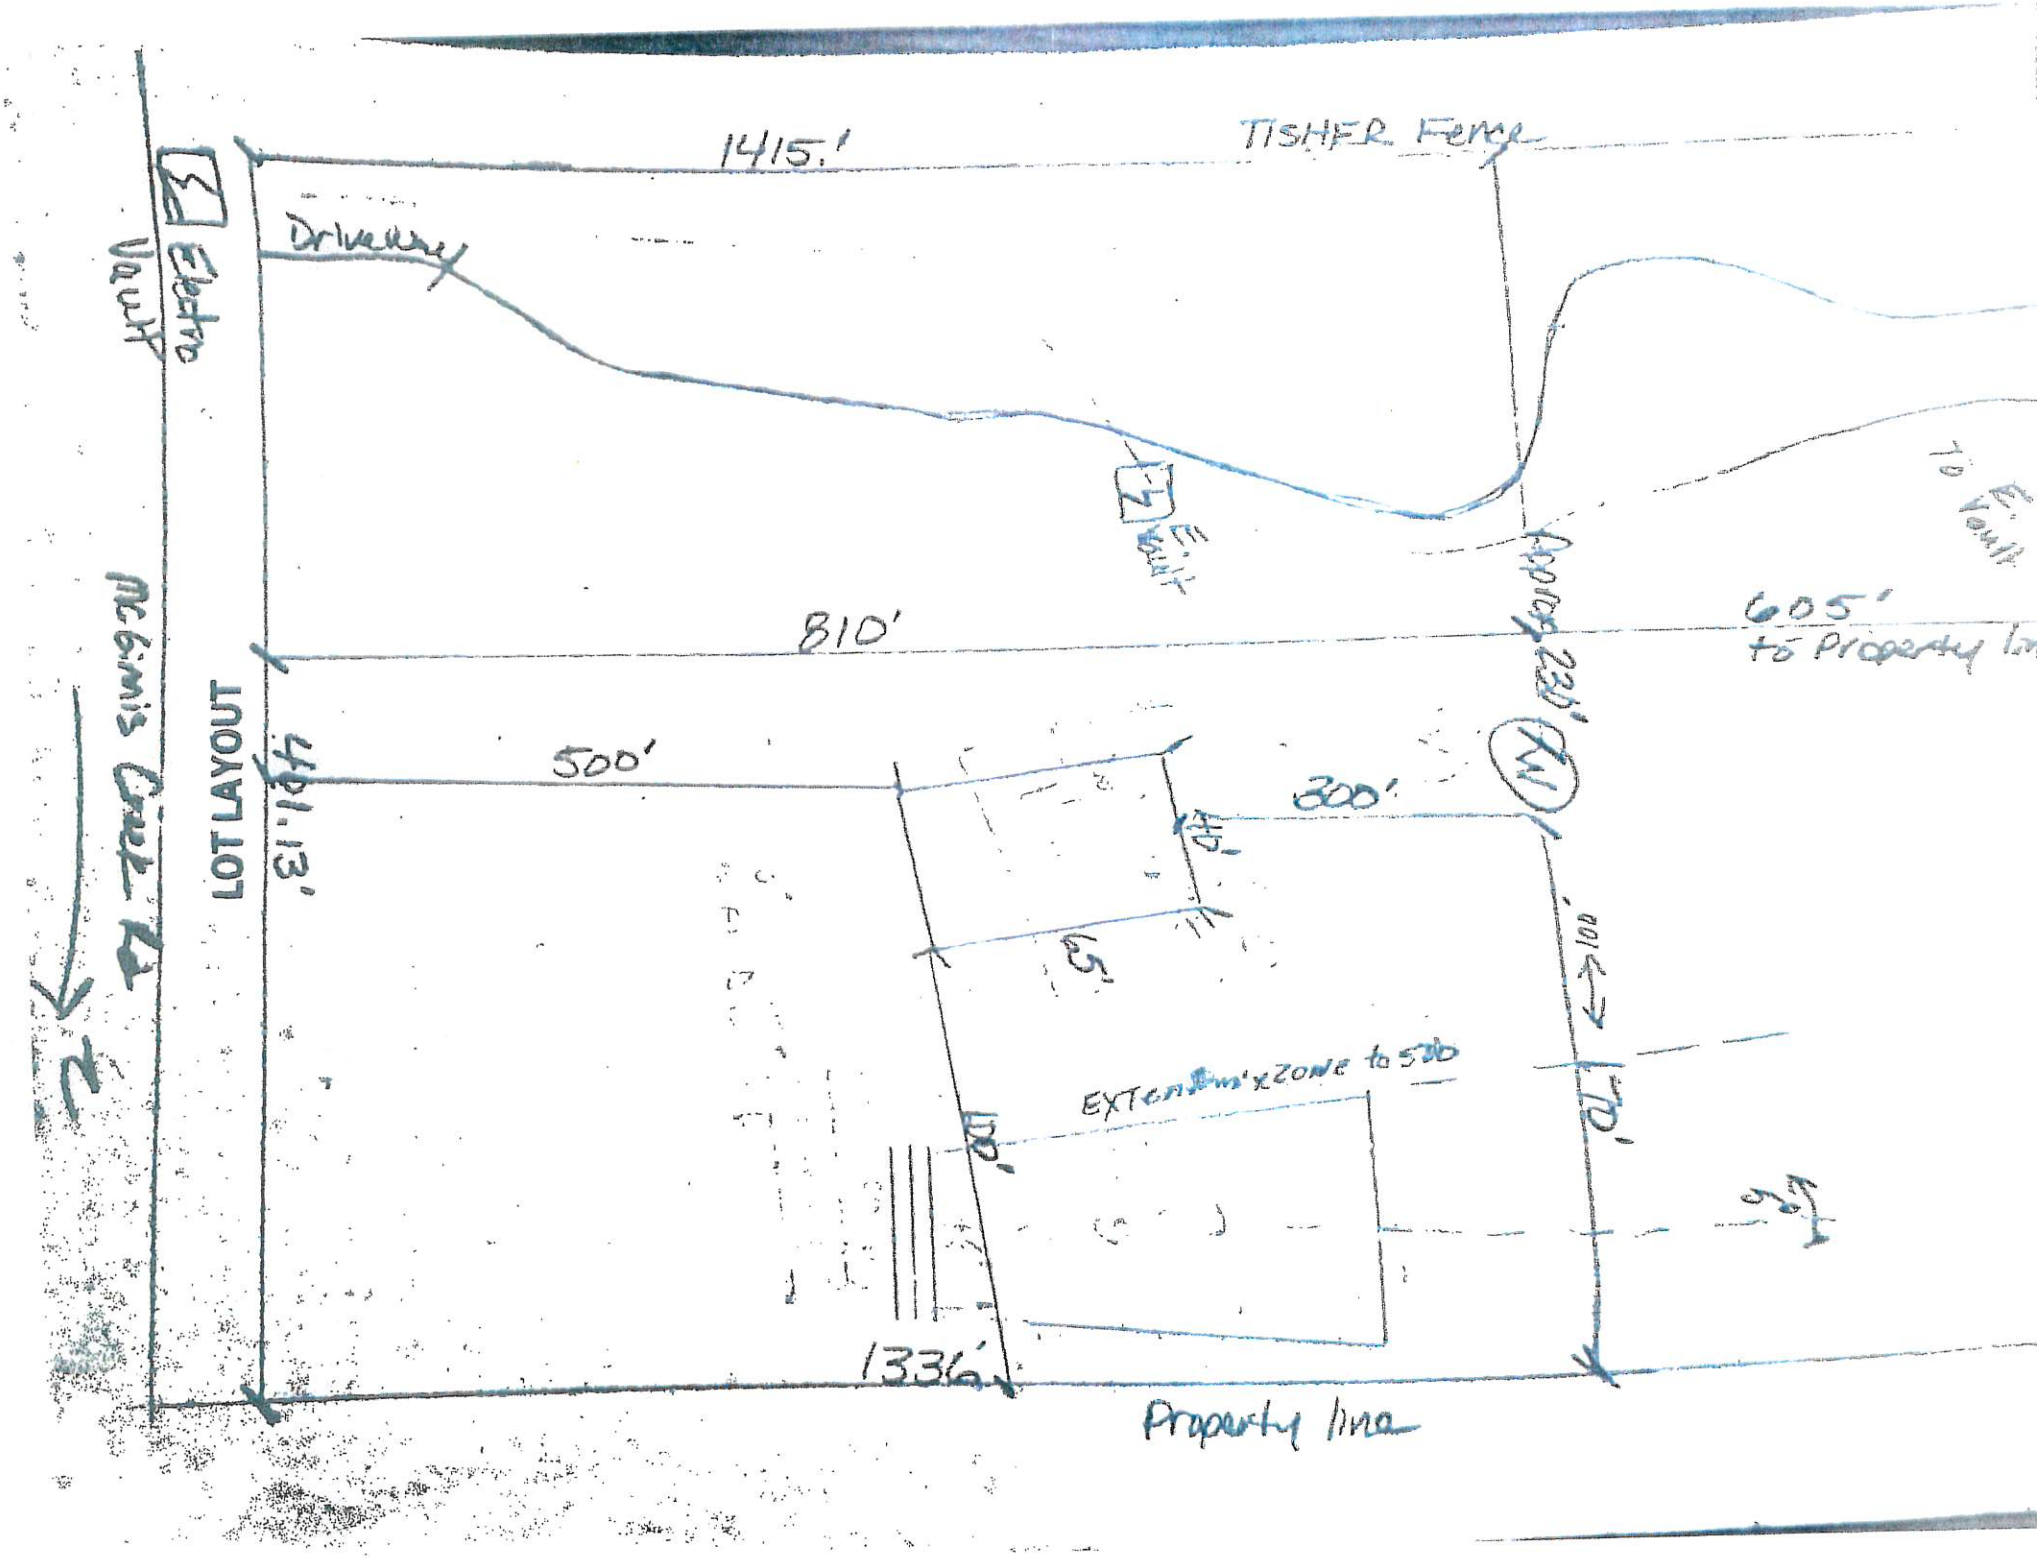
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/10/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


1415.'
TISHER Fence
Driveway
E. Light
810'
605'
to Property line
500'
300'
LOT LAYOUT
McGinnis Creek Rd
EXTension/rezone to 5B
1336'
Property line