LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit #25-55053

Issue Date: 02/12/2025 Expiration Date: 02/11/2026

Property Owner: Colby Brousseau

Mailing Address: [redacted]

Installer: Bryan Anderson License #: 175

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: MCGINNIS CREEK FLATS 2, S08, T26 N, R28 W, LOT 1, ACRES 6.36

Property Address: 3685 McGinnis Meadows Rd., Libby, MT 59923 Assessment Code: 55053

DEQ COSA: EQ#07-1740 Date: 06/15/2007

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 4 Laterals @ 85' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 85' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg *Date:* 7/22/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

RU LOT #1

LINCOLN COUNTY, MONTANA
LOT LAYOUT
MCGINNIS CREEK FLATS II
IN SECTION 8, TWP. 26 N., R. 28 W., P.M.M.

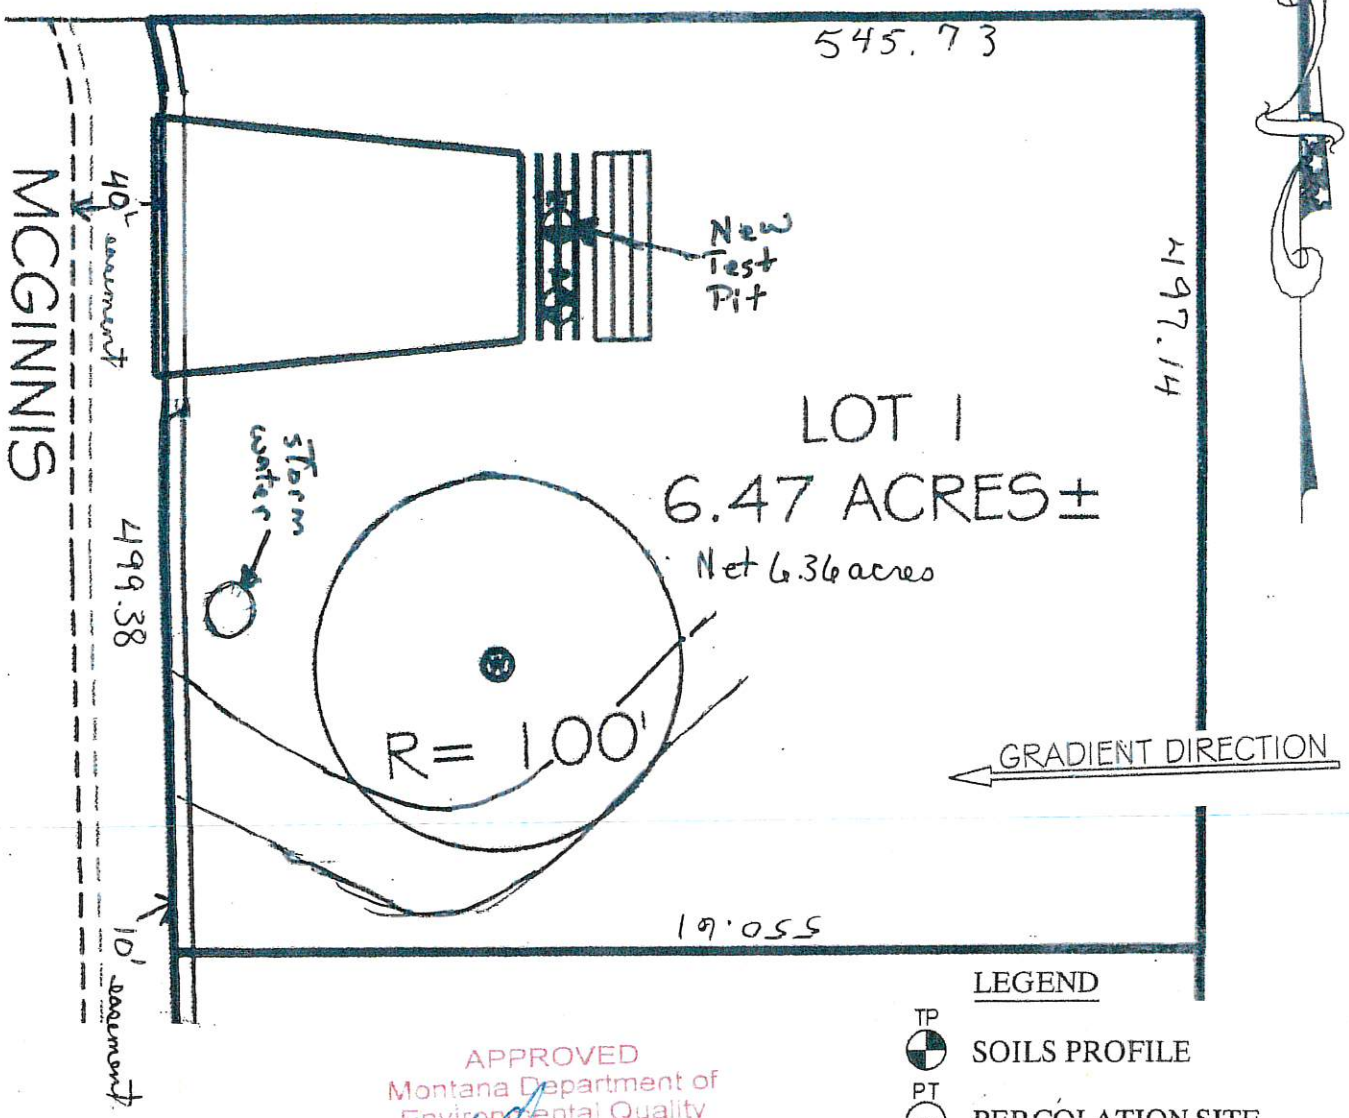


APPROVED
Montana Department of
Environmental Quality
Reviewer Date 1/28/2025

EQ# 07-1740

LEGEND

- TP — SOILS PROFILE
- PT — PERCOLATION SITE
- W — PROPOSED WELL SITE
- STORMWATER POND 20'x 30'x 2'
- SLOPE
- GRADIENT DIRECTION
- PROPOSED SEPTIC SITE 4-100' TRENCHES 10' APART
- REPLACEMENT SITE 4-100' TRENCHES 10' APART
- 200' MIXING ZONE

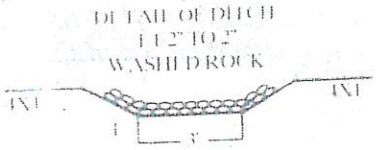

ALONG THE UPPER DITCH LINES OF APPROACH ROADS