LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/07/2020 Expiration Date: 08/07/2021

Property Owner: Paul & Jennifer Brown c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Brian Anderson License No.

__XX__ New Installation _____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 75' Legs off of septic using chambers.

Parcel Description:

Legal: S33, T30 N, R31 W, ACRES 100, E2NE & N2NESE

Address or Location: 580 PROSPECT CREEK RD LIBBY, MT 59923

Geo/Assessors code: 0000003100

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1500 gallons Drainfield Size: 225 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

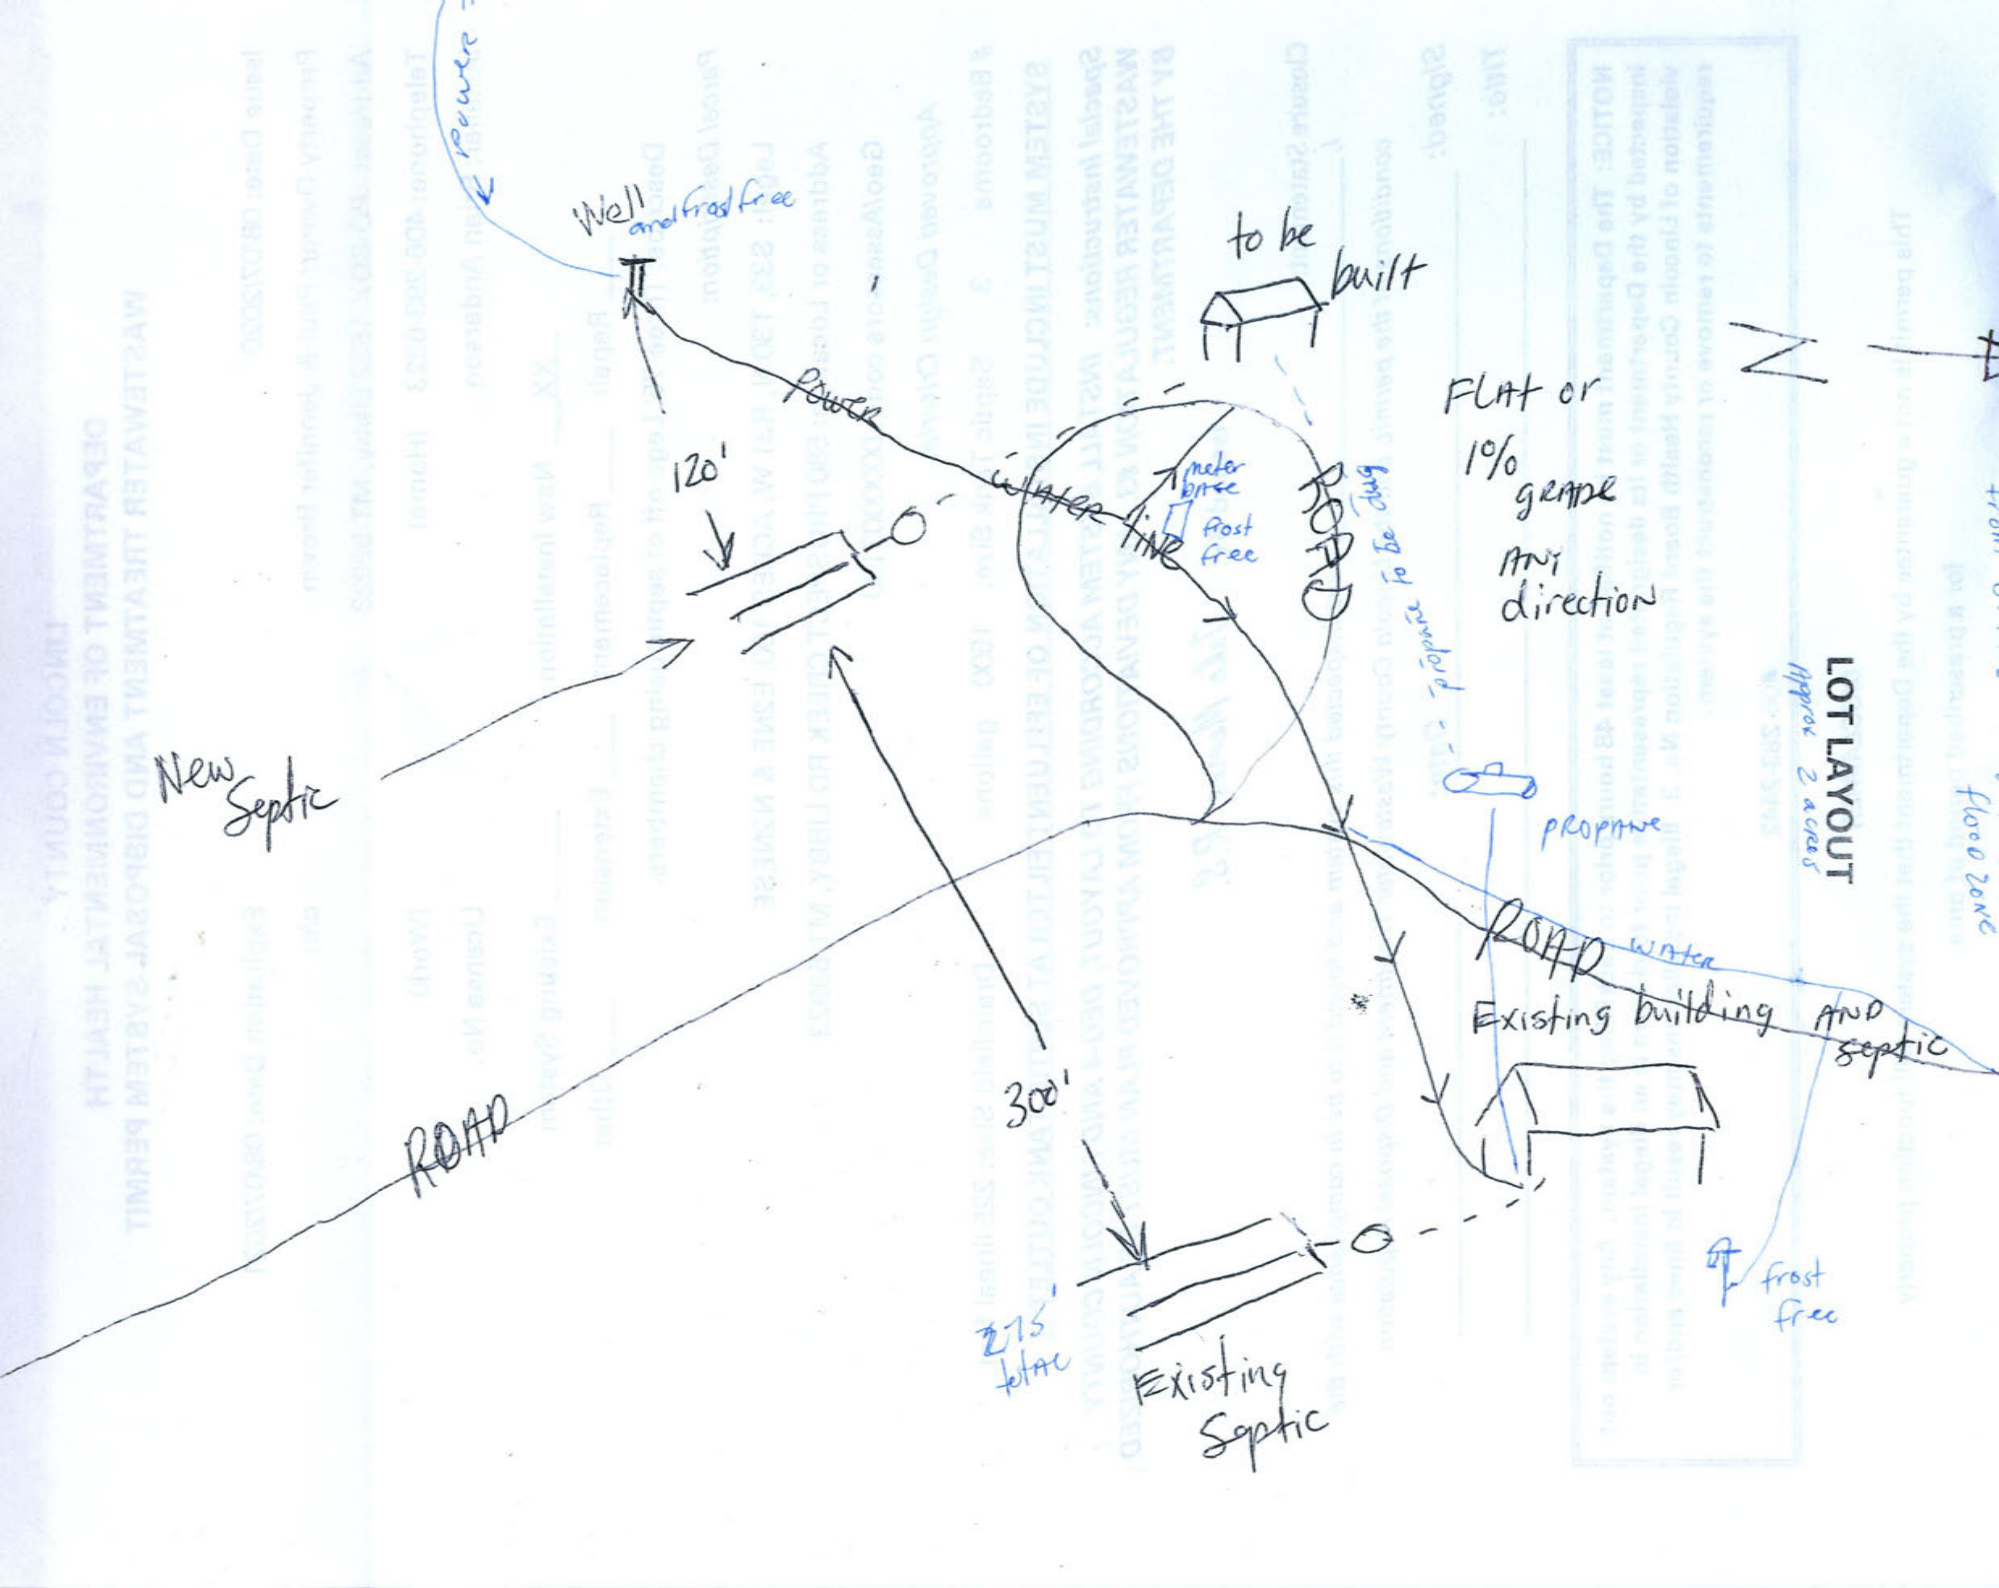
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly


Well and frost free
to be built
power
120'
water line
meter brace
frost free
ROAD
Gang to be moved
FLAT or 1% grade ANY direction
LOT LAYOUT
Approx 2 acres
flood zone
New Septic
propane
ROAD
water
Existing building AND septic
300'
ROAD
frost free
275' total
Existing Septic