LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/22/2020 Expiration Date: 09/22/2021

Property Owner: Richard Butts c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work) [redacted]

Installer: Larson Landscaping License No. 66

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Gravity System

Parcel Description:

Legal: S30, T37 N, R26 W, SENE 40.00 ACRES

Address or Location: 4744 Indian Creek Rd Eureka, MT 59917

Geo/Assessors code: 0000011518

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: (5)-75' Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Glenn Larson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Glenn Larson *Date:* 11-30-2020

Title: Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

DETAIL



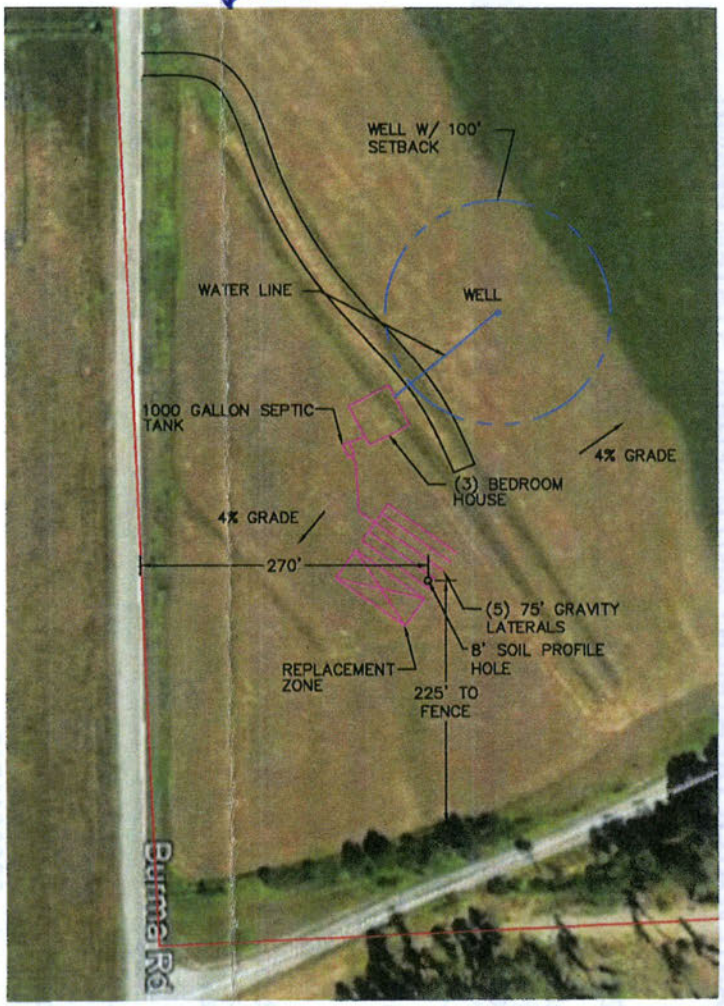

RICH BUTTS SITE LAYOUT

REV	DATE	COMPANY	SCALE	LARSON LANDSCAPING BUTTS SEPTIC
		MDS	1/16 = 1'-0"	SITE LAYOUT
		CONTRACT	DRAWN	7/28/20
		VERBAL	T/MBH	7/28/20
		PLOT FILE	WEIGHT	1
		PML-0001		215-001

THIS DRAWING IS PROPERTY OF MDS CIVIL ENGINEERING AND SURVEYING, INCORPORATED. IT IS NOT TO BE REPRODUCED IN ANY FORM WITHOUT WRITTEN APPROVAL FROM MDS ENGINEERING