LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/04/2021

Expiration Date: 02/04/2022

Property Owner: Brian & Robin Cahill

c/o: Jason Williams

Address: [redacted]

Telephone: [redacted] (Home)

(Work)

Installer: Dennis Riedlinger

License No. 23

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 85' laterals using chambers.

Parcel Description:

Legal: PHELPS HOMESTEAD, S32, T31 N, R33 W, ACRES 24.07, LOT 2 *10348*

Address or Location: 2628 LAKE CREEK RD LAKE TROY MT 59935

Geo/Assessors code: 0000010348

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 255 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Jake Mertes, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

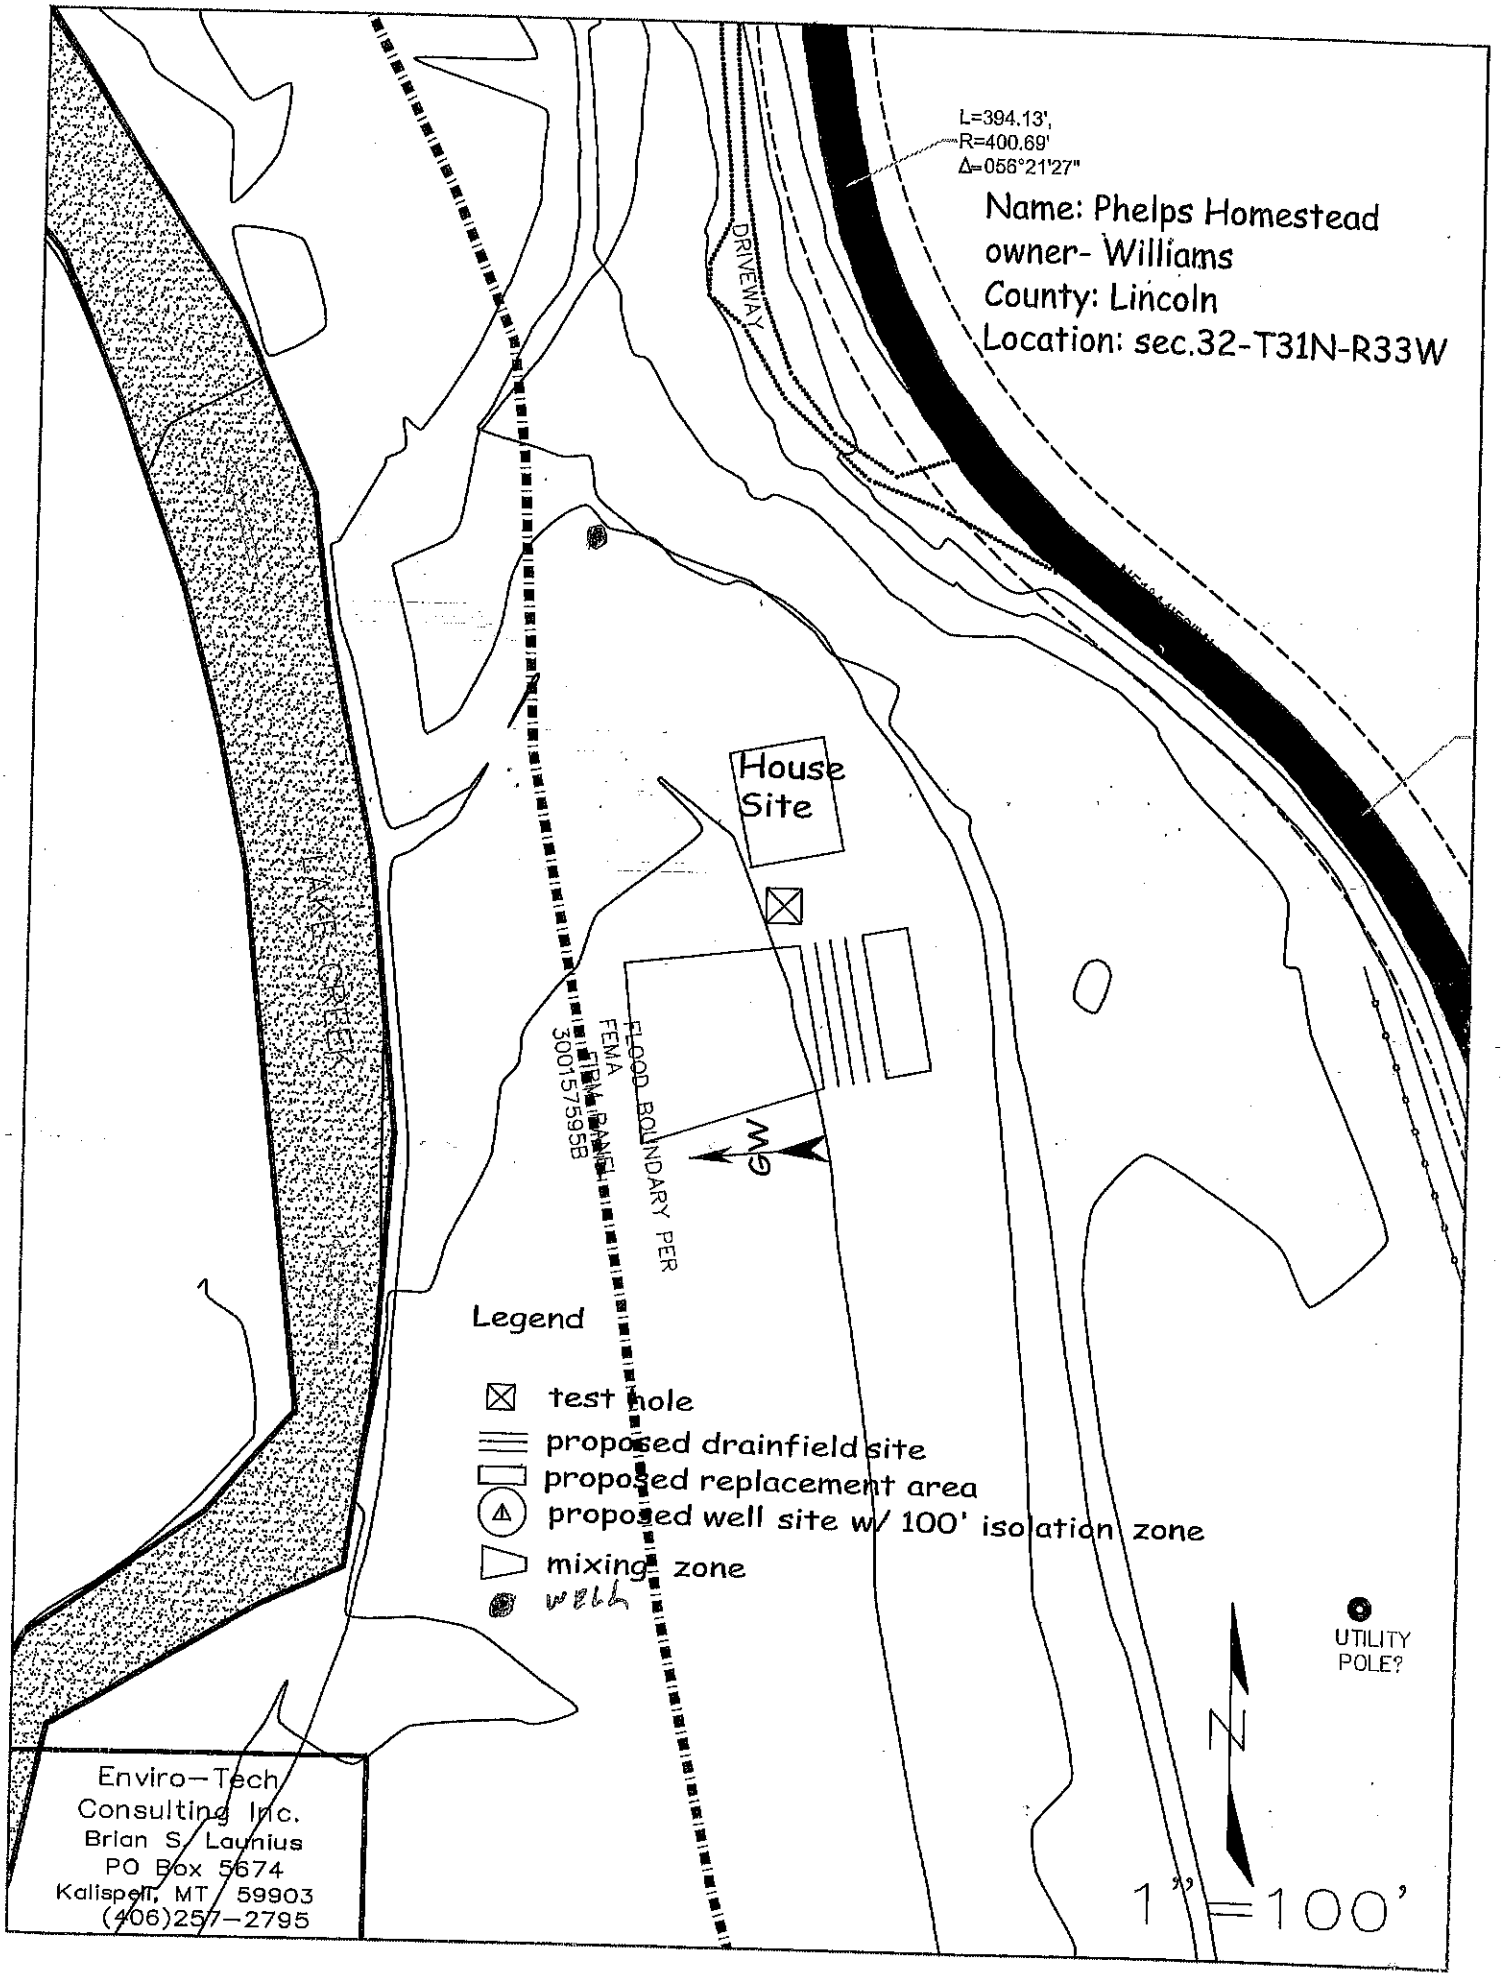
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


L=394.13',
R=400.69'
Δ=058°21'27"
Name: Phelps Homestead
owner- Williams
County: Lincoln
Location: sec.32-T31N-R33W
DRIVEWAY
House Site
FLOOD BOUNDARY PER FEMA FIRM PANEL 30015759 5B
Legend
test hole
proposed drainfield site
proposed replacement area
proposed well site w/ 100' isolation zone
mixing zone
well
UTILITY POLE?
N
1"=100'
Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795