LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/06/2020 Expiration Date: 10/06/2021

Property Owner: William Edwards c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Sawtooth Excavating LLC License No. 812344210

XX New Installation ____ Existing System

__Repair ____ Replacement ____ Extension ____ Other

Describe: Two 76' Laterals using chambers.

Parcel Description:

Legal: S13, T31 N, R34 W, C.O.S. 4223, PARCEL B in NWNW, ACRES 23

Address or Location: 358 Manier Rd Troy, MT 59935

Geo/Assessors code: 0000018044

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 152 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Logan Mertes *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 10/26/20

Title: Sawtooth Excavating

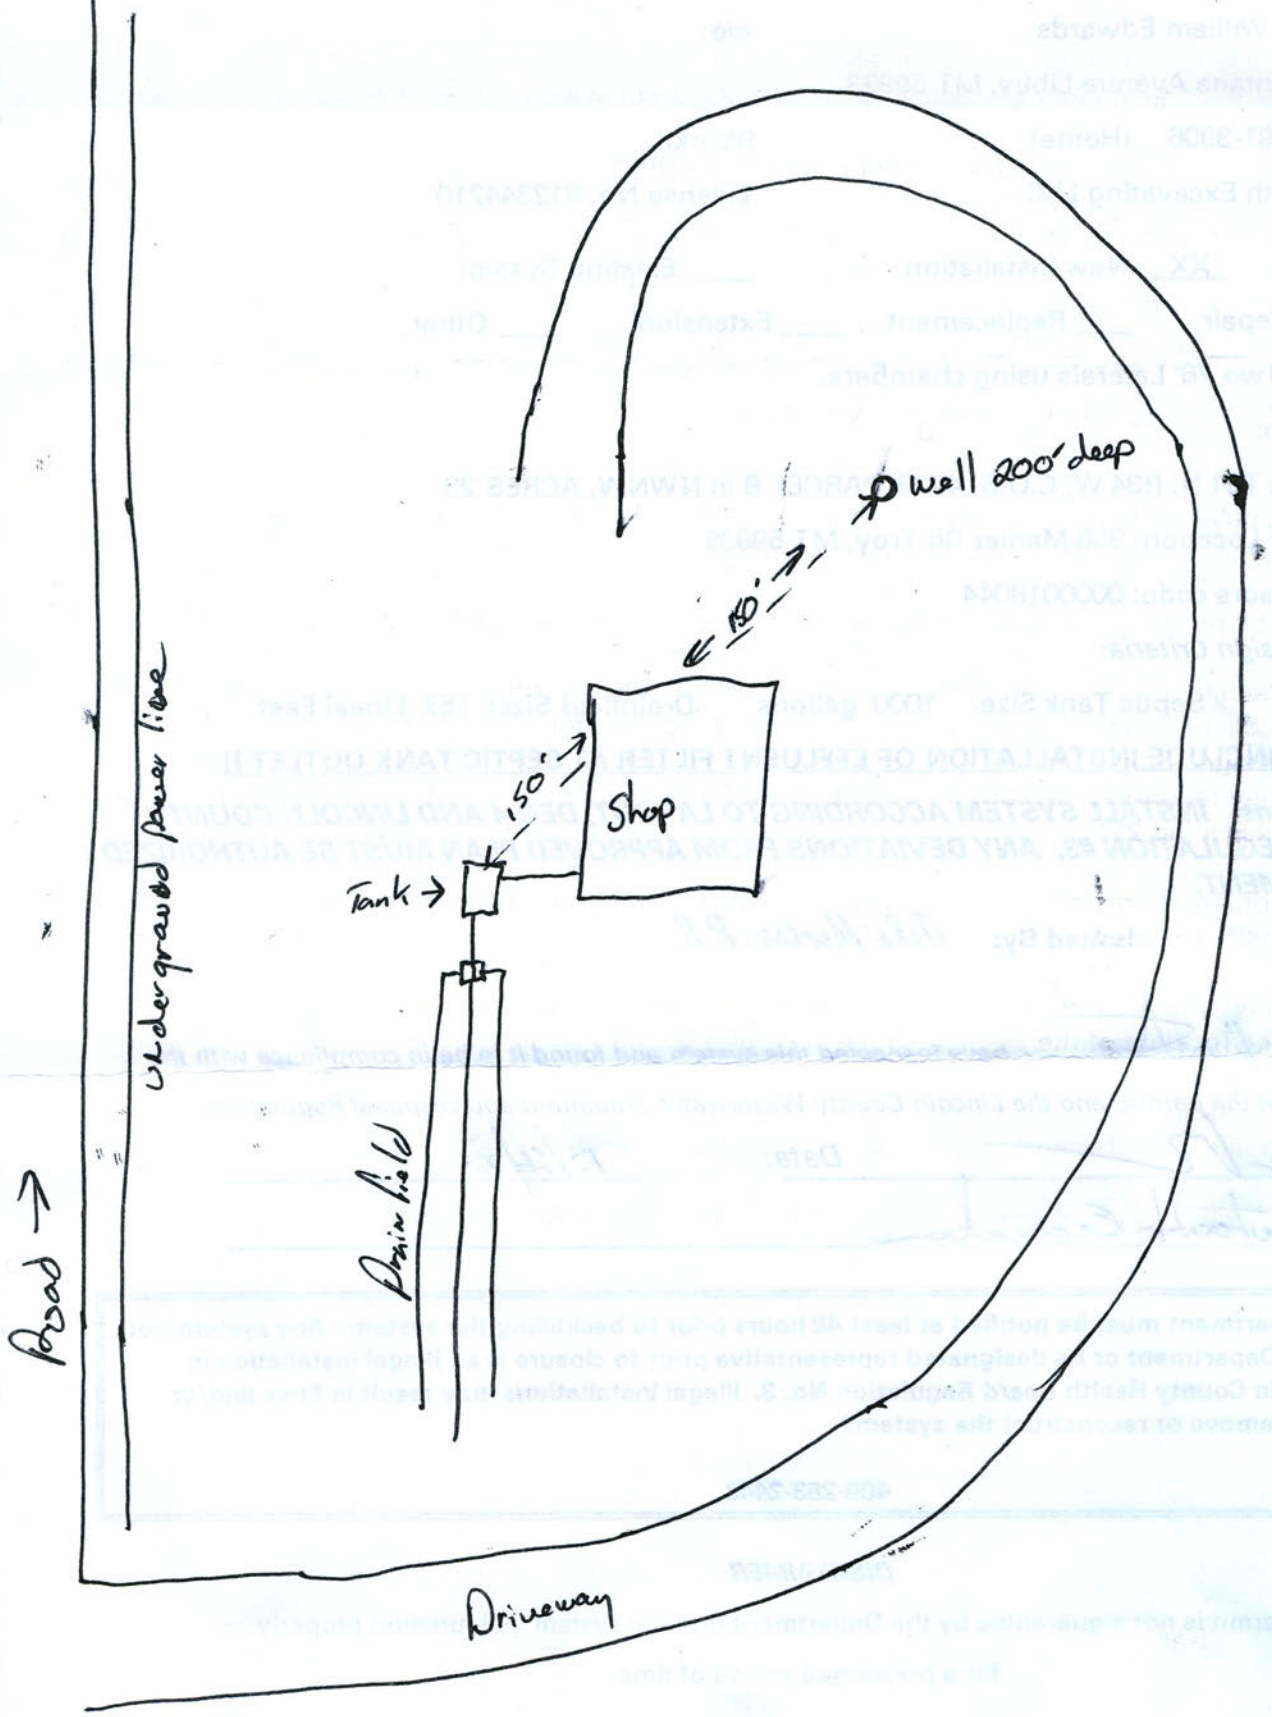
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


well 200' deep
150'
150'
Shop
Tank
Drain field
Underground power line
Road
Driveway