LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/01/2020 Expiration Date: 10/01/2021

Property Owner: Todd & Cindy Featherly c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Todd Featherly (Inspected by MDS) License No.

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 100' Pressure Dosed Laterals using 3' wide chambers.

Parcel Description:

Legal: MOUNTAIN FOOTHILLS ESTS PH 1, S07, T36 N, R26 W, ACRES 5, LOT 4 PM 6966

Address or Location: 422 Norris Loop Eureka, MT 59917 LOT 4

Geo/Assessors code: 0000055597

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 5-100' Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 11/6/20

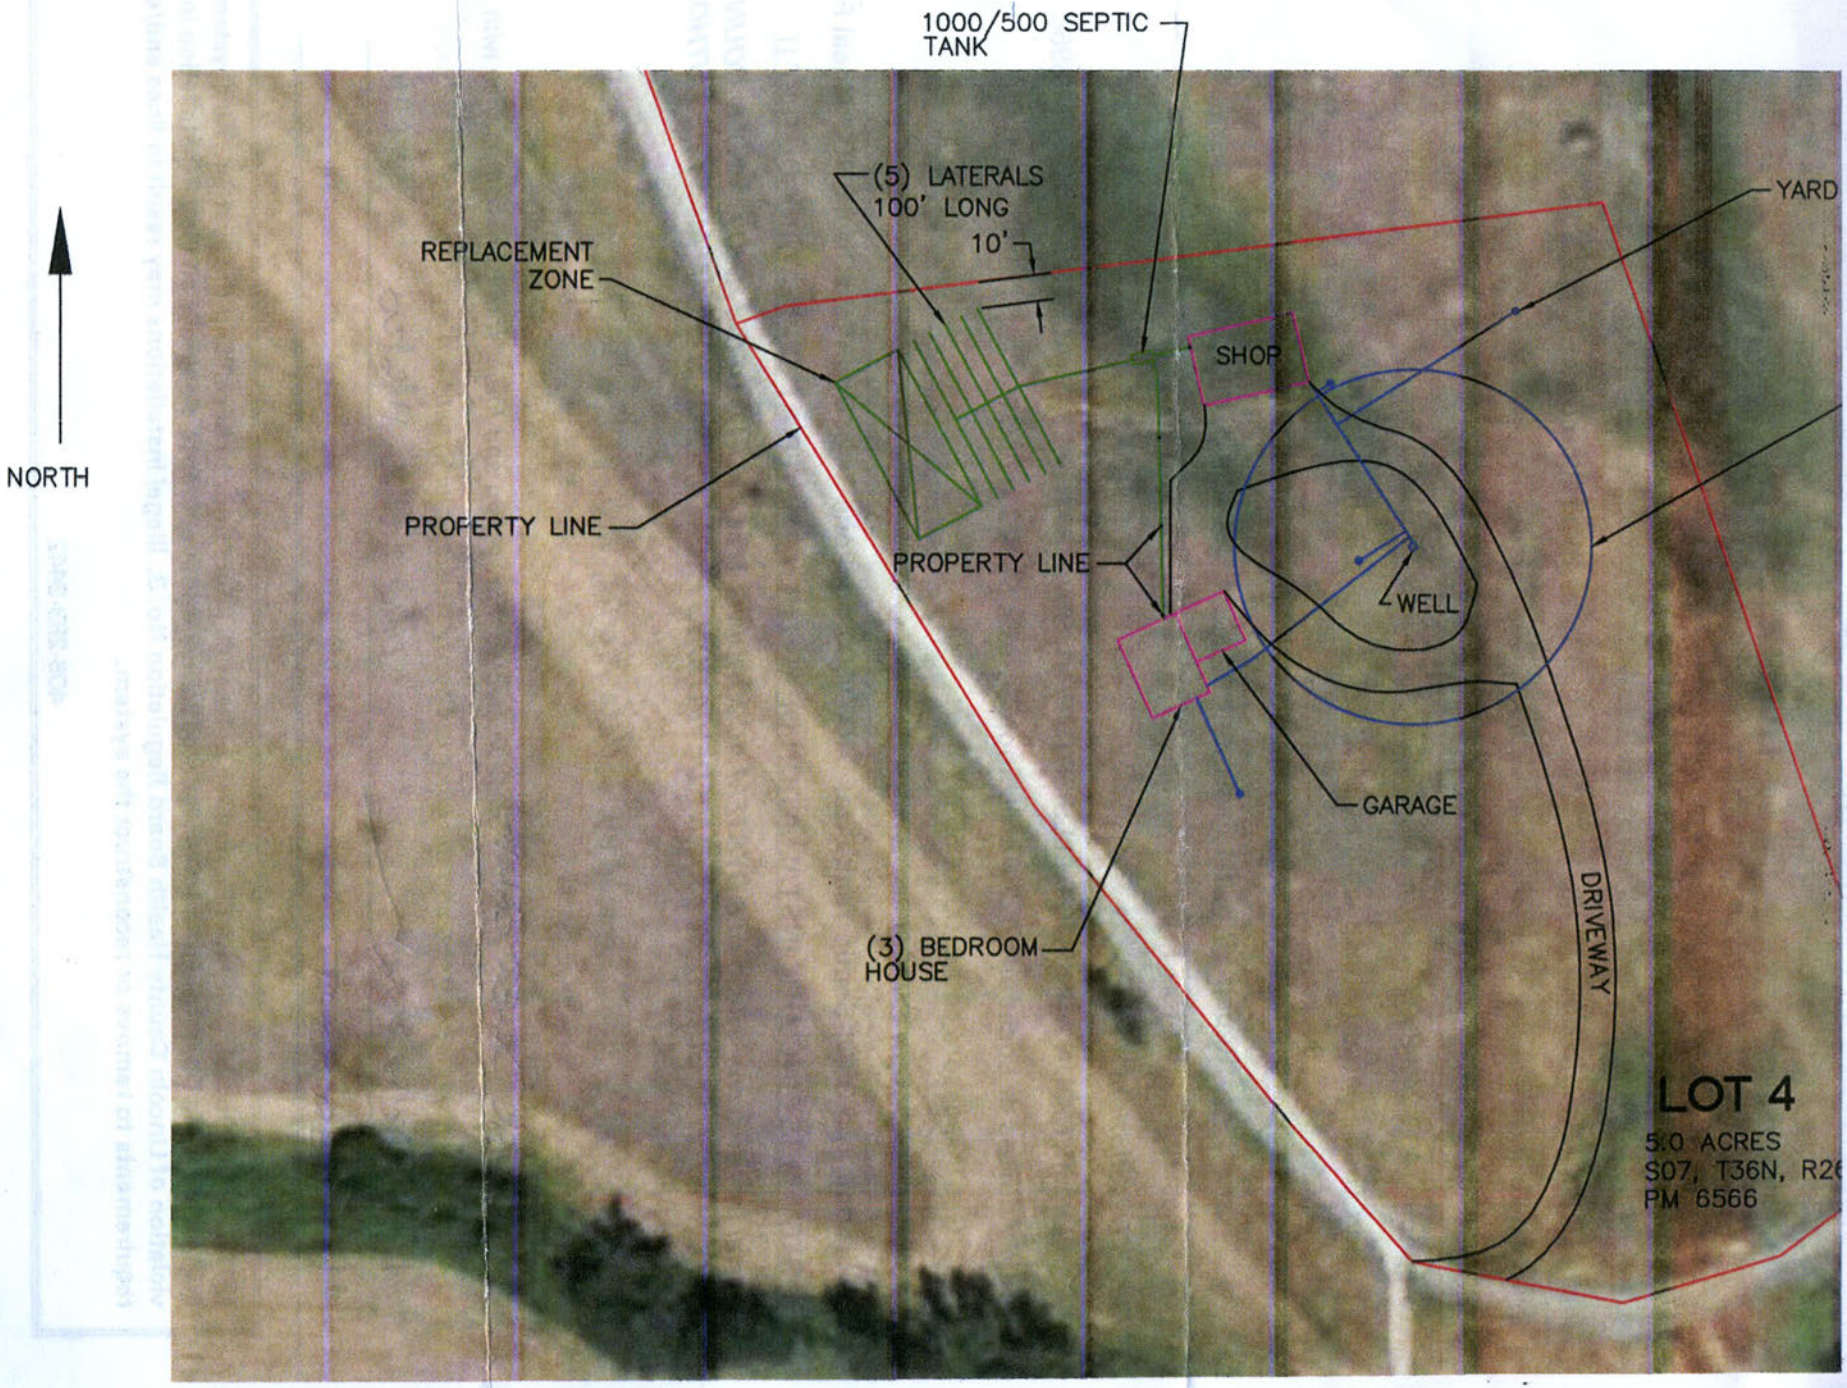
Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly


1000/500 SEPTIC TANK
(5) LATERALS 100' LONG
10'
REPLACEMENT ZONE
YARD
SHOP
NORTH
PROPERTY LINE
PROPERTY LINE
WELL
GARAGE
DRIVEWAY
(3) BEDROOM HOUSE
LOT 4
5.0 ACRES
S07, T36N, R2
PM 6566