LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/10/2020 Expiration Date: 11/10/2021

Property Owner: Tom Fraley c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work) [redacted]

Installer: Charles Follensbee License No. 96

__XX__ New Installation ____ Existing System

___ Repair ___ Replacement ____ Extension ____ Other

Describe: Three 84' Laterals using gravelless chambers.

Parcel Description:

Legal: S17, T37 N, R26 W, ACRES 20, N2SESW or TR 2A

Address or Location: Pluid Rd Eureka, MT 59917

Geo/Assessors code: 0000016839

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 252 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement: Charley Follensbee, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Charley Follensbee *Date:* 10/10/20

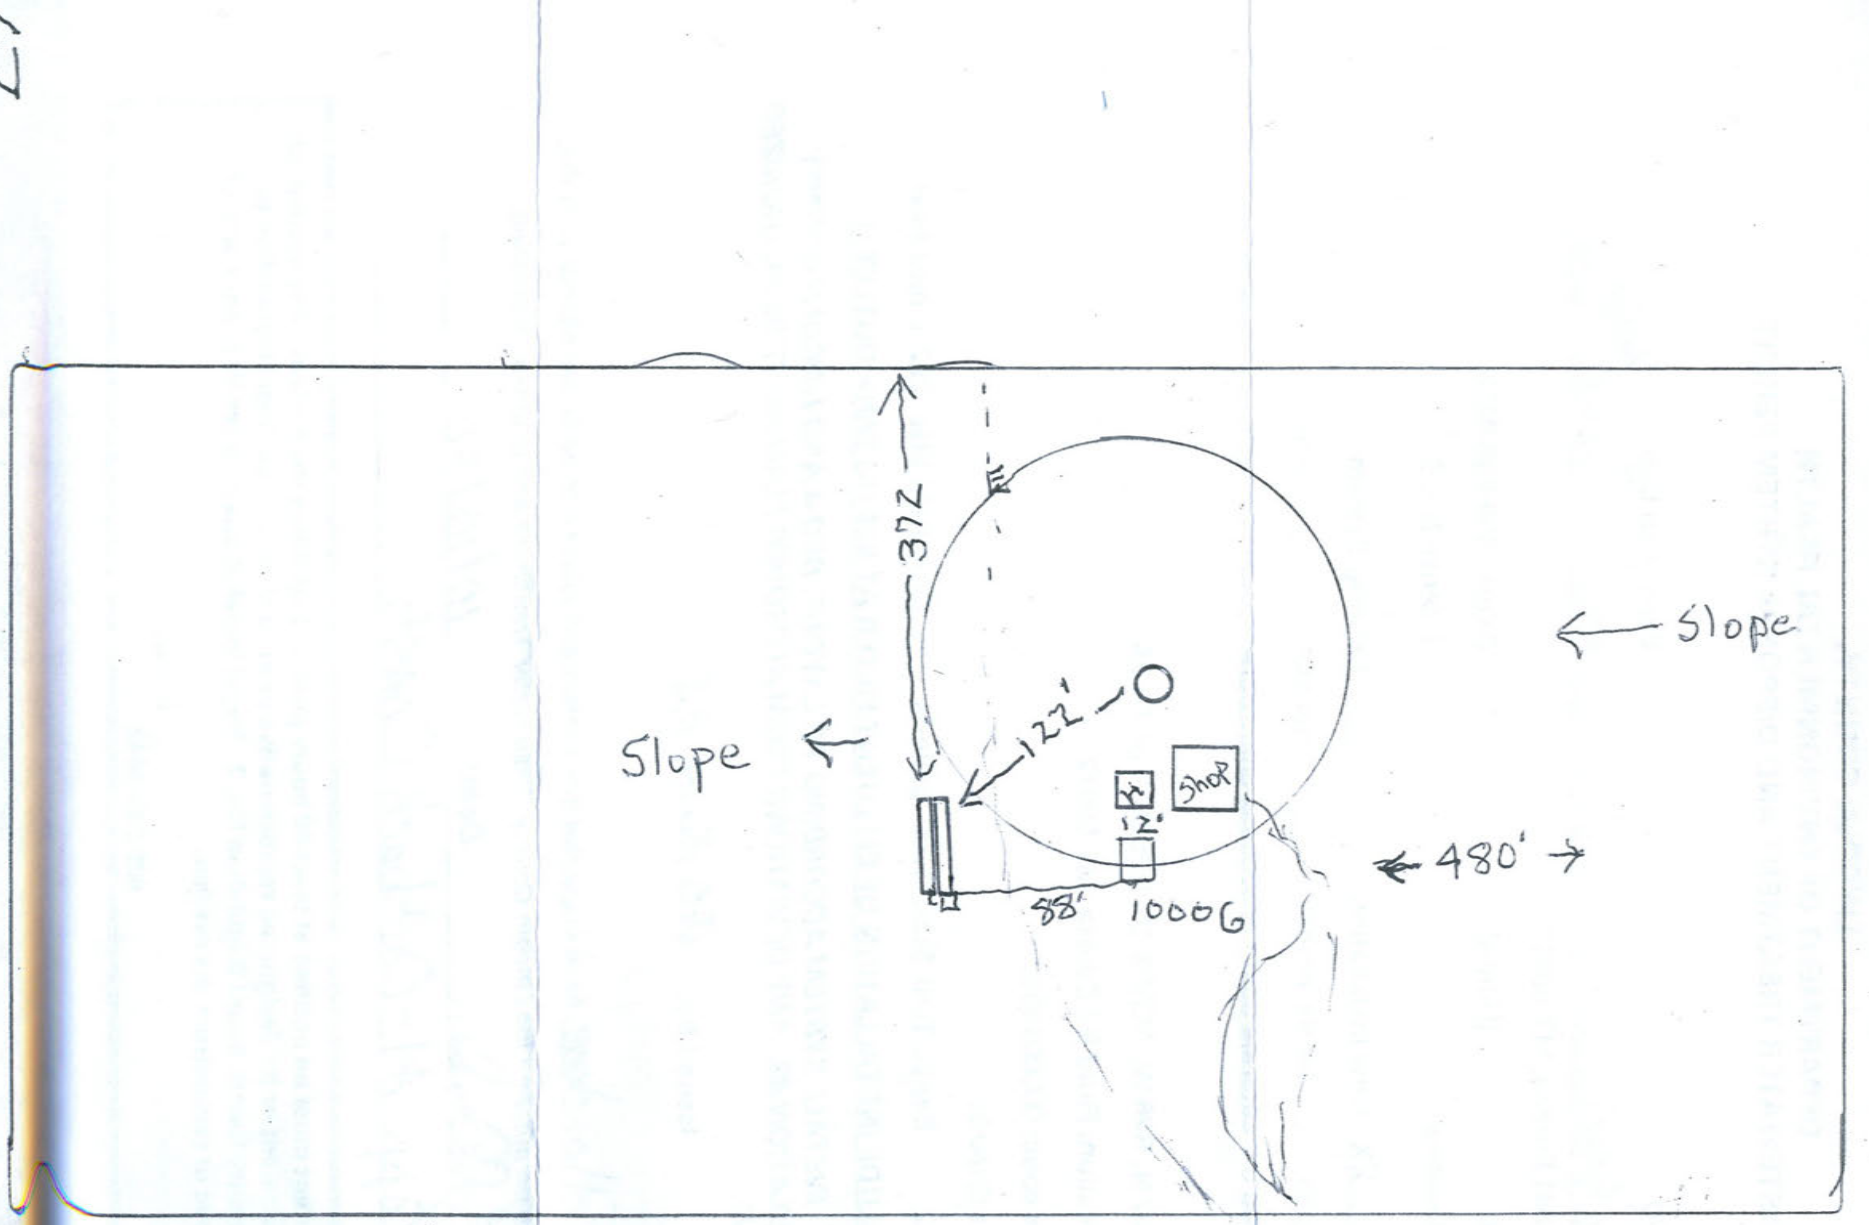
Title: Owner/Opp AI-Outback Const.

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
372'
122'
Slope
Slope
480'
Shop
12'
88'
10006