LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/22/2020 Expiration Date: 10/22/2021

Property Owner: Brian Gorman c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Kootenai Sand & Gravel Inc. License No. 109

__XX__ New Installation __XX__ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 88' pressure dosed laterals in 3' wide trenches using drain rock.

Parcel Description:

Legal: S17, T34 N, R25 W, ACRES 99.83, TR 1G IN N2SW & SWNW & TR 5A IN SENW

Address or Location: 191 Ant Flat Rd Trego, MT 59934

Geo/Assessors code: 0000012223

Approved Design Criteria:

Bedrooms: 3 (Garage-2) Septic Tank Size: 2000/500 gallons Drainfield Size: 437.5 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

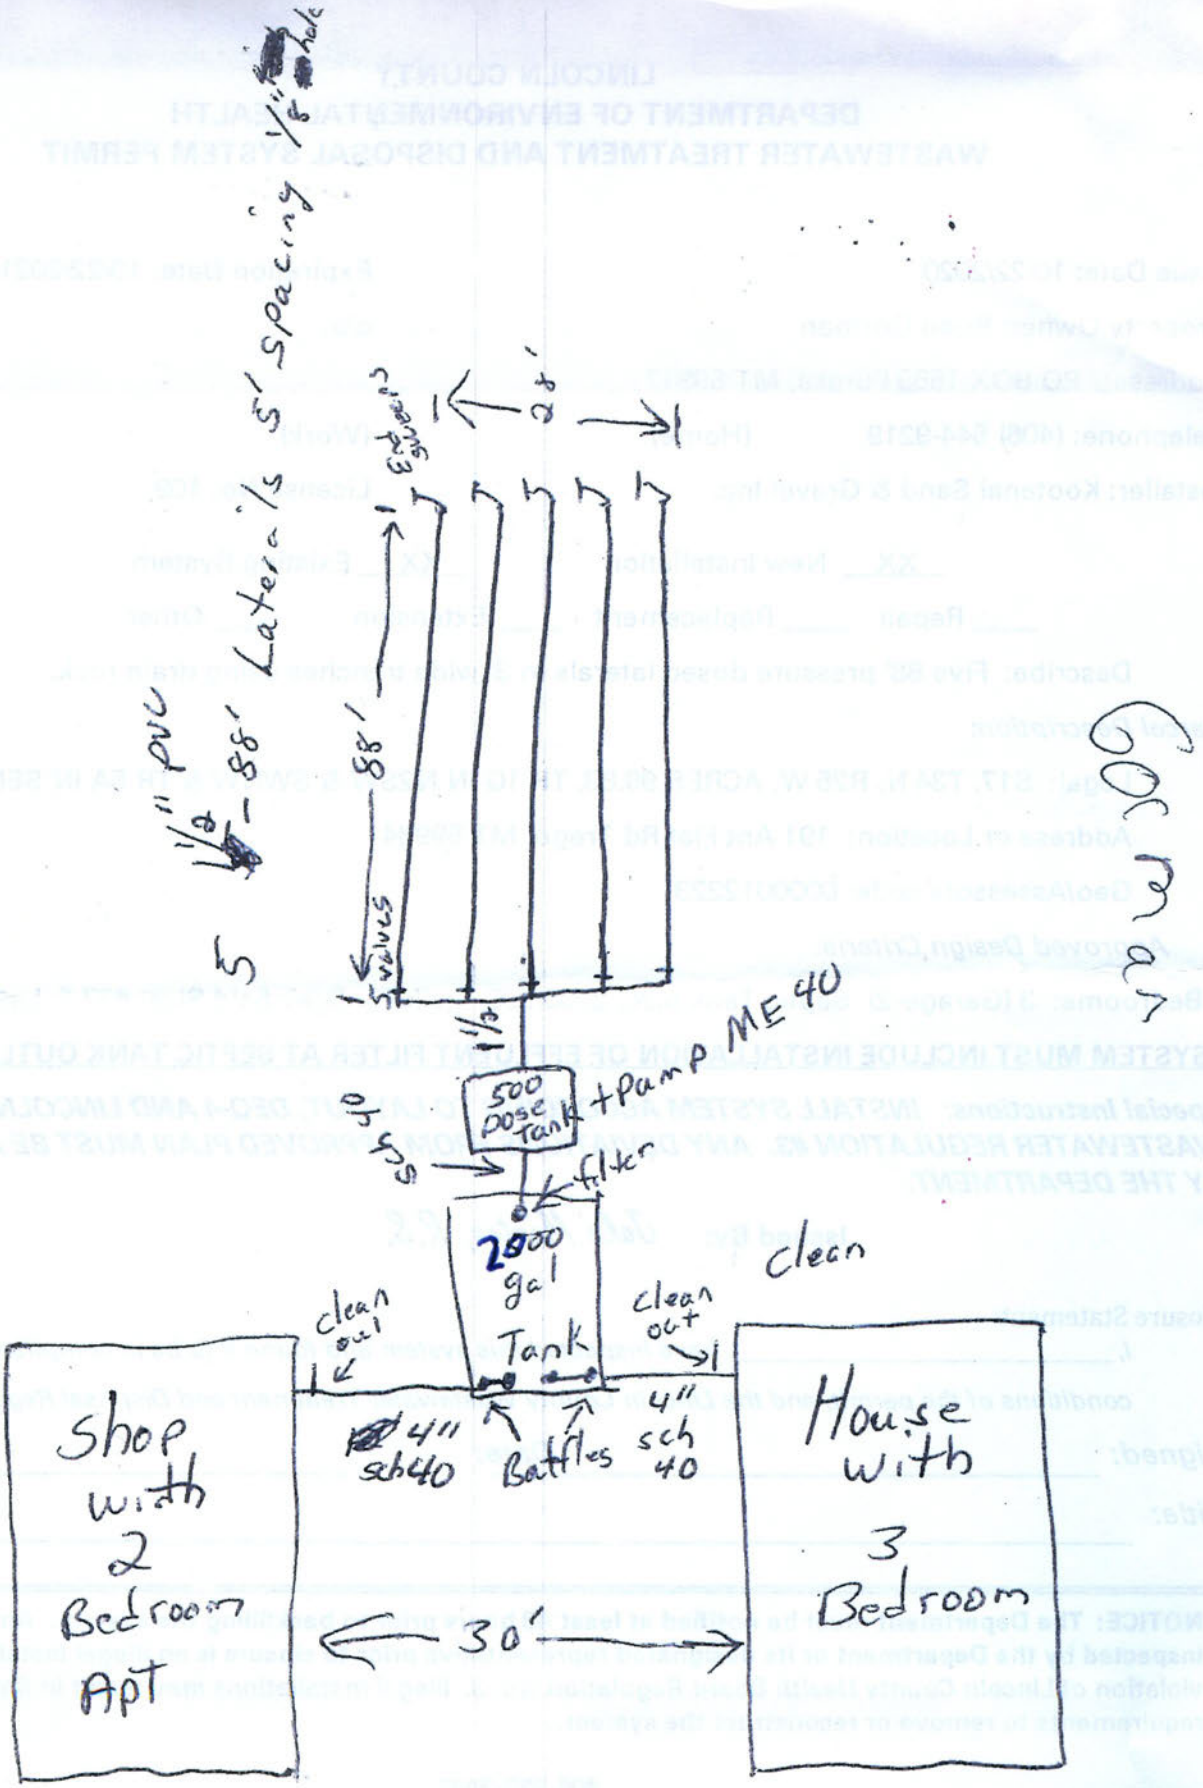
Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


1/8" Hole
5 1/8" pvc - 88' Laterals 5' spacing
End guard
2'
88'
5 valves
1 1/2"
500 Dose Tank
+Pump ME 40
sch 40
filter
2000 gal Tank
clean out
clean out
clean
Shop with 2 Bedroom Apt
4" sch40
Baffles
4" sch 40
House with 3 Bedroom
30'
60 mil