LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/25/2021 Expiration Date: 02/25/2022

Property Owner: Josh & Tara Letcher c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Gideon Yutzy License No. 113

___ New Installation ___ Existing System

___ Repair __XX__ Replacement ___ Extension ___ Other

Describe: Three 44' laterals using infiltrators.

Parcel Description:

Legal: S26, T37 N, R28 W, C.O.S. 4375, ACRES 2.41, TRACT 2 in N2NE

Address or Location: 3987 West Kootenai Rd Rexford, MT

Geo/Assessors code: 0000005394

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000 gallons Drainfield Size: 128 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Gideon Yutzy *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Gideon Yutzy *Date:* 4-15-2021

Title: Licensed Installer # 113

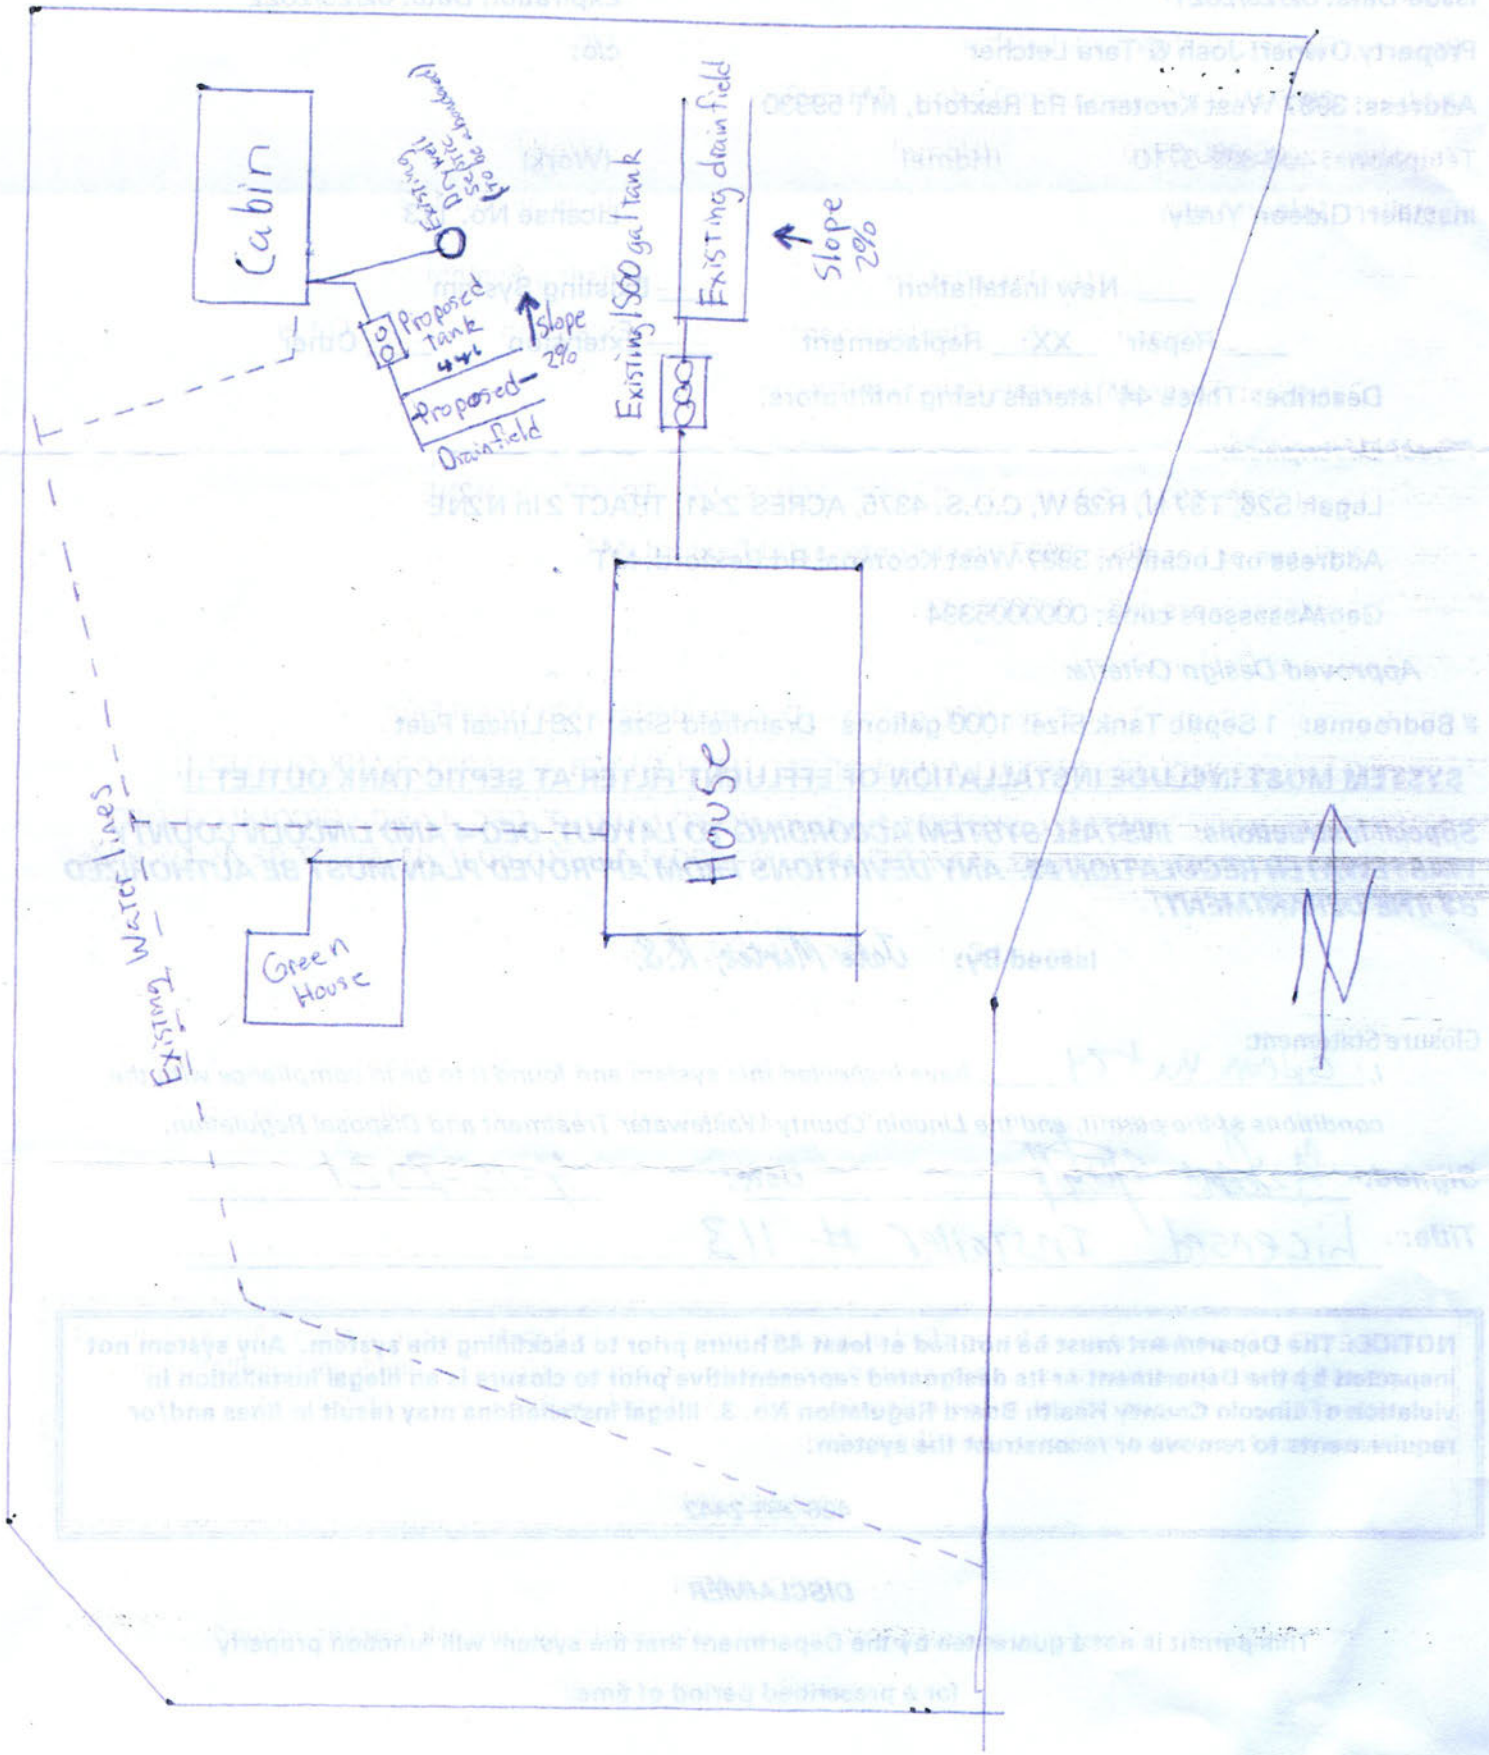
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Cabin
Existing PVC Vent
Existing PVC Pressure Manifold
Proposed tank 4ft
Slope 2%
Proposed Drainfield
Existing 1500 gal tank
Existing drain field
Slope 2%
House
Green House
Existing Water Lines