LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/06/2025 Expiration Date: 05/05/2026 Permit# 25-54669

Property Owner: Frank Longo

Mailing Address: [redacted]

Installer: Cory Clasen License #: 181

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new sand lined gravity system for 3 Bedroom House.

Legal: OSPREY VIEW ESTATES, S13, T36 N, R28 W, LOT 12B, ACRES 8.4, PM 6452

Property Address: 838 Paradise Ridge Rd., Rexford, MT 59930 Assessment Code: 54669

DEQ COSA: E.Q.# 03-1533 Date: 03/26/2003

Approved Design Criteria: Installation of new sand lined gravity system for 3 Bedroom House with 3 Laterals @ 65'.

# of Bedrooms: 3 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg Date: 6/27/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Marquardt & Marquardt Surveying
Kalispell, Mt

name-Amend. Sub. Plat of Lot 12
Osprey View Estates
county-Lincoln
location- NW¼sec.13-T36N-R28W
drawn by-Brian S. Launius
E.Q.# _____

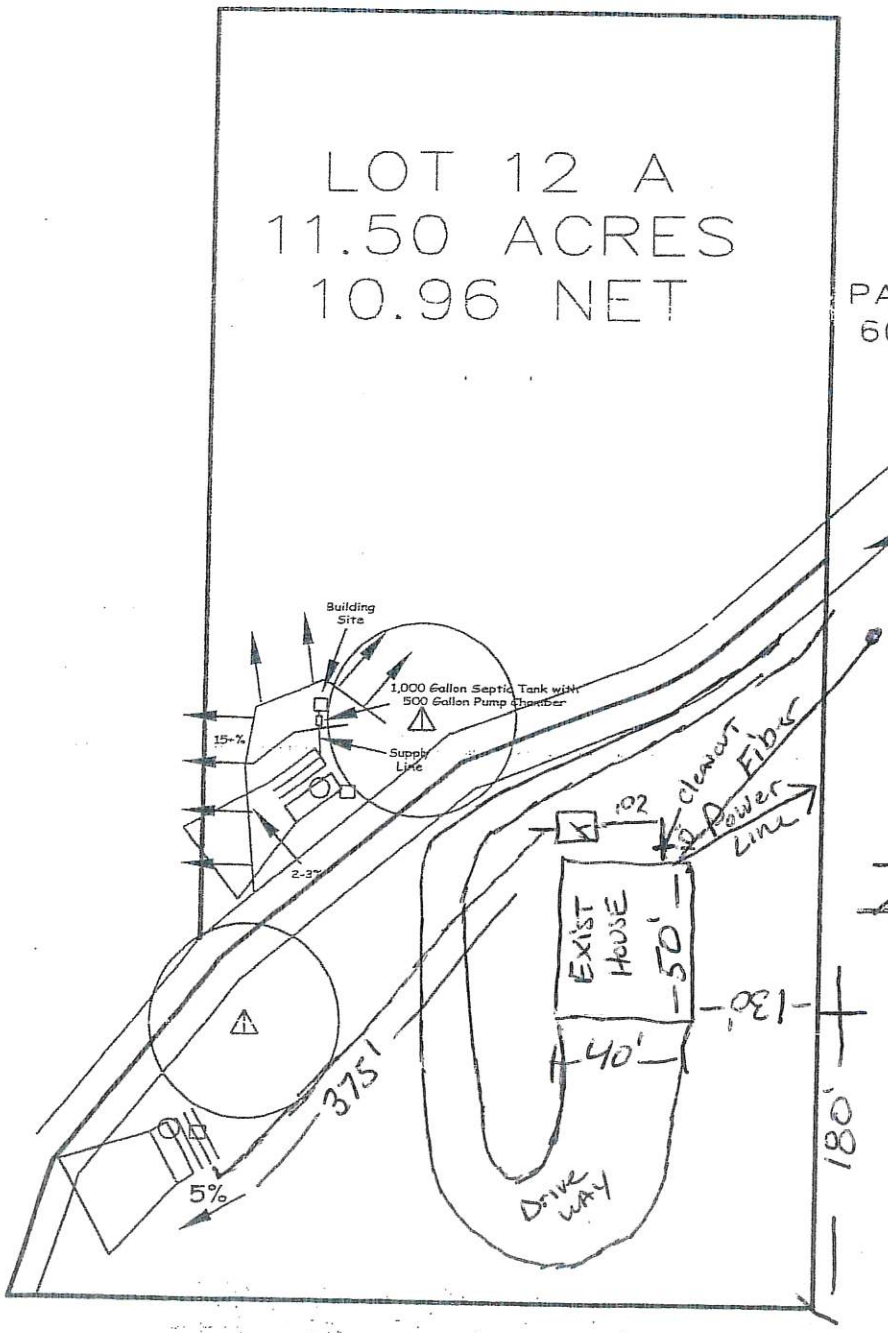

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
2003
Tim Read 3-26-03
Reviewer Date

Revised 3/10/03 - Added supply line & septic tank location.

Legend
- perc test
- test hole
- well site w/100' isoloation zone
- drainfield site
- replacement area
- mixing zone

LOT 12 B
9.20 ACRES
8.40 Net

N

SCALE- 1"= 2