LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/25/2020 Expiration Date: 08/25/2021

Property Owner: Neil & Robyn Newton c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Self License No.

___ New Installation ___ Existing System

___ Repair __XX__ Replacement ___ Extension ___ Other

Describe: Three 85' Laterals using chambers.

Parcel Description:

Legal: S32, T30 N, R33 W, TR-4NA 1N N2S2SWNE 1.204 ACRES

Address or Location: 27 Hawkeye Ln Troy, MT 59935

Geo/Assessors code: 0000009939

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 85'

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, J. MERTES, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 9/25/2020

Title: _____

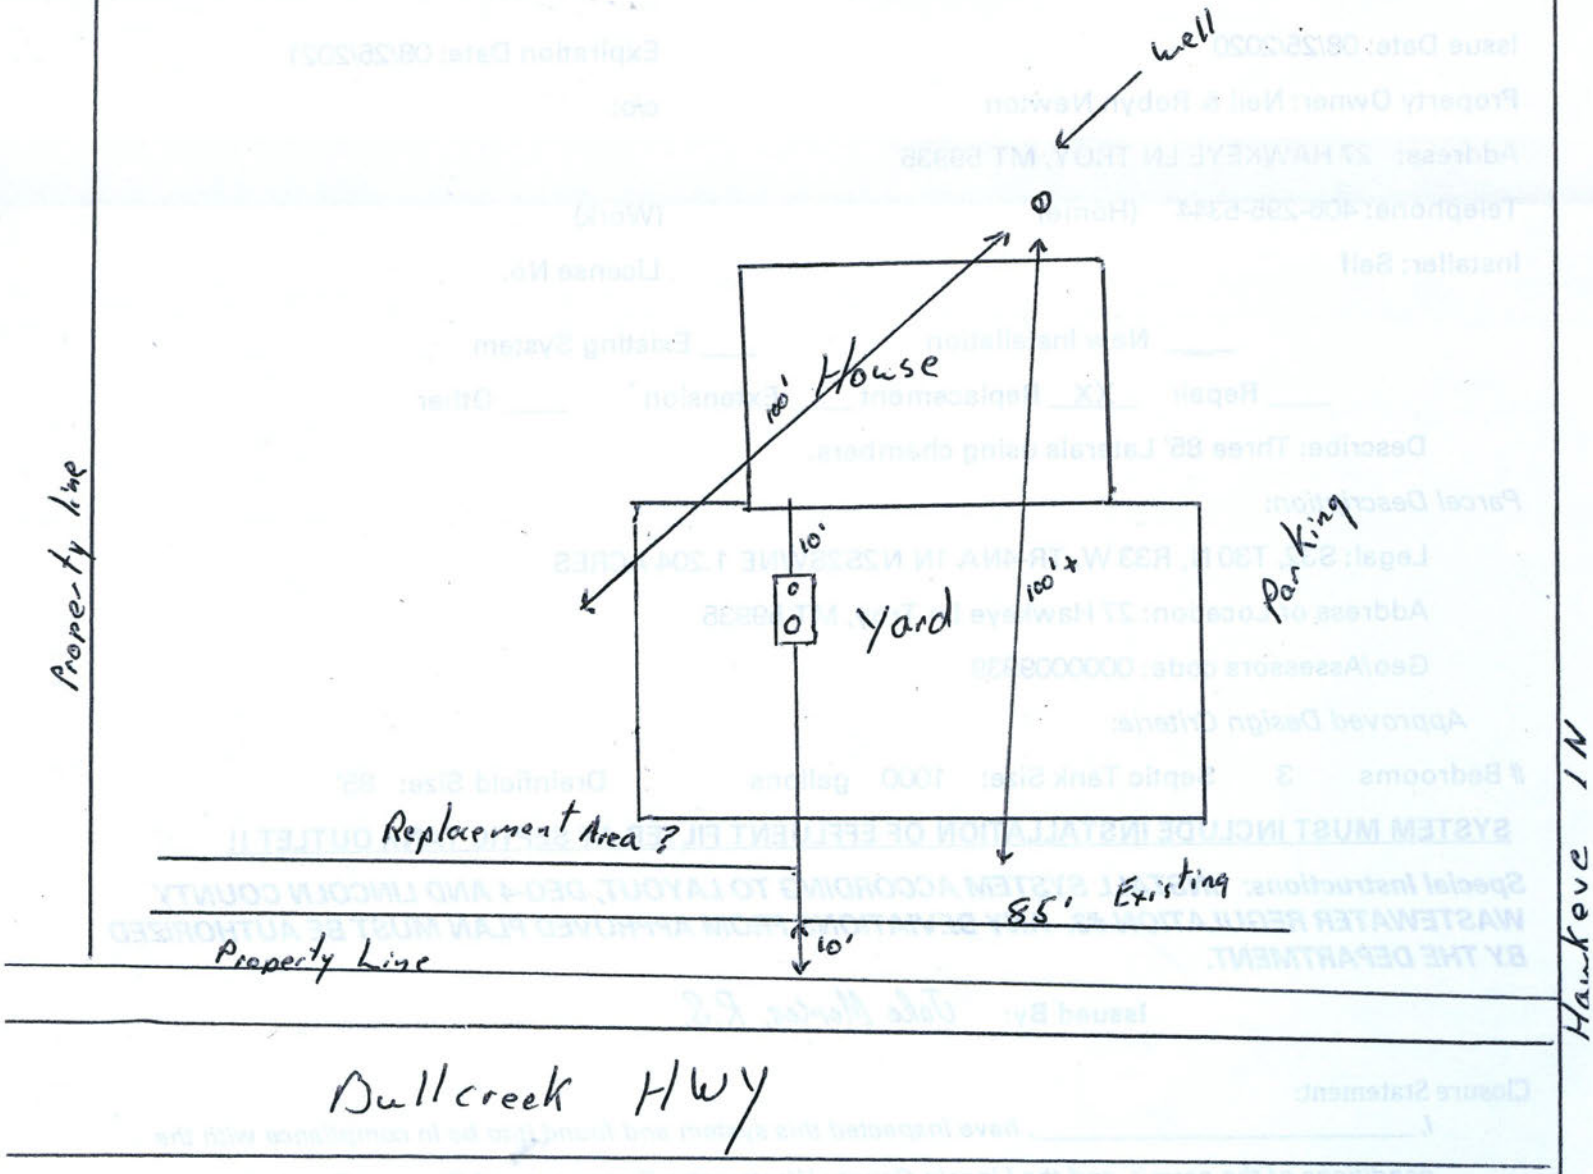
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


well
100' House
10'
Yard
100'±
parking
Property line
Replacement Area?
Existing
85'
10'
Property Line
Bullcreek HWY
Hawkeye LN