LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/25/2020 Expiration Date: 08/25/2021

Property Owner: Denny & Teresa Phillips c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Royden Caldwell License No. 171

___ New Installation ___ Existing System

___ Repair __XX__ Replacement ___ Extension ___ Other

Describe: Four 94' Laterals using drain rock & perf pipe.

Parcel Description:

Legal: S25, T36 N, R27 W, TRS 7C & 1B1 IN SE OR PARCEL A CS #1496 53.33 ACRES

Address or Location: 2151 Tobacco Rd Eureka, MT 59917 Parcel A

Geo/Assessors code: 0000014836

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 376 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

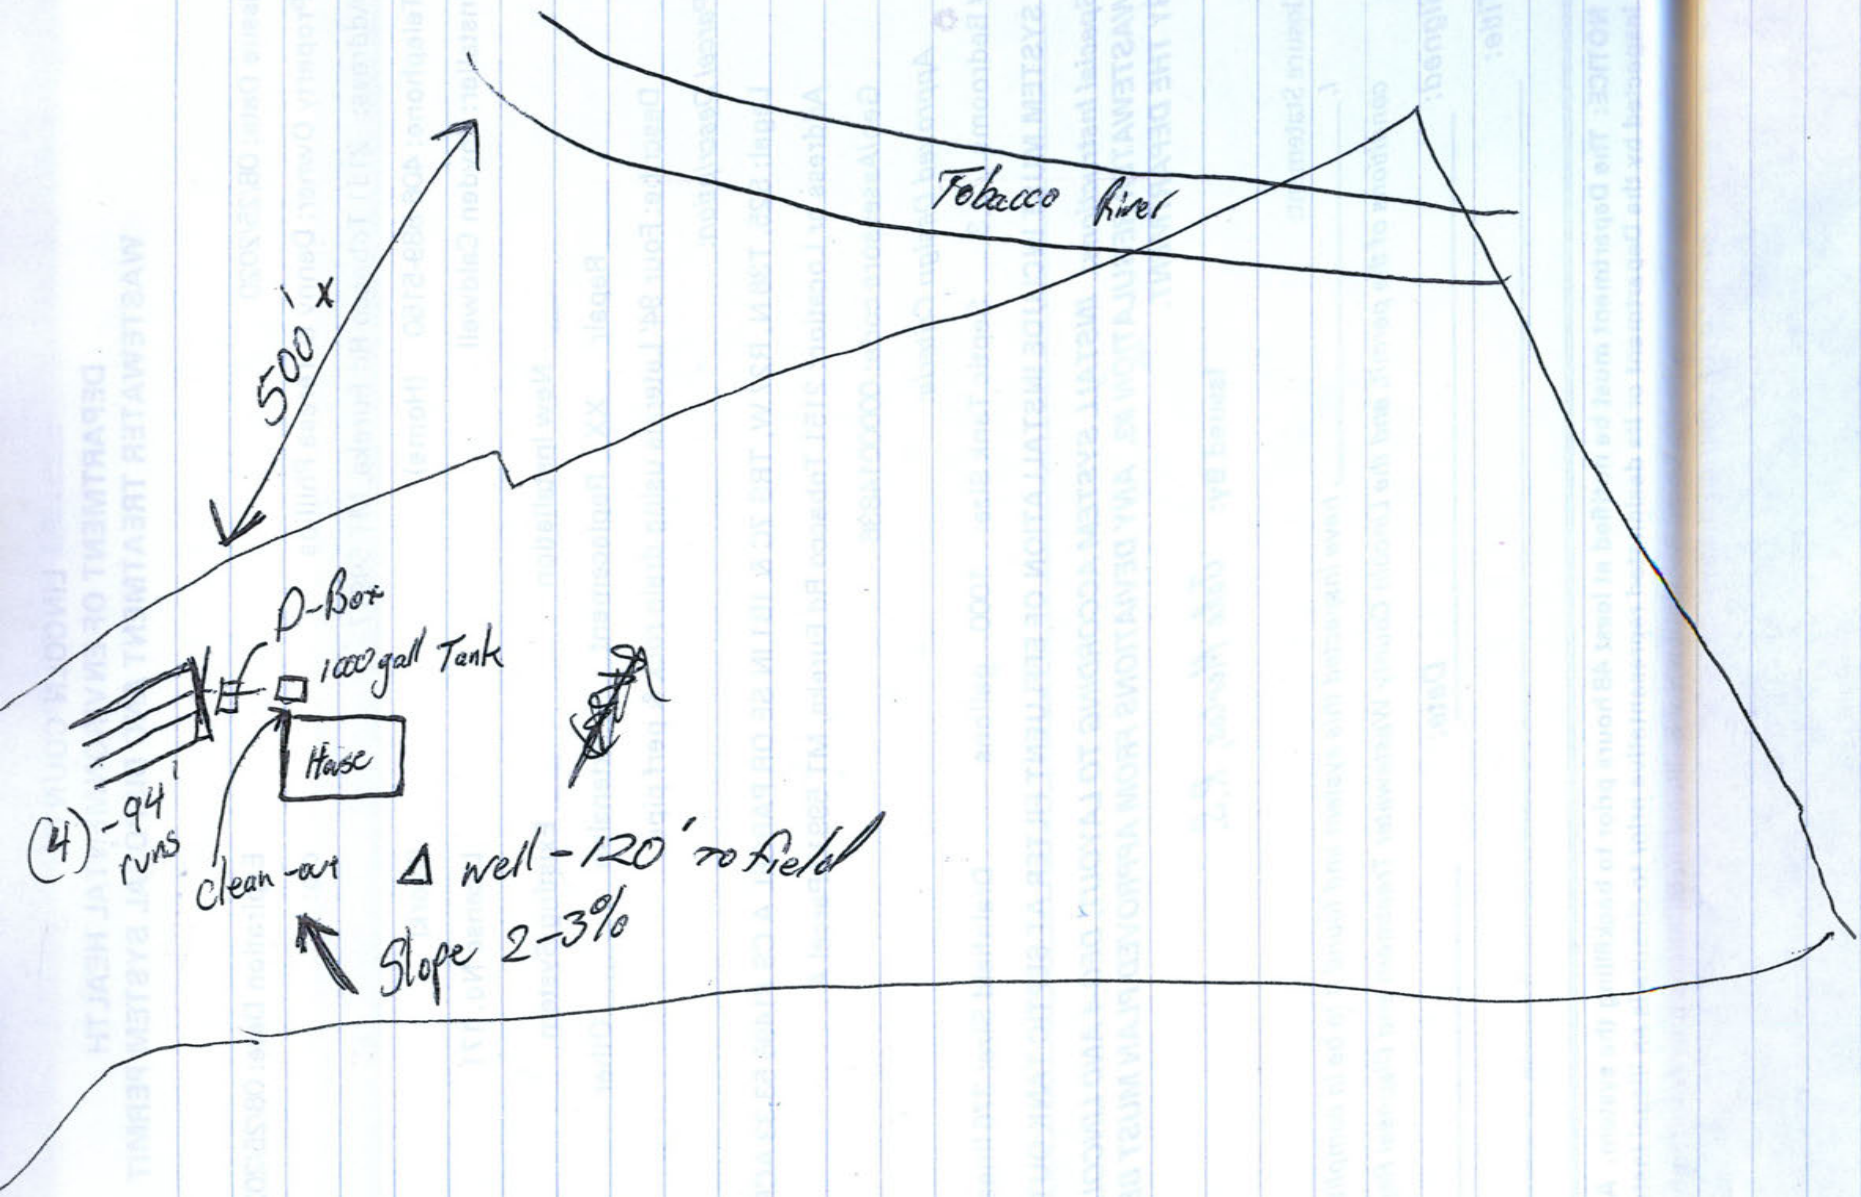
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Tobacco River
500' ±
P-Box
1000 gall Tank
House
(4) - 94' runs
Clean-out
Δ well - 120' to field
Slope 2-3%