# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/22/2020 Expiration Date: 09/22/2021

Property Owner: James Post c/o:

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Koocanusa Excavating License No. 135

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Pressure doses system.

*Parcel Description*:

Legal: VICK, S11, T37 N, R27 W, ACRES 5.02, LOT 4 PM 6917

Address or Location: 144 Horse Collar Rd Eureka, MT 59917

Geo/Assessors code: 0000055446

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: (3)-58' Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

I, BUCK SCHERMERHORN, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* 12/22/20

*Title:* PRESIDENT


**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

| REVISIONS | | | |
|---|---|---|---|
| REV | DESCRIPTION | BY/DATE | APRD/DATE |
| | | | |

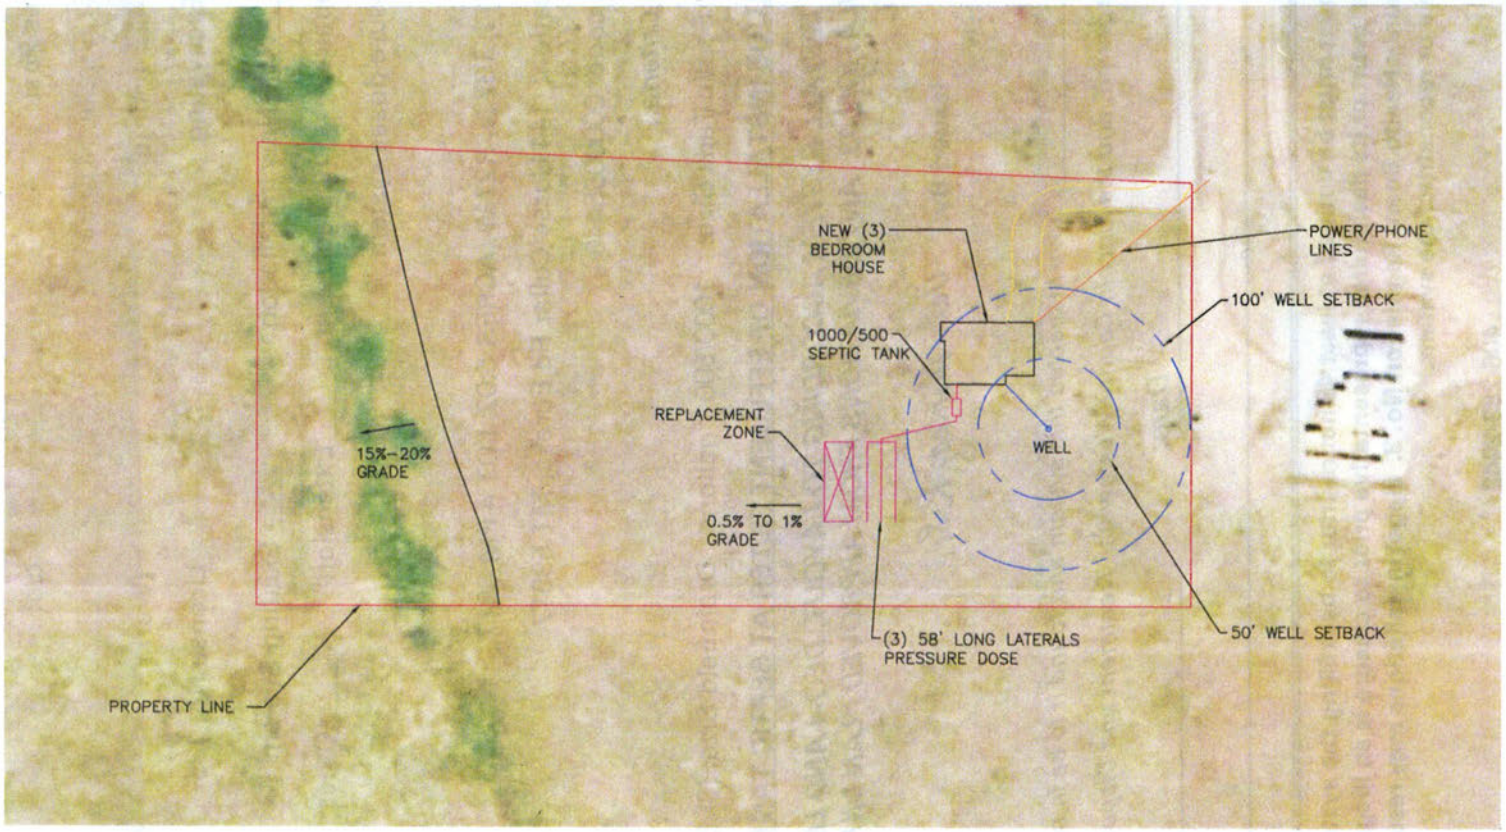


# POST SITE LAYOUT

THIS DRAWING IS PROPERTY OF KEI UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

| REV | DATE | COMPANY: KEI | SCALE: 1/16 = NOTED | KODCANUSA EXCAVATING POST SEPTIC PERMIT |
|---|---|---|---|---|
| | | CONTRACT: | DATE: | SITE LAYOUT |
| | | VERBAL | 6/2020 | DRAWN BY: 8/13/20 |
| | | PLOT FILE: PML-0001 | WEIGHT | B. MCNAMARA 8/13/20 |
| | | | FINISH | POST 1 |