LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/4/2020 Expiration Date: 9/4/2021

Property Owner: Jennifer Remp c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Terry Oedewaldt License No. 002

__XX__ New Installation ____ Existing System

____ Repair ___ Replacement ____ Extension ____ Other

Describe: Four 66' Laterals using chambers.

Parcel Description:

Legal: S33, T31 N, R31 W, C.O.S. 4642 Tract A

Address or Location: 252 Kootenai Views Dr Libby, MT 59923 Tract C

Geo/Assessors code: 50492

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: ~~284~~ 260 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Terry Oedewaldt, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 2/17/21

Title: President

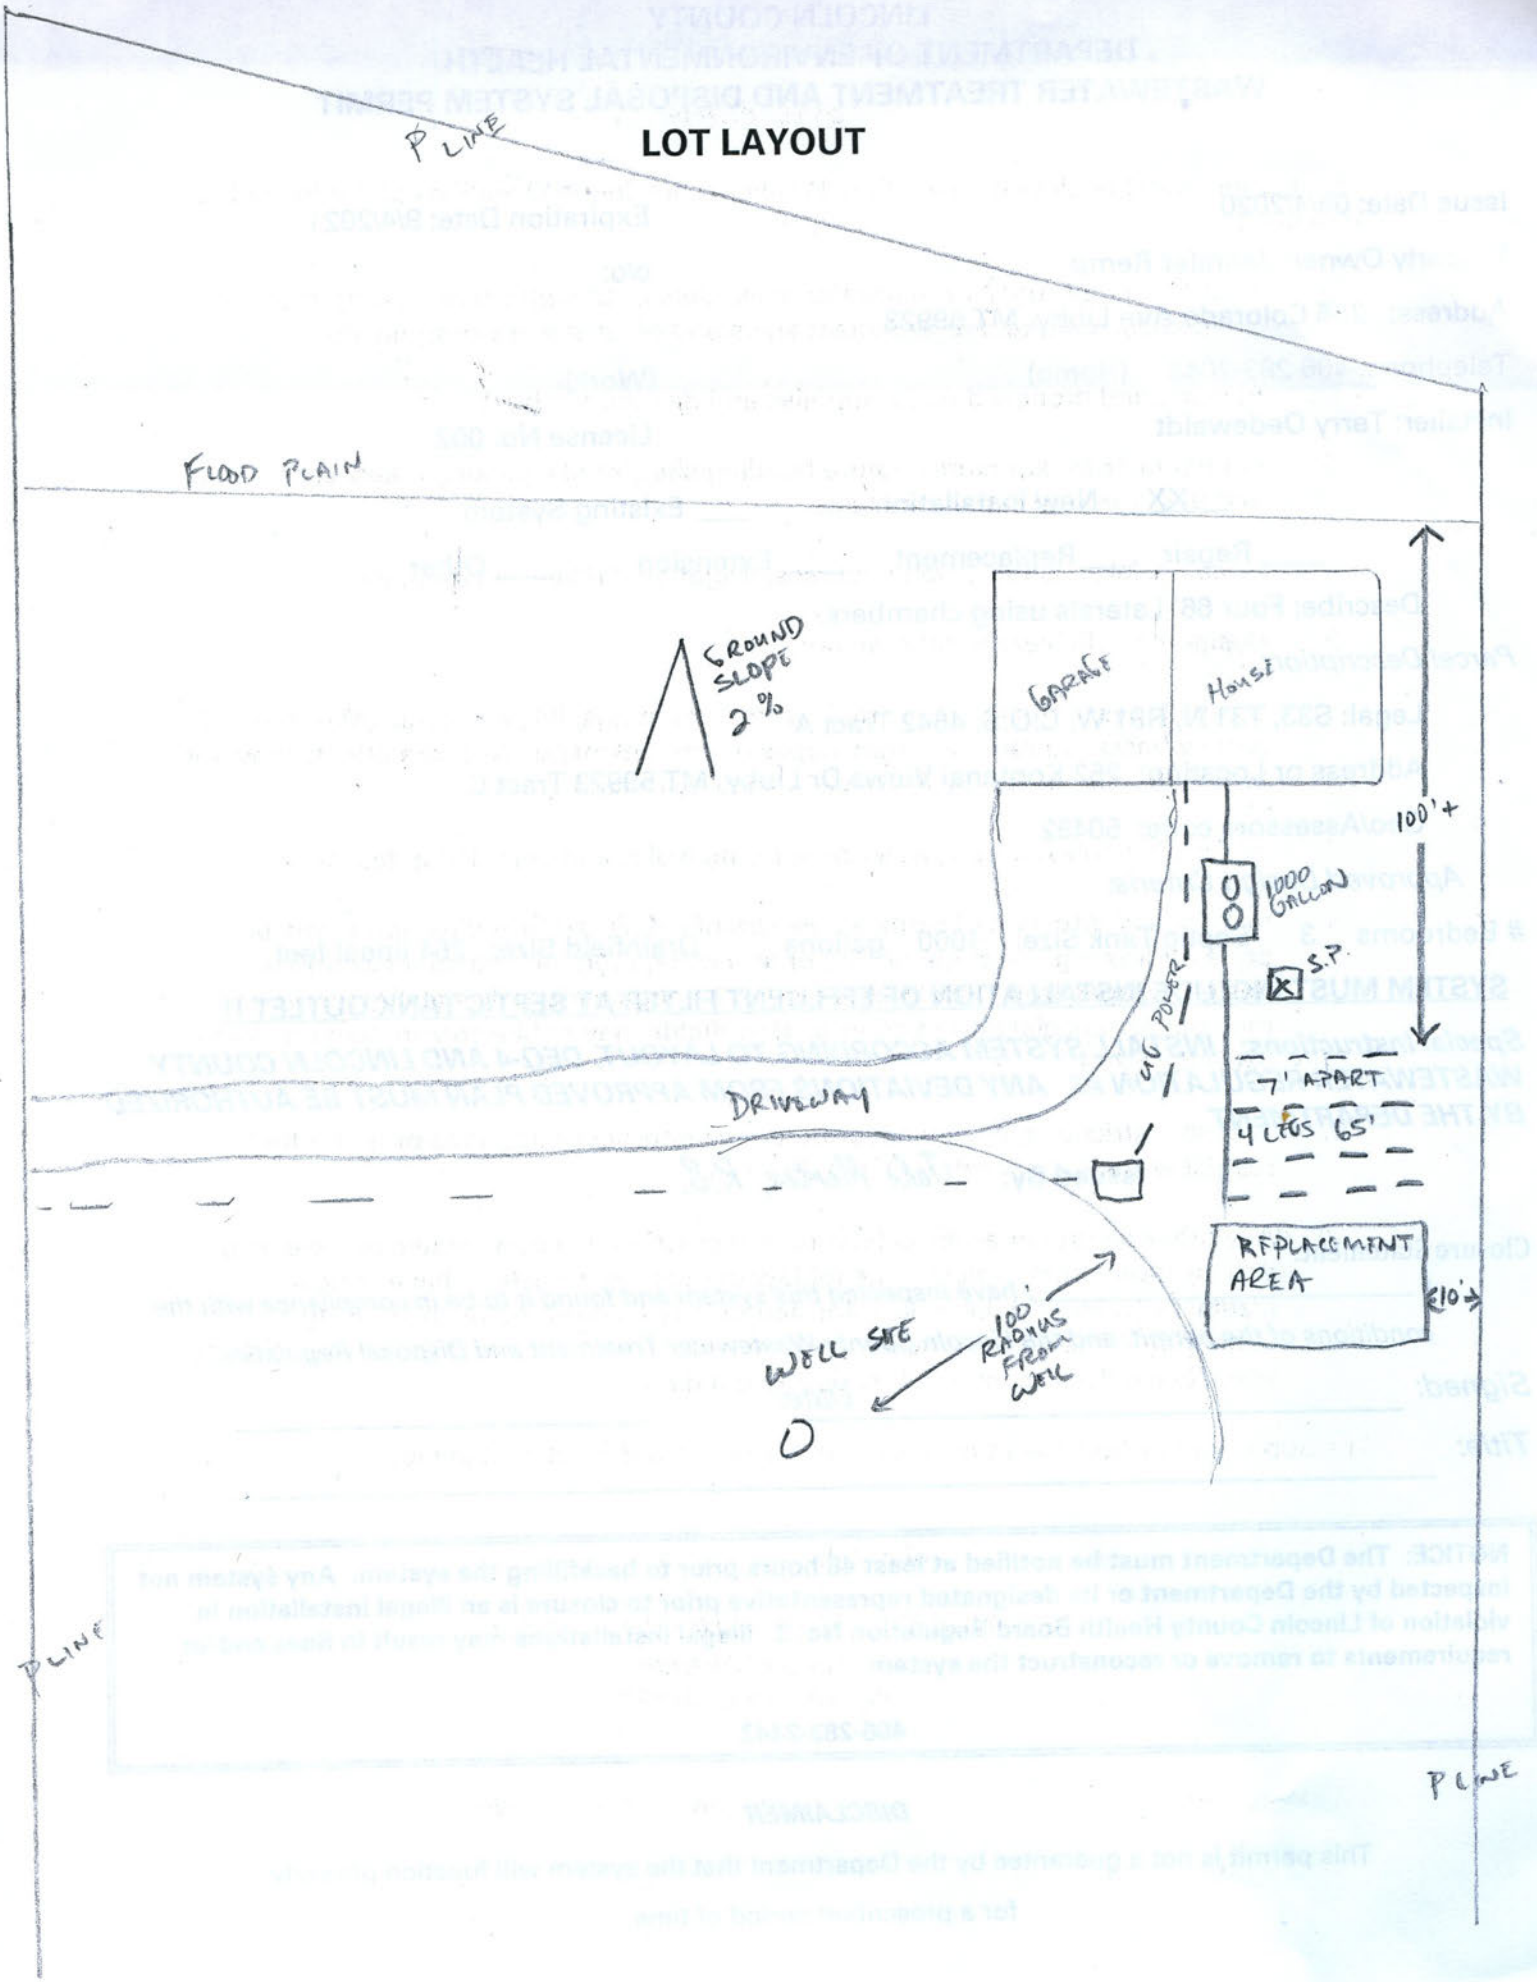
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


P LINE
FLOOD PLAIN
GROUND SLOPE 2%
GARAGE
HOUSE
100'+
1000 GALLON
S.P.
6" POWER
DRIVEWAY
7' APART
4 LEGS 65'
REPLACEMENT AREA
10'
WELL SITE
100' RADIUS FROM WELL
P LINE
P LINE