LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 02/24/2021 -2022

Property Owner: Helen Russell

Mailing Address: [redacted]

Telephone: (Home) (Work) [redacted]

Name of Person Who Installed System Being Reviewed: Glenn Larson of Larson Landscaping

Type of System Work Reviewed:

___ New Installation __XX__ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 100' laterals using drain rock and perf pipe.

Property Description:

Legal: S14, T36 N, R28 W, C.O.S. 3876, PARCEL B, ACRES 4.22,

Address or Location: Parcel B

Reviewed Design Components:

Wastewater Flows: 300/day Sewer Lines: Septic Tank: 1000 Gallons EffluentFilter: YES

Dosing or Lift Tank: NO Drainfield: 300 Lineal Feet Drainfield Construction: drain rock

Hydraulic Function: yes

Comments:

System Review Documentation Statement:

I, Glenn Larson, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.

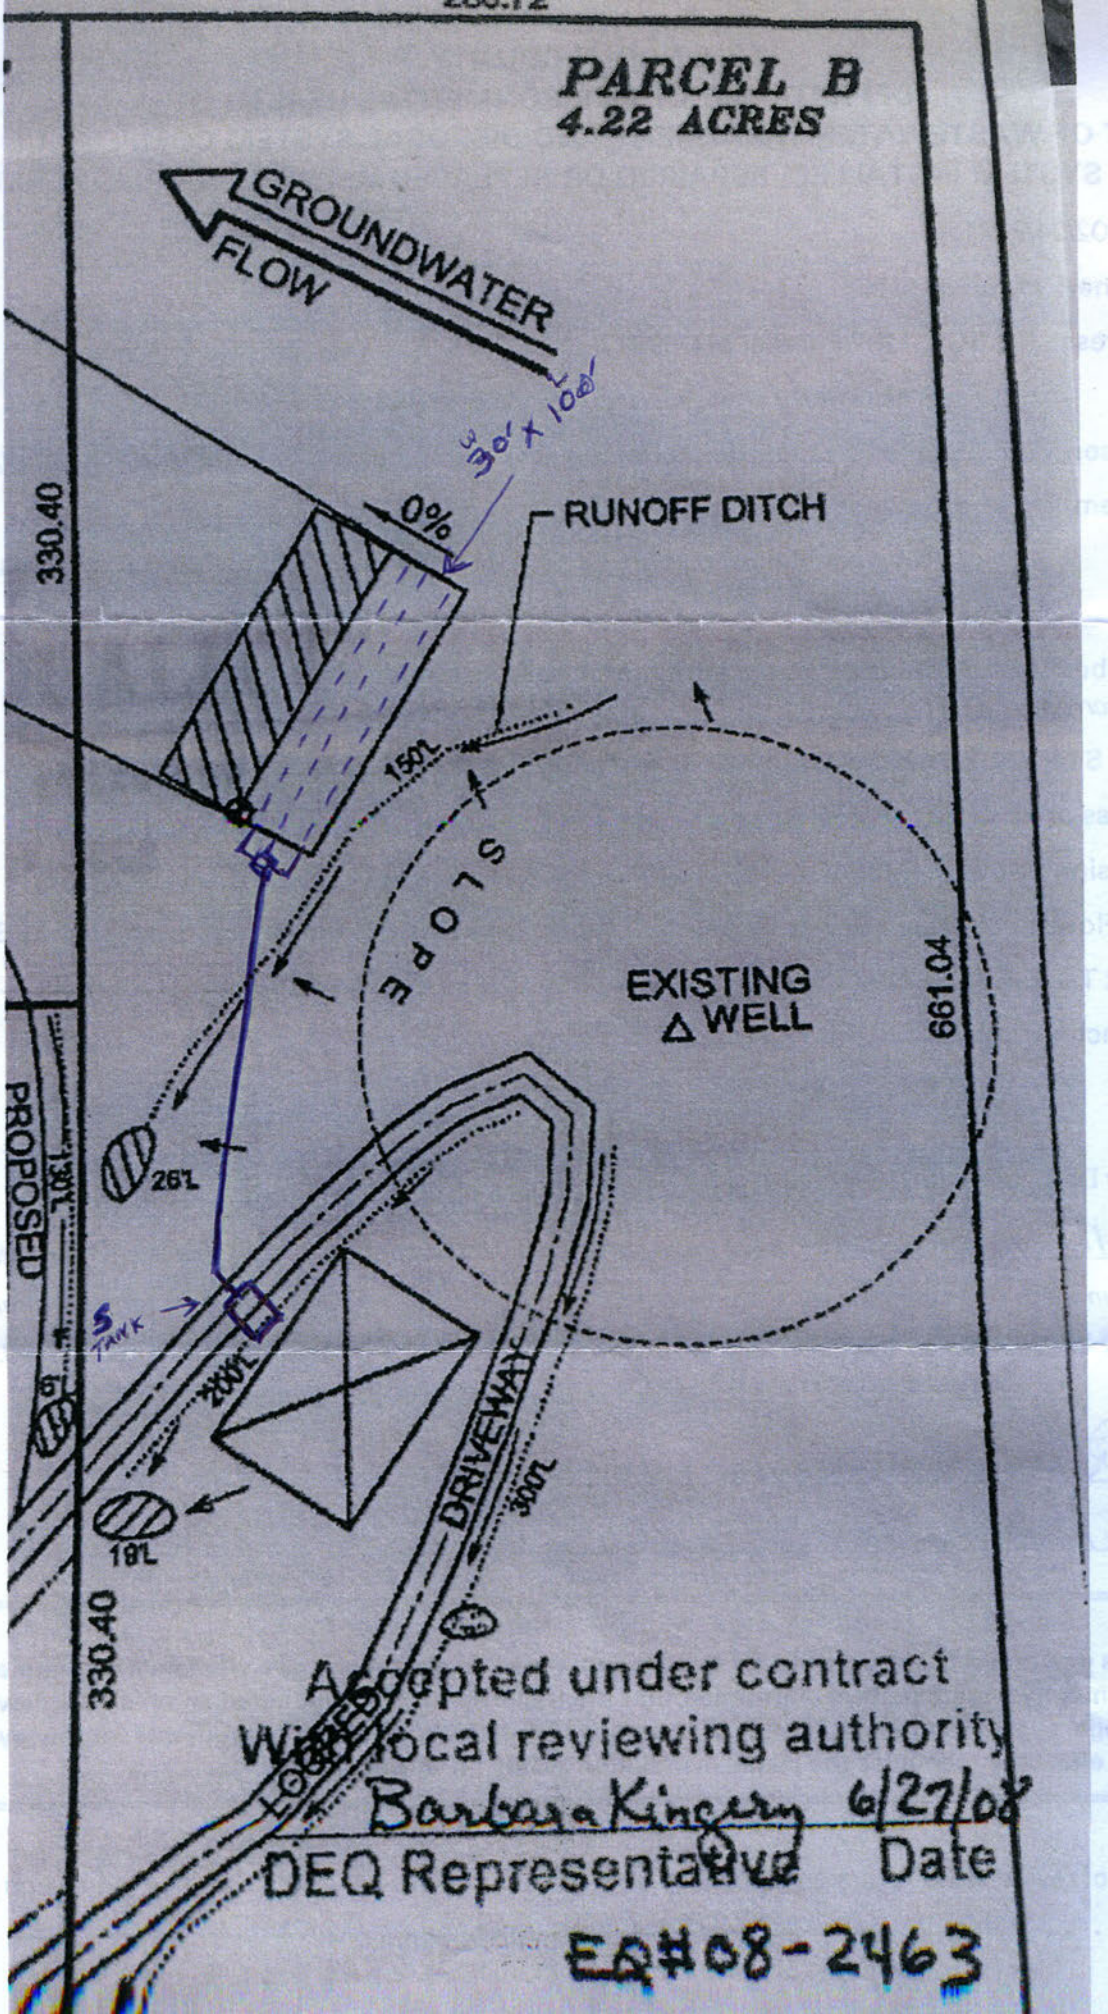
Signed: Glenn Larson *Date:* 3-1-2021

Title: Installer

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.


PARCEL B
4.22 ACRES
GROUNDWATER FLOW
30' X 100'
0%
RUNOFF DITCH
330.40
150L
SLOPE
EXISTING WELL
661.04
PROPOSED
190L
26'L
5 TANK
200L
DRIVEWAY
360L
19'L
330.40
LOOP
Accepted under contract
With local reviewing authority
Barbara Kingery 6/27/08
DEQ Representative Date
EQ#08-2463