LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 6/11/2025 (Renewal) 05/28/2024 Expiration Date: 6/10/2026 Permit# 25-19883

Property Owner: Colter Salminen

Mailing Address: [redacted]

Installer: Donavan Truman License #: 109

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Parcel Description:

Legal: EKHOLT 2, S31, T36 N, R26 W, LOT 2, ACRES 16.001

Property Address: 3466 Tobacco Rd., Eureka, MT 59917 Assessment Code: 19883

DEQ COSA: EQ#22-1899 Date: 3/22/22

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 4 Laterals @ 84'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 4 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/8/25


✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

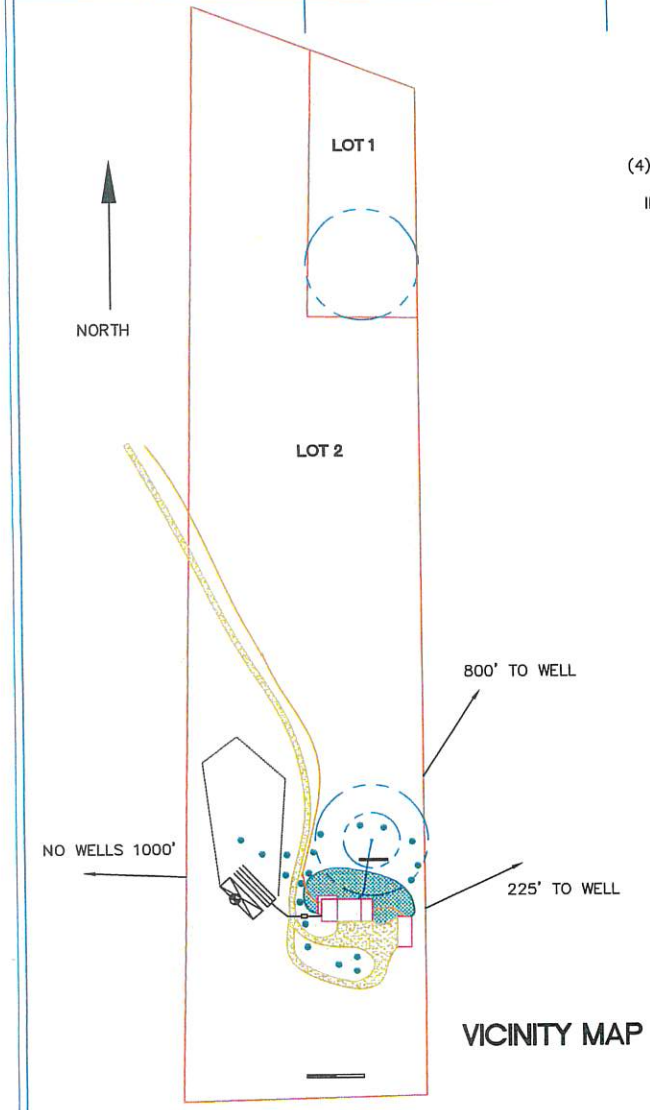

VICINITY MAP

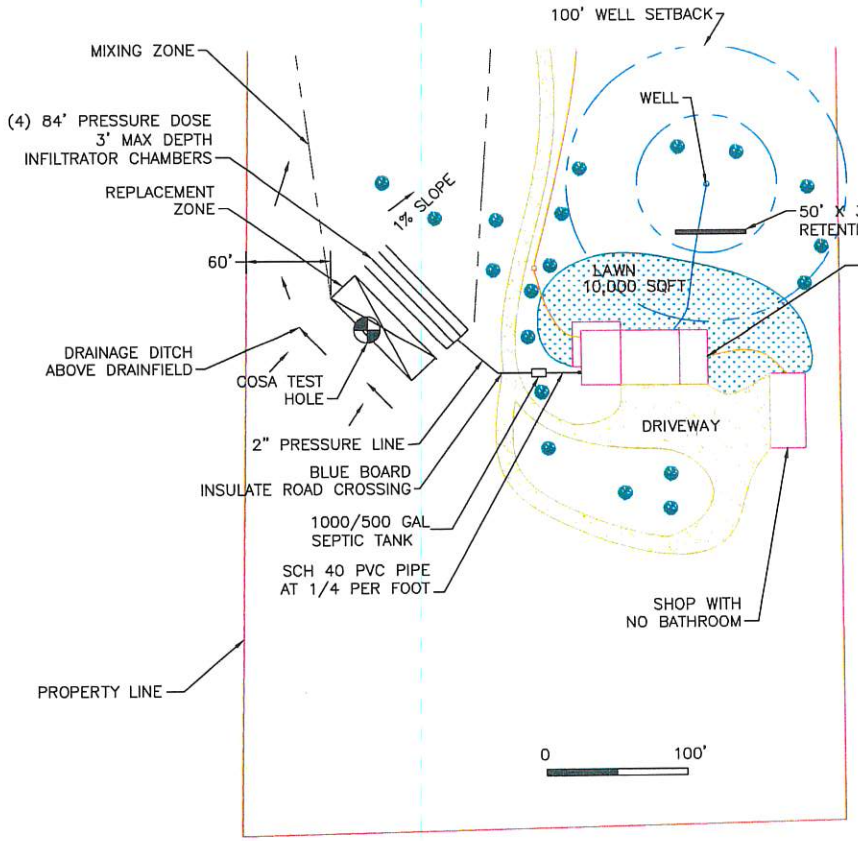

COLTER SALINMEN SITE LAYOUT

DRAINFIELD SIZING

(3) BEDROOM= 300 GPD
300 GPD/0.3 APP= 1000 SQFT
1000 SQ FT/3' CHAMBERS= 333 LF
333 LF/ 4 LATERALS= 84'

LOT 2

16.001 ACRES
3466 TOBACCO RD, EUREKA, MT 59917
S31, T36N, R26W, PM 7241
ASSESSMENT #0000019883
GEO 56-4824-31-4-02-22-0000
COSA 22-1899 3-2022

UPDATE 4/23/25

REV	DESCRIPTION	BY/DATE	APRD/DATE

REV	DATE	COMPANY	SCALE:	MONTANA DESIGN SERVICES SALINMEN SEPTIC
		MDS	1/16 & NOTED	SITE LAYOUT
		CONTRACT:	DATE:	1ST AMENDMENT 4/21/25
		VERBAL	4/2024	C. SALINMEN 4/23/25
		PLOT FILE:	WEIGHT	JOB NO. 336-001 SHEET 1
		PML-0001		

THIS DRAWING IS PROPERTY OF MDS UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & MDS IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT