**LINCOLN COUNTY**
**DEPARTMENT OF ENVIRONMENTAL HEALTH**
**AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT**

Issue Date: 07/21/2020 2021 ✓

Property Owner: Spencer Sartori

Mailing Address: [redacted]

Telephone: [redacted] (Home) (Work)

Name of Person Who Installed System Being Reviewed:

Type of System Work Reviewed: Rupert Schreiner

___ New Installation ___XX___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe:

*Property Description*:

Legal: S16, T34 N, R25 W, C.O.S. 3627, ACRES 12.69, REMAINDER IN NW

Address or Location: 842 Trego Rd, Trego MT 59934

Reviewed Design Components:

Wastewater Flows: Sewer Lines: Septic Tank: 1,000 Effluent Filter: yes

Dosing or Lift Tank: N/A Drainfield Size: 200 Lineal Ft

Drainfield Construction: Drainrock

Hydraulic Function: yes

Comments:

System Review Documentation Statement:

*I, Rupert Schreiner, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.*

*Signed:* Rupert D. Schreiner *Date:* 7-23-20


*Title:* Sit #19

**NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.**

***DISCLAIMER***

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.

# DAVIDOW FAMILY TRANSFER
REWRITE OF REMAINDER
NW1/4 NW1/4 S16, T34N, R17W
LINCOLN COUNTY

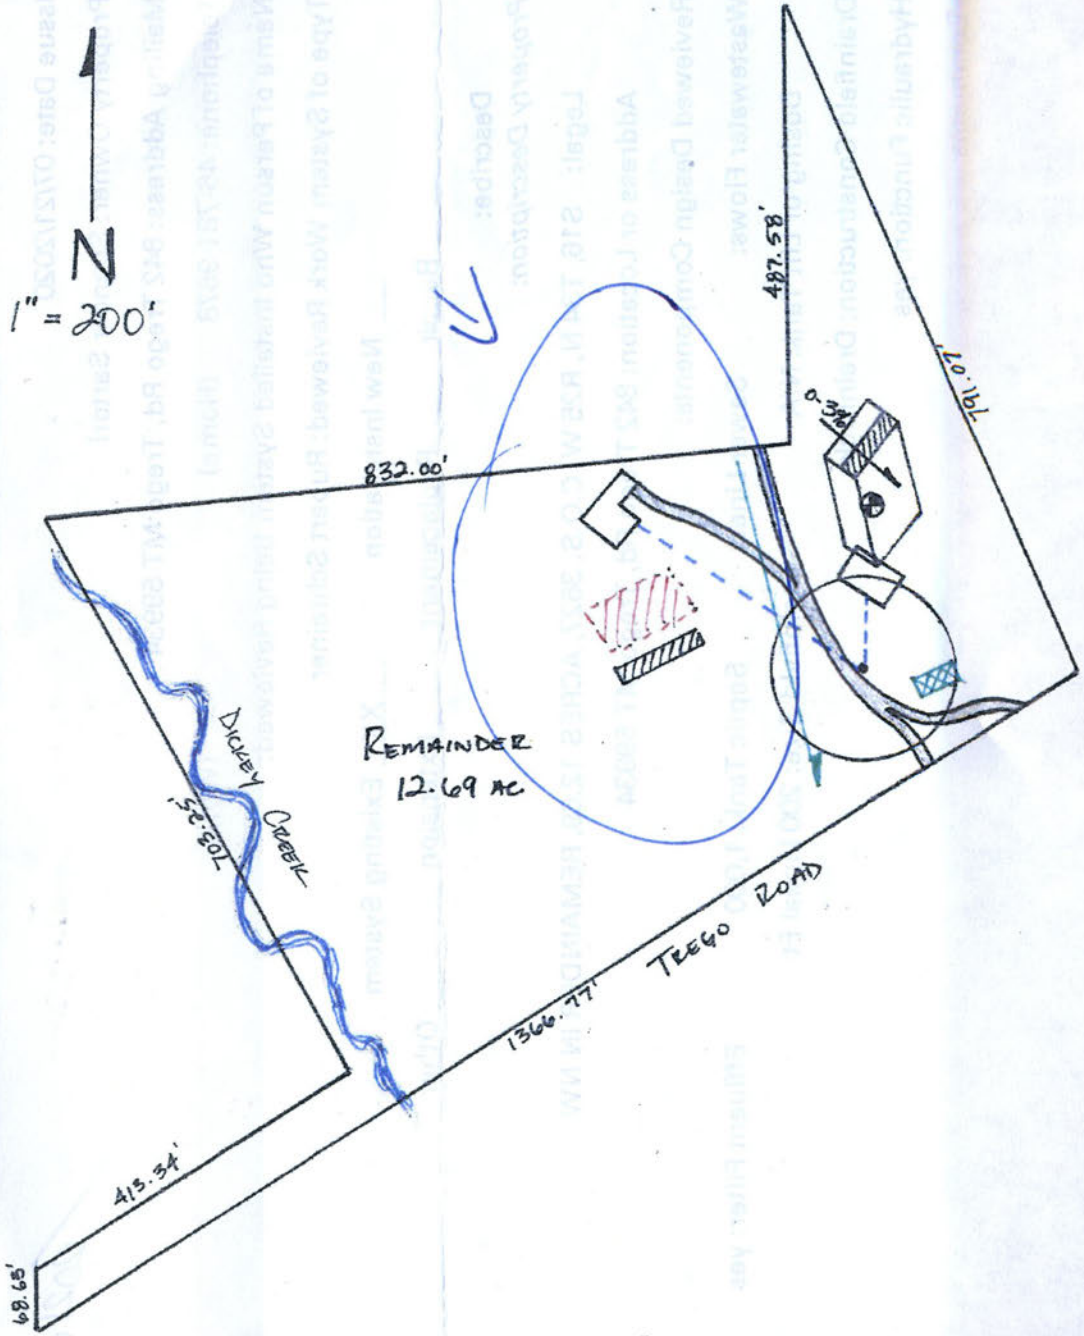


* NO WELLS OR D.F. W/IN 100' OF PROPERTY BOUNDARY *

KEY

- EXISTING WELL (NO WELL-LOG FOUND)
- WATER LINE
- APPROX. AREA OF EXISTING WWTS (NO PERMIT OF RECORD)
- PROPOSED D.F. & 100% REPLACEMENT AREA
- TEST HOLE LOCATION
- STORMWATER FLOW DIRECTION
- STORMWATER RETENTION POND (20' x 45' x 2')