LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/15/2015 Expiration Date: 8/10/2021 (Re-issue)

Property Owner: John Schmoll c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Self License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 72' laterals using gravelless chambers. Size reduced per 0.8 app rate.

Parcel Description:

Legal: S24 T32 R28

Address or Location: 3950 Five Mile Creek Rd

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 144 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes

Closure Statement:

I, Bill Rees, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

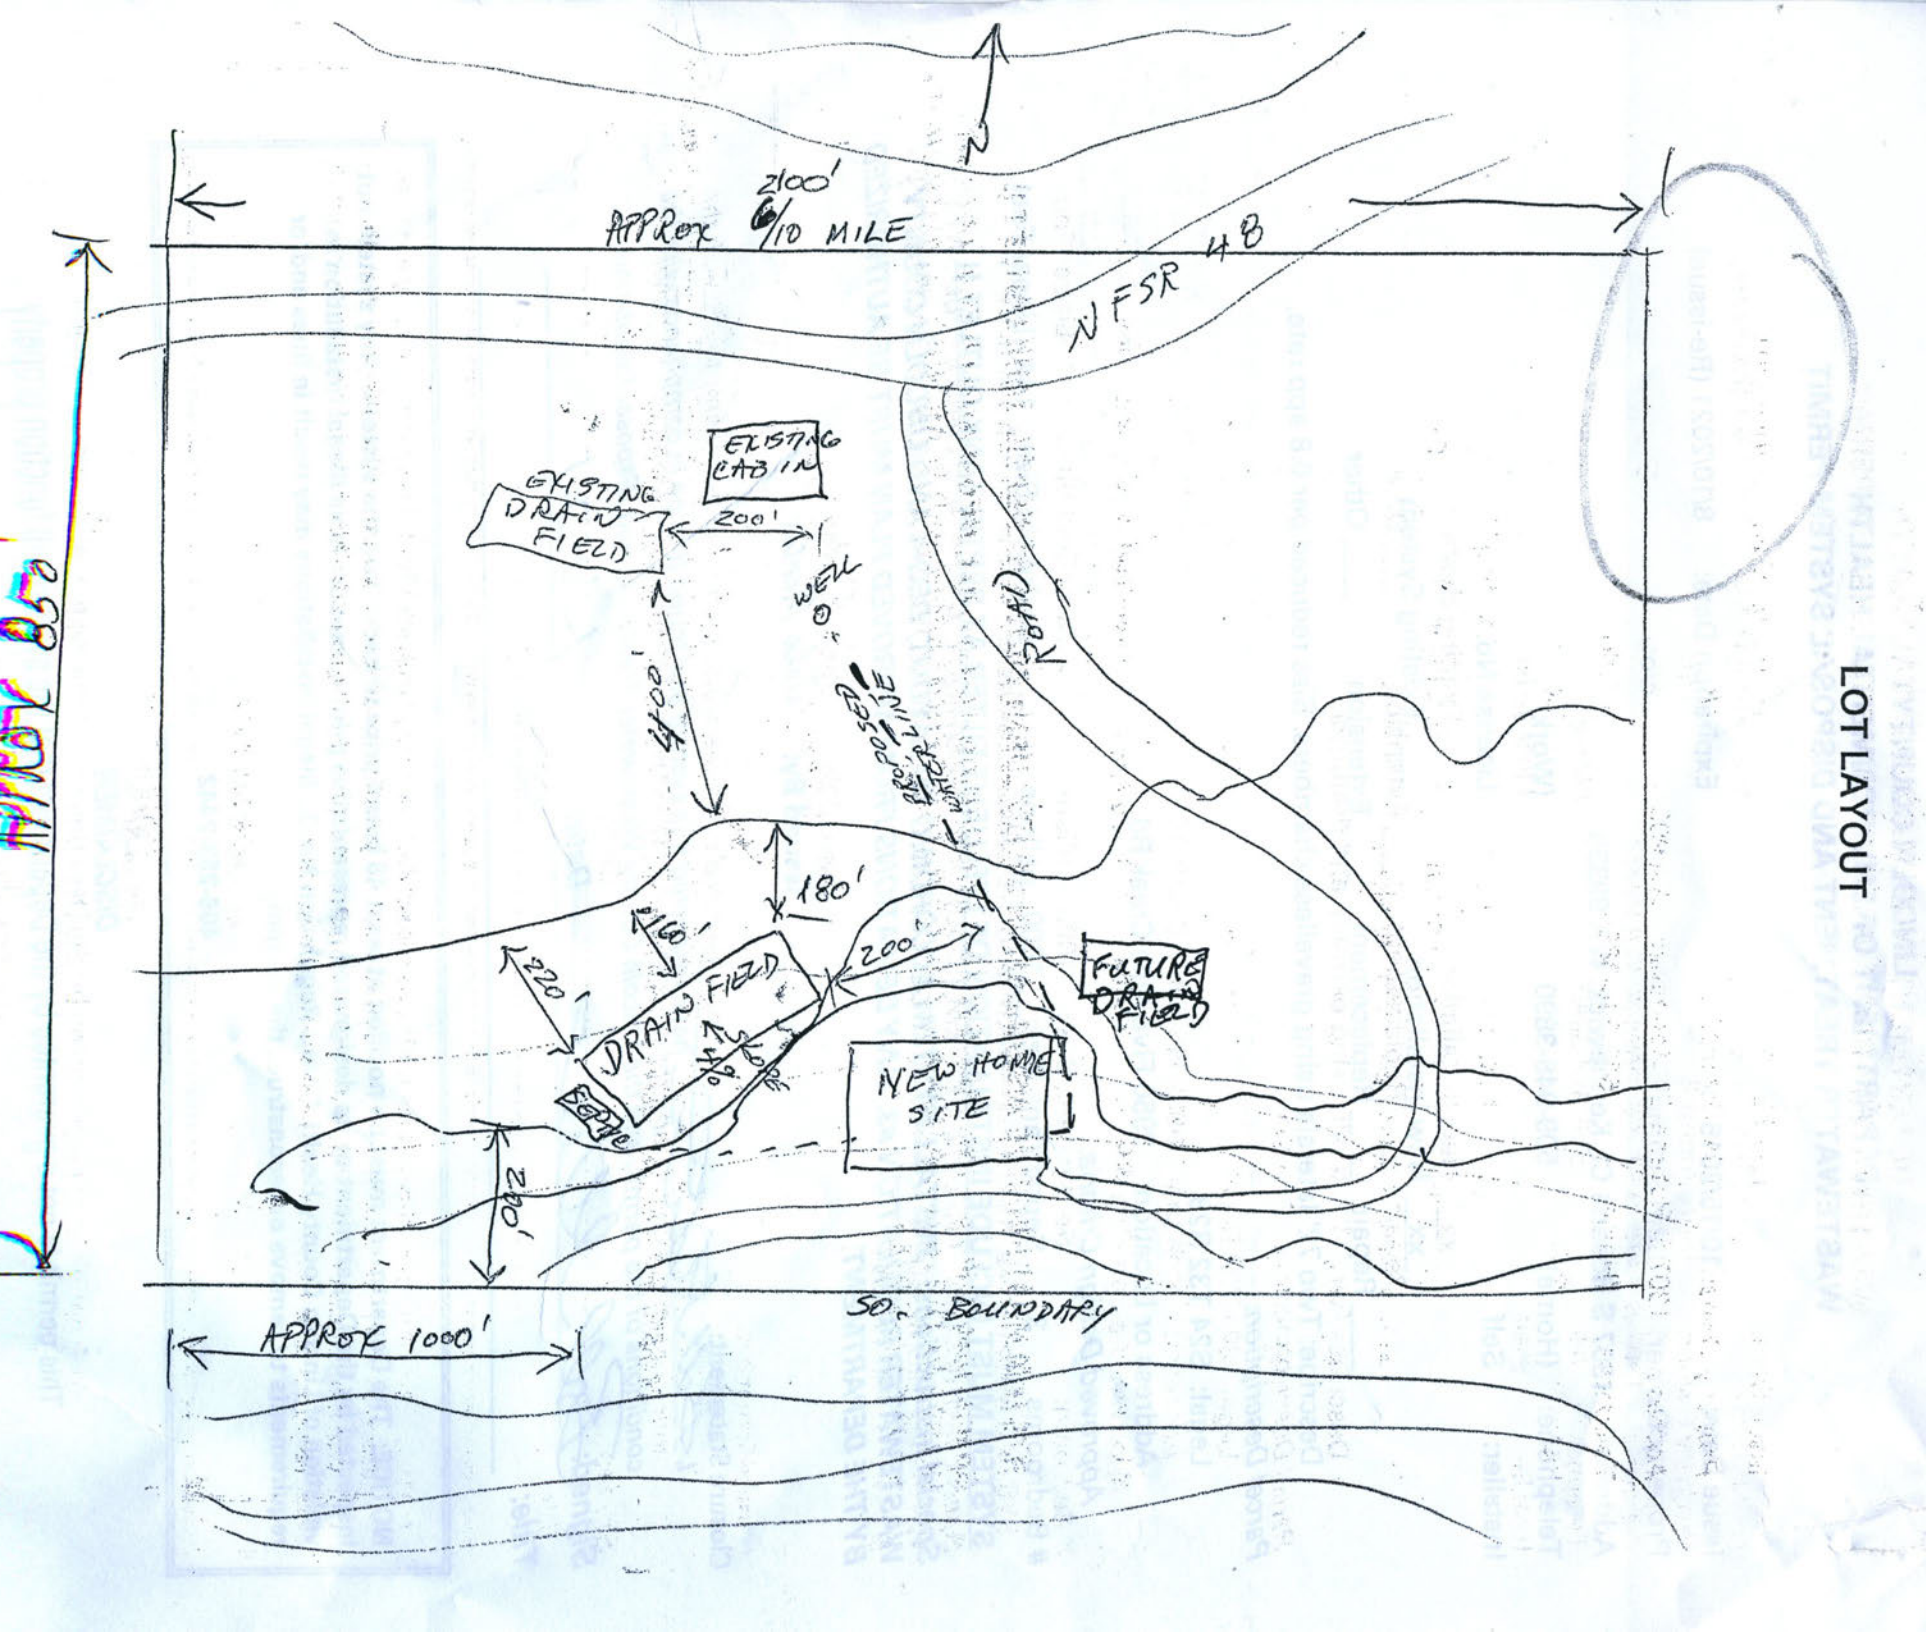
Signed: Bill Rees *Date:* 1-14-21

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


APPROX 850'
2100'
APPROX 6/10 MILE
NFSR 48
EXISTING CABIN
EXISTING DRAIN FIELD
200'
WELL
400'
APPROX SEA WATER LINE
ROAD
180'
160'
220'
DRAIN FIELD
200'
FUTURE DRAIN FIELD
NEW HOME SITE
240'
SO. BOUNDARY
APPROX 1000'
LOT LAYOUT