LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/11/2020 Expiration Date: 08/11/2021

Property Owner: Andrew & Anna Shay c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Bob Cuffe License No. 141

__XX__ New Installation ___ Existing System

____ Repair ___ Replacement ____ Extension ____ Other

Describe: Four 84' Laterals pressure dosed in 3' wide trenches using drainrock.

Parcel Description:

Legal: S31, T36 N, R26 W, C.O.S. 4402, ACRES 9.277, TRACT 1 in SE

Address or Location: TRACT 1

Geo/Assessors code: 0000054551

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 330 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Robert Cuffe *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 9/25/20

Title: President, GEI

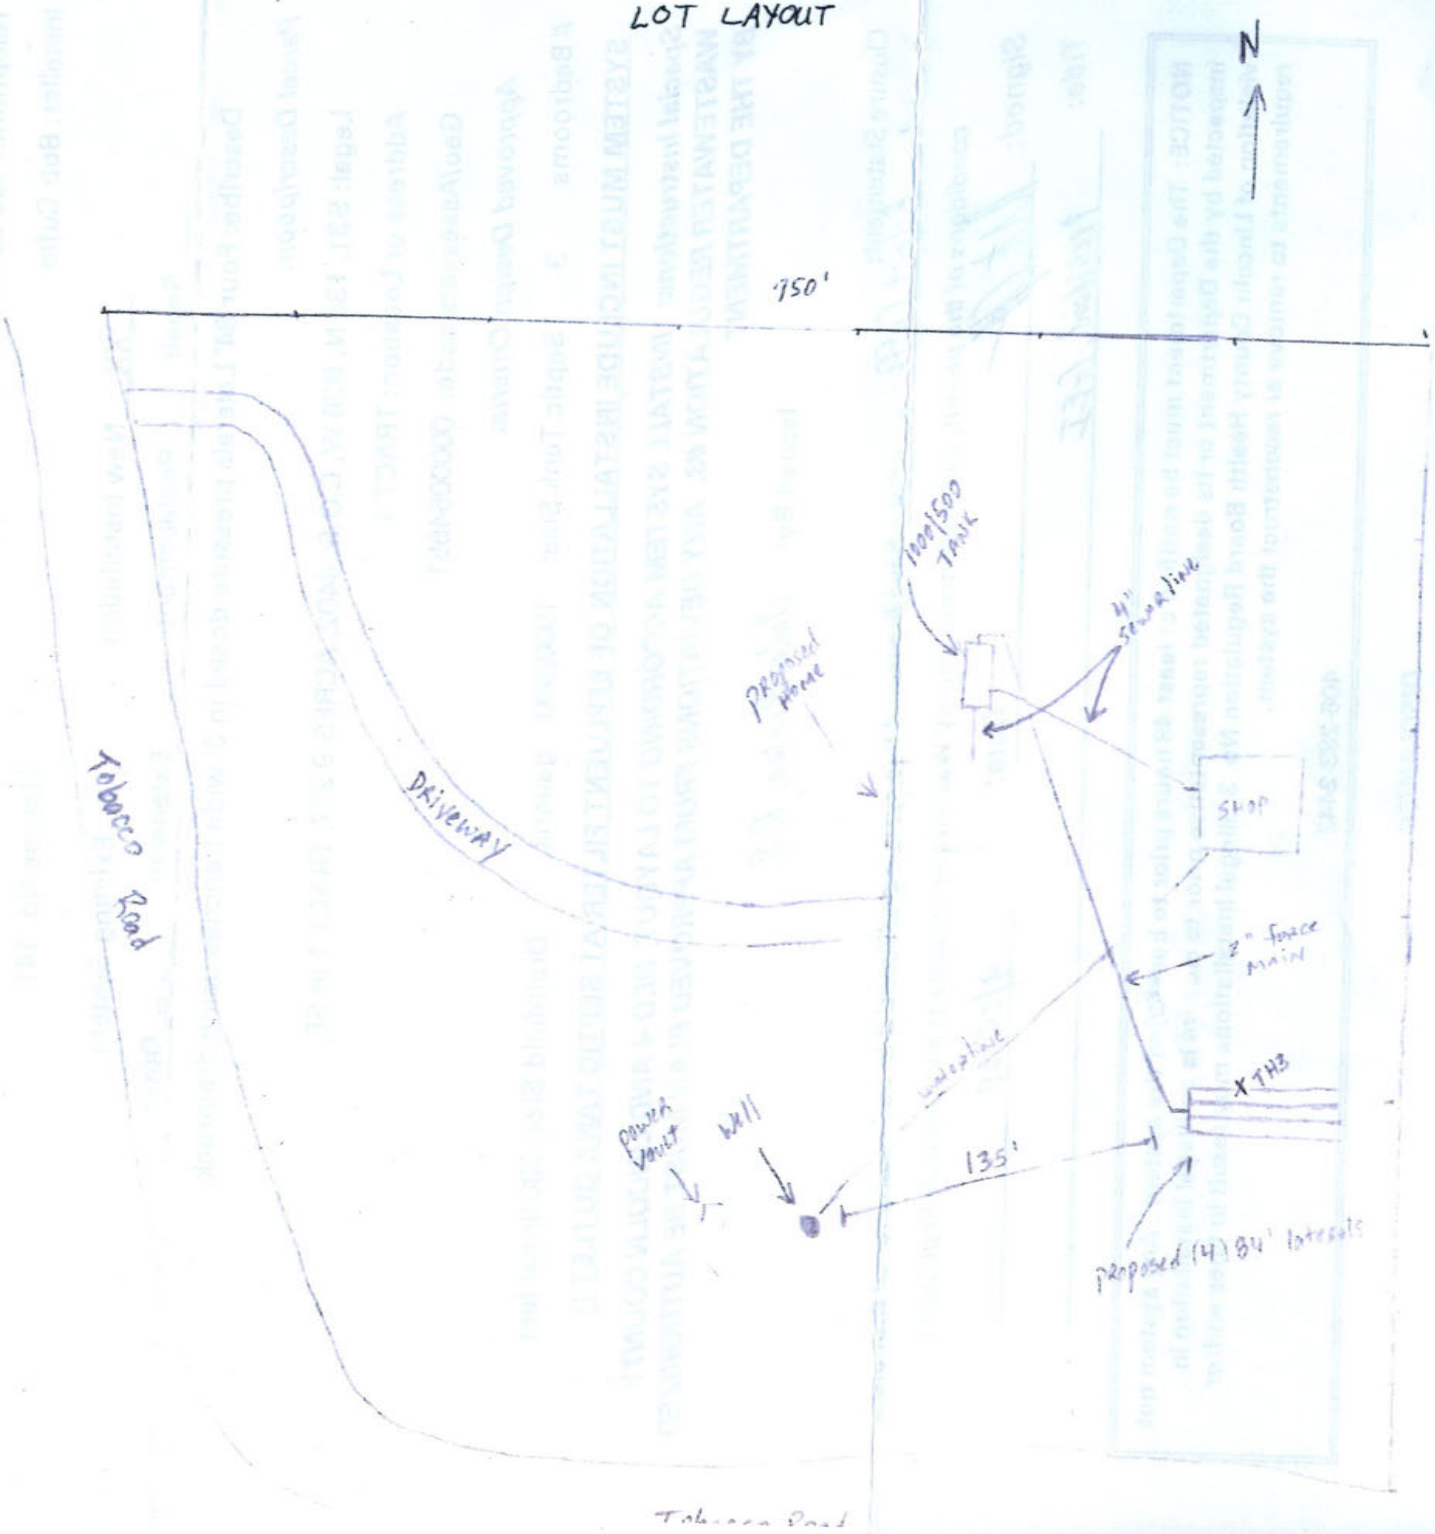
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


N
750'
1000/500 TANK
4" Sewer line
proposed home
SHOP
Tobacco Road
Driveway
2" force main
power vault
well
135'
proposed (4) 84' laterals
625
Tobacco Road